




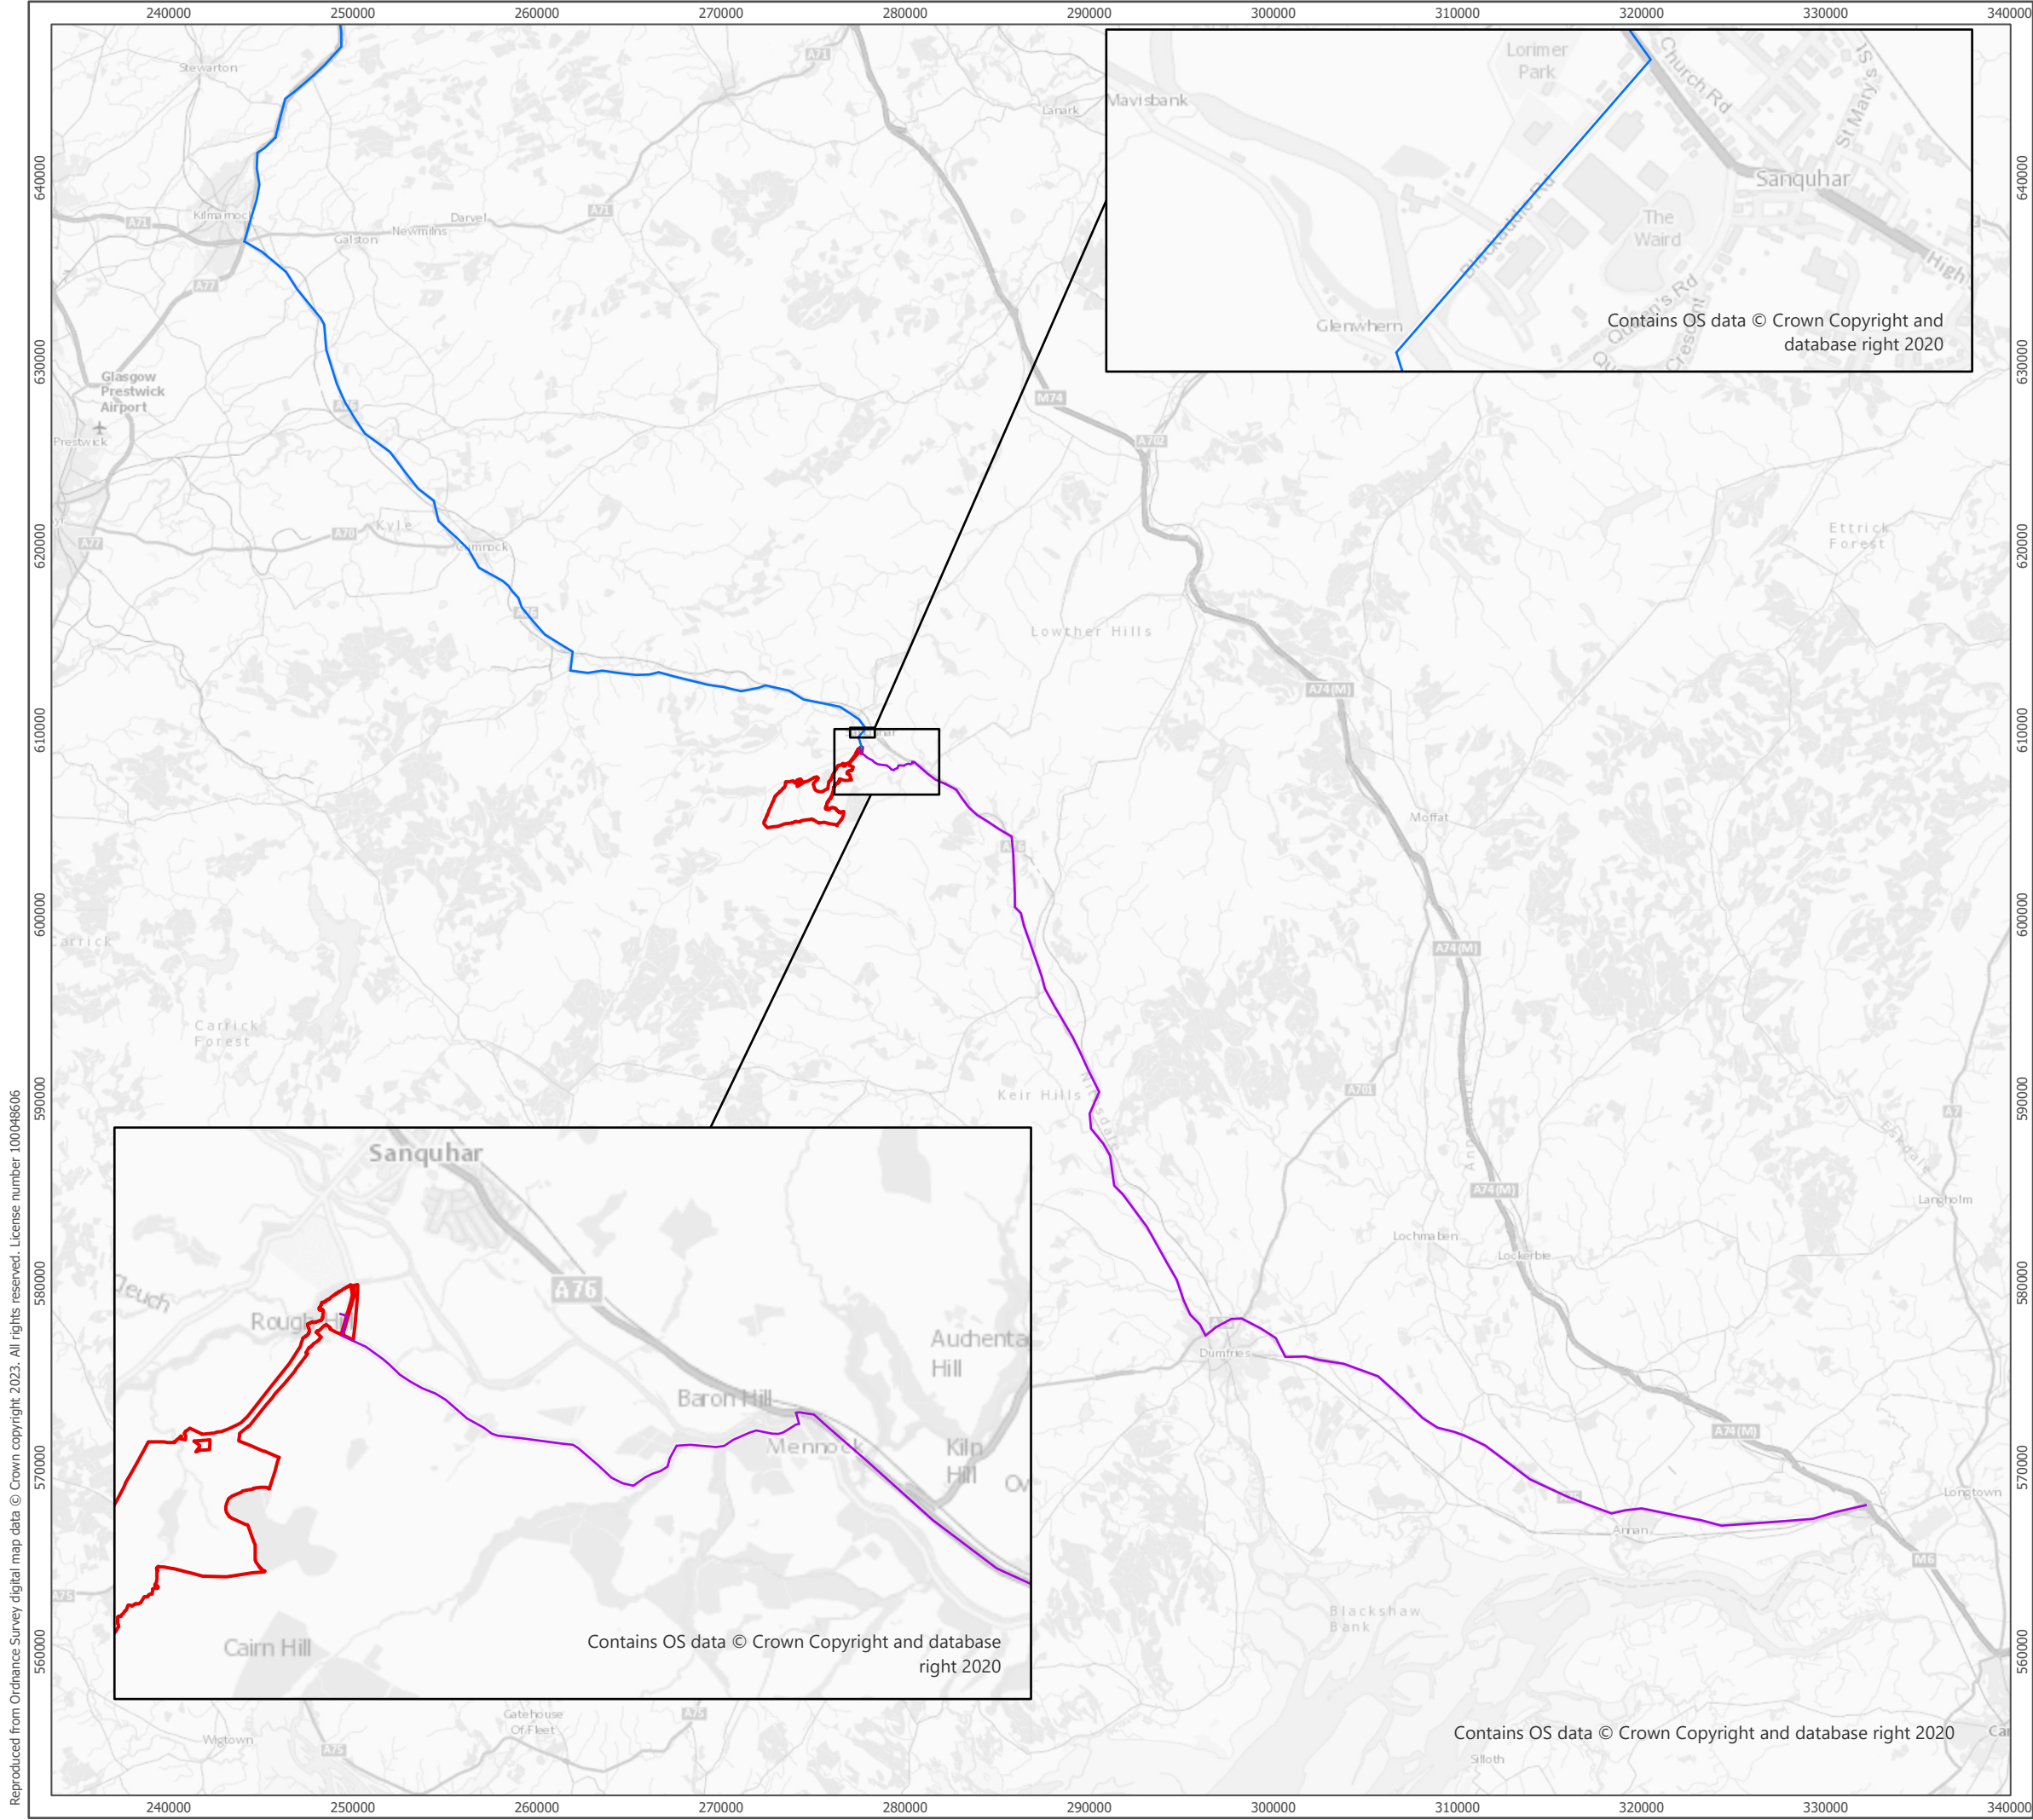

 Site Boundary

 Alternative Abnormal Load Route to Site (Northern Route)

 Preferred Abnormal Load Route to Site (Southern Route)

1:350,000 Scale @ A3

  
0 5 10 km

  
NORTH

|                 |                   |
|-----------------|-------------------|
| Produced By: CR | Ref: 4254-REP-089 |
| Checked By: FO  | Date: 01/06/2023  |

**Abnormal Load Route to Site**  
Figure 13.1

**Cloud Hill Wind Farm EIA**