




Reproduced from Ordnance Survey digital map data © Crown copyright 2023. All rights reserved. License number 100048606

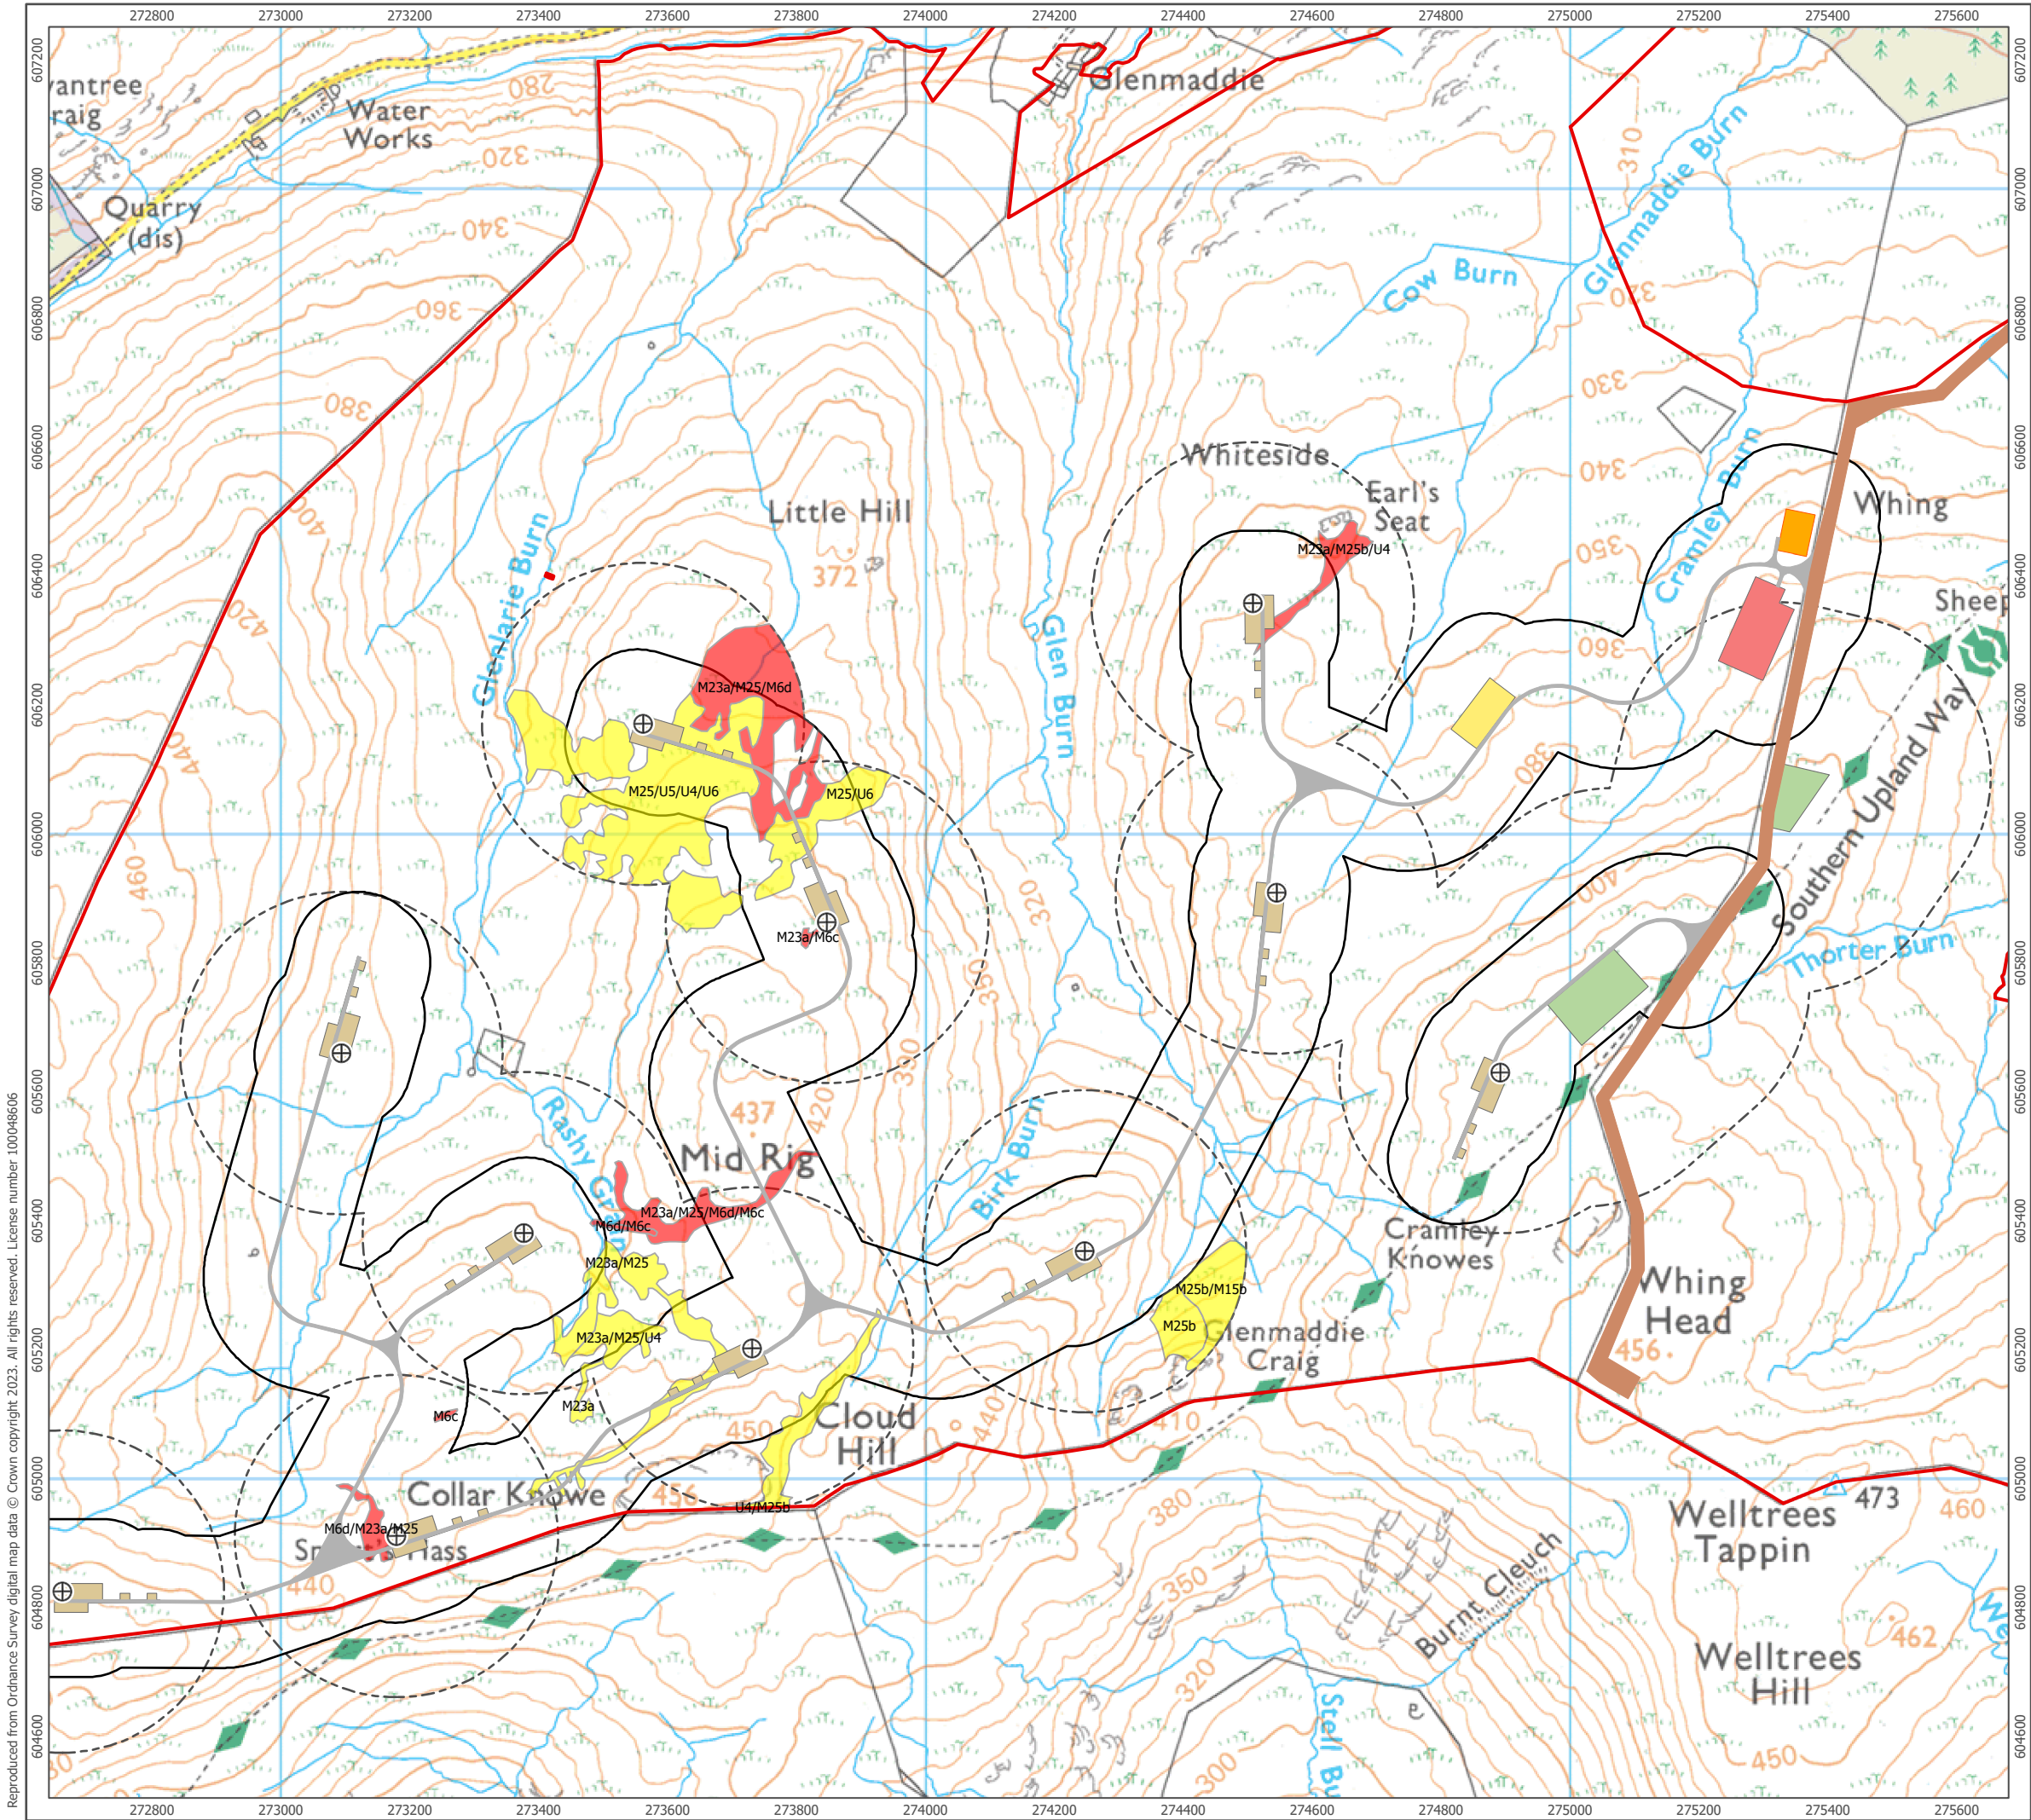

⊕ Proposed Turbine Location

Site Boundary

Existing Access Track

New Access Track

BESS

Borrow Pit

Construction Compound

Crane Hardstanding

Substation

250 m Buffer for Excavations > 1 m in Depth

100 m Buffer Area for Excavations < 1m in Depth

GWDTE Groundwater Dependency

High

Moderate

1:10,000 Scale @ A3

0 150 300 Meters

NORTH

Produced By: CG	Ref: 4254-REP-088
Checked By: AC	Date: 4/12/2023

Groundwater Dependent Terrestrial Ecosystems

Figure 11.5

Cloud Hill Wind Farm

EIA Report