


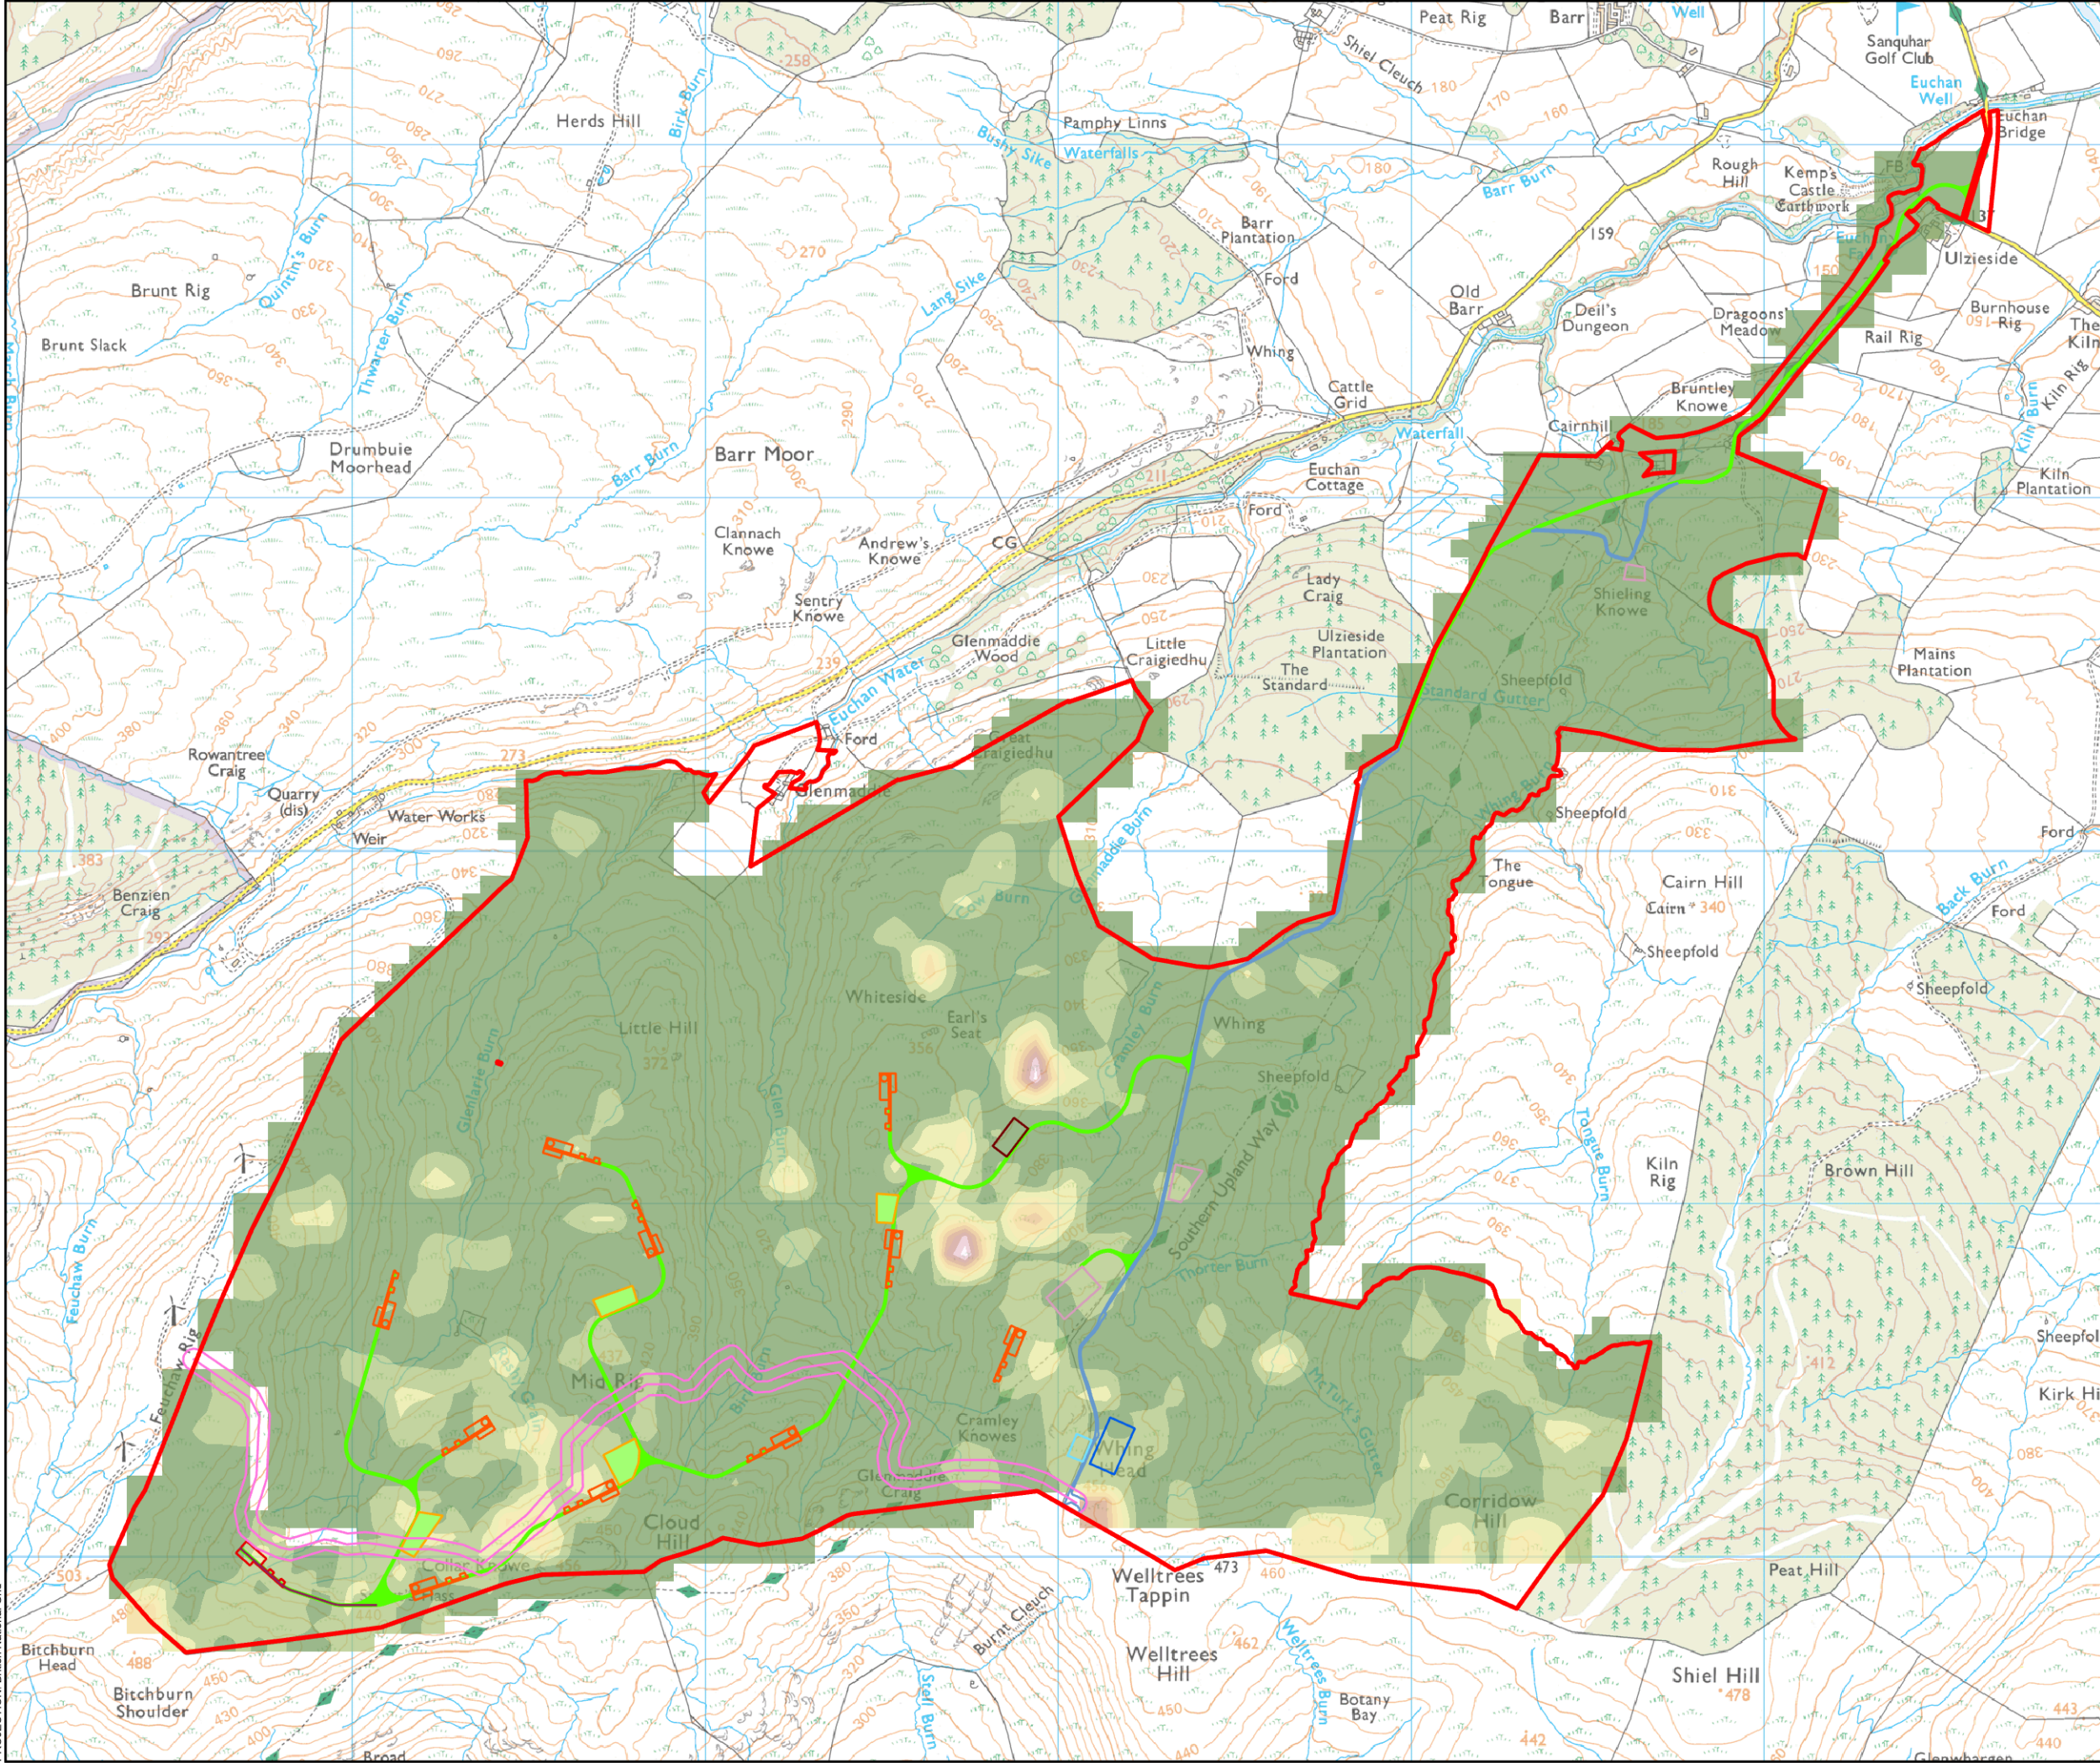

- Site Boundary
- Access Track
- Existing Access
- Cable Location In (with 30m buffer)
- BESS Platform
- T1 Revised Access Track
- T1 Revised Hardstanding
- Substation Platform
- Construction Compound
- Burrow Pits
- Hardstanding Locations
- Temporary Peat Storage Areas

Interpolated Peat Depth (m)

- 0.01 - 0.50
- 0.51 - 1.00
- 1.01 - 1.50
- 1.51 - 2.00
- 2.01 - 2.50
- 2.51 - 3.00
- 3.01 - 3.50
- 3.51 - 4.00
- 4.01 - 4.50
- >4.51

0 100 200 300 400 500
Metres



SCALE: See Scale Bar
SIZE: A3
PROJECT:
DATE: 26/09/2024

VERSION: A02
DRAWN: MTC
CHECKED: SMcK
APPROVED: KR

Figure 10.1.4
Interpolated Peat Depths
Cloud Hill Windfarm
Peat Slide Risk Assessment

