


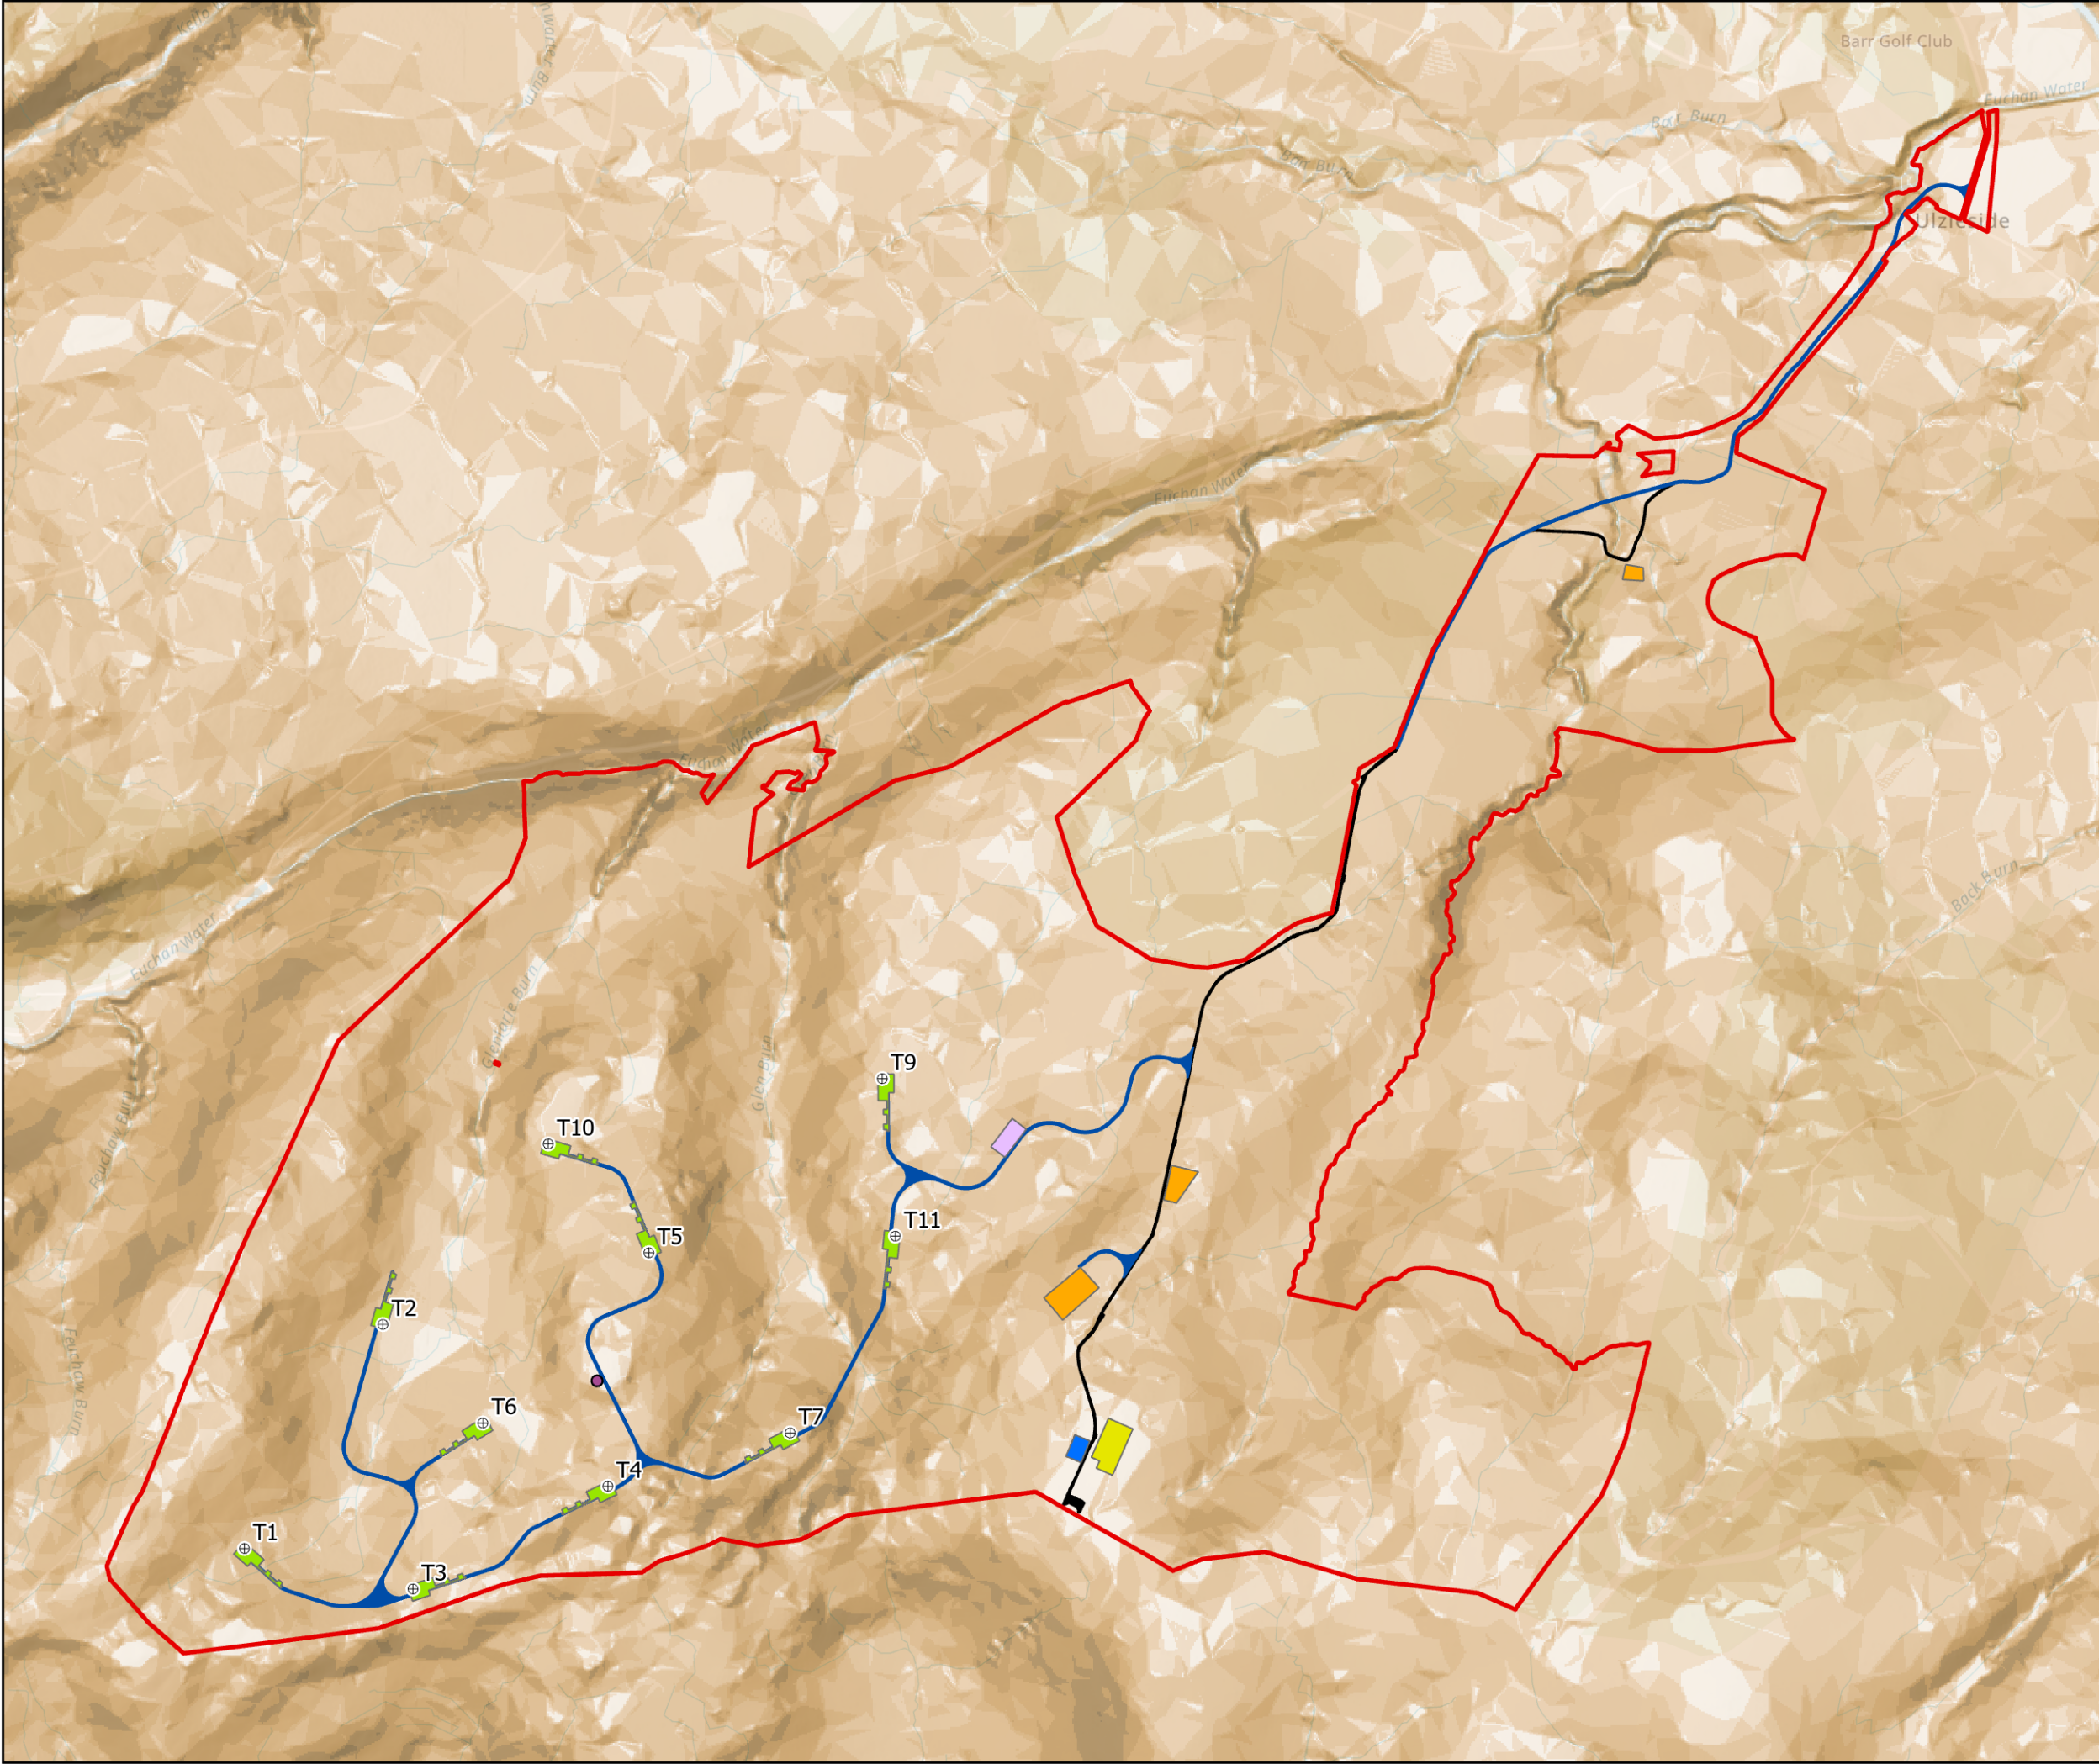

Site Boundary

⊕

Turbine Location

●

Met Mast

Site Infrastructure

BESS

Borrow Pit

Temporary Construction Compound

Crane Hardstanding

Substation

Proposed Access Track

Existing Access Track

Slope (Degrees)

≤1.72≤3.43≤5.71≤8.53≤11.3≤14.04≤16.7≤21.8≤30.96≤45≤90

0100200300400500

Metres

N

SCALE: See Scale Bar

VERSION: A02

SIZE: A3

DRAWN: MTC

PROJECT: 0740609

CHECKED: SMcK

DATE: 26/09/2024

APPROVED: LH

Figure 10.1.5
Slope
Cloud Hill Windfarm
Peat Slide Risk Assessment

ERM

BayWa r.e.