


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCl mg/Nm3 at Emission Point A1 For the month of June 2026

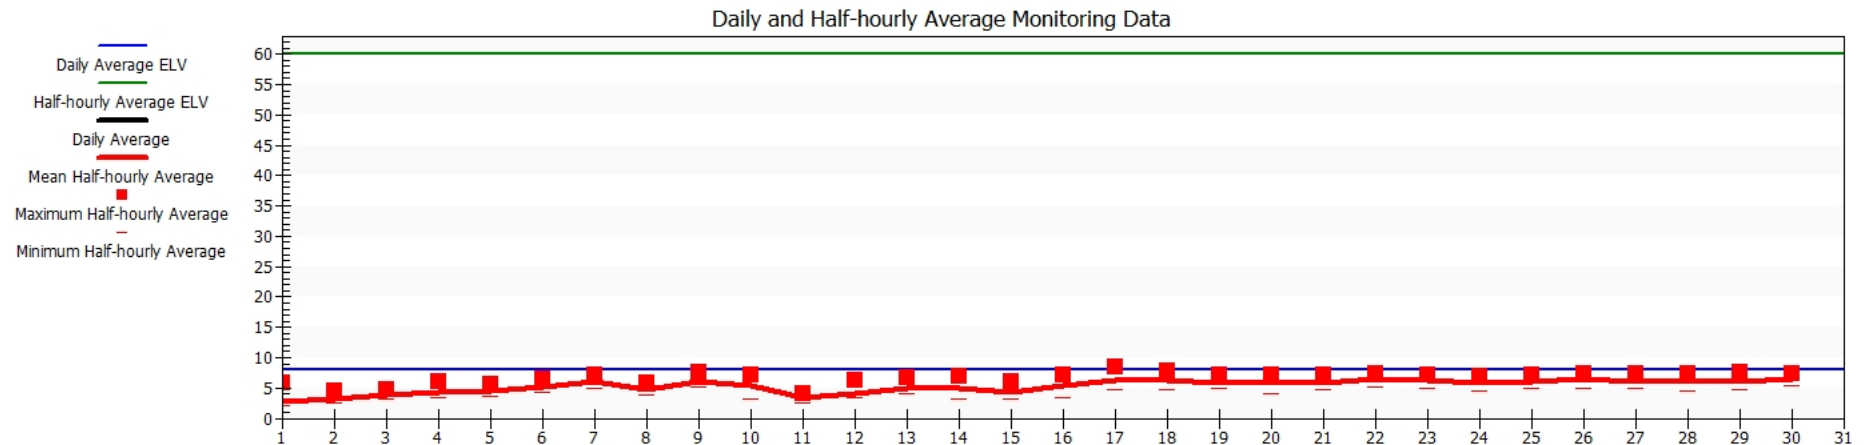

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	
	Monthly maximum	8.4	Maximum Half-hourly average	5.9	4.4	4.7	5.9	5.5	6.6	7.2	5.7	7.6	7.2	4.1	6.3	6.7	6.9	6.1	7.1	8.4	7.9	7.2	7.2	7.2	7.3	7.1	7.0	7.2	7.4	7.3	7.4	7.5	7.3	
	Monthly mean	5.3	Mean Half-hourly average	2.8	3.3	3.8	4.2	4.5	5.3	6.1	4.8	6.1	5.3	3.4	4.1	4.9	4.9	4.3	5.5	6.2	6.2	5.8	5.9	5.8	6.5	6.2	5.7	6.1	6.5	6.0	6.2	6.0	6.4	
	Monthly minimum	2.1	Minimum Half-hourly average	2.1	2.4	3.3	3.5	3.6	4.3	4.9	3.8	5.1	3.2	2.6	3.3	4.0	3.1	3.2	3.4	4.6	4.7	5.0	4.0	4.7	5.3	5.0	4.5	4.9	4.9	4.9	4.5	4.7	5.5	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	
	Monthly maximum	6.5	Daily average	2.8	3.3	3.8	4.2	4.5	5.3	6.1	4.8	6.1	5.3	3.4	4.1	4.9	4.9	4.3	5.5	6.2	6.2	5.8	5.9	5.8	6.5	6.2	5.7	6.1	6.5	6.0	6.2	6.0	6.4	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO2 mg/Nm3 at Emission Point A1 For the month of June 2026

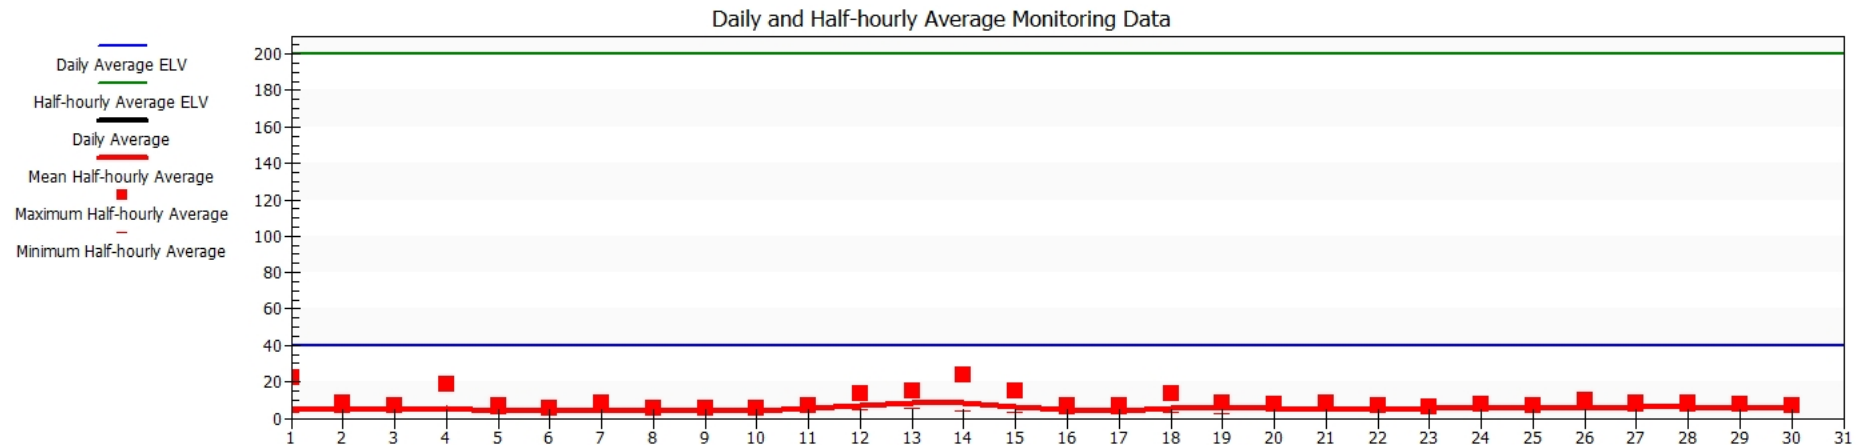

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	
	Monthly maximum	24	Maximum Half-hourly average	22	8	7	19	7	5	9	5	5	6	7	14	15	24	15	7	7	13	9	8	8	7	6	8	7	10	8	8	8	7	
	Monthly mean	5	Mean Half-hourly average	6	5	5	6	4	4	5	4	4	4	5	7	8	8	6	4	4	5	5	5	5	5	5	5	6	6	6	6	6	6	
	Monthly minimum	2	Minimum Half-hourly average	3	3	4	4	3	3	4	3	3	4	4	4	5	4	4	2	2	3	3	4	4	4	4	4	5	4	4	4	5	5	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	
	Monthly maximum	8	Daily average	6	5	5	6	4	4	5	4	4	4	5	7	8	8	6	4	4	5	5	5	5	5	5	5	6	6	6	6	6	6	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for NOx mg/Nm3 at Emission Point A1 For the month of June 2026

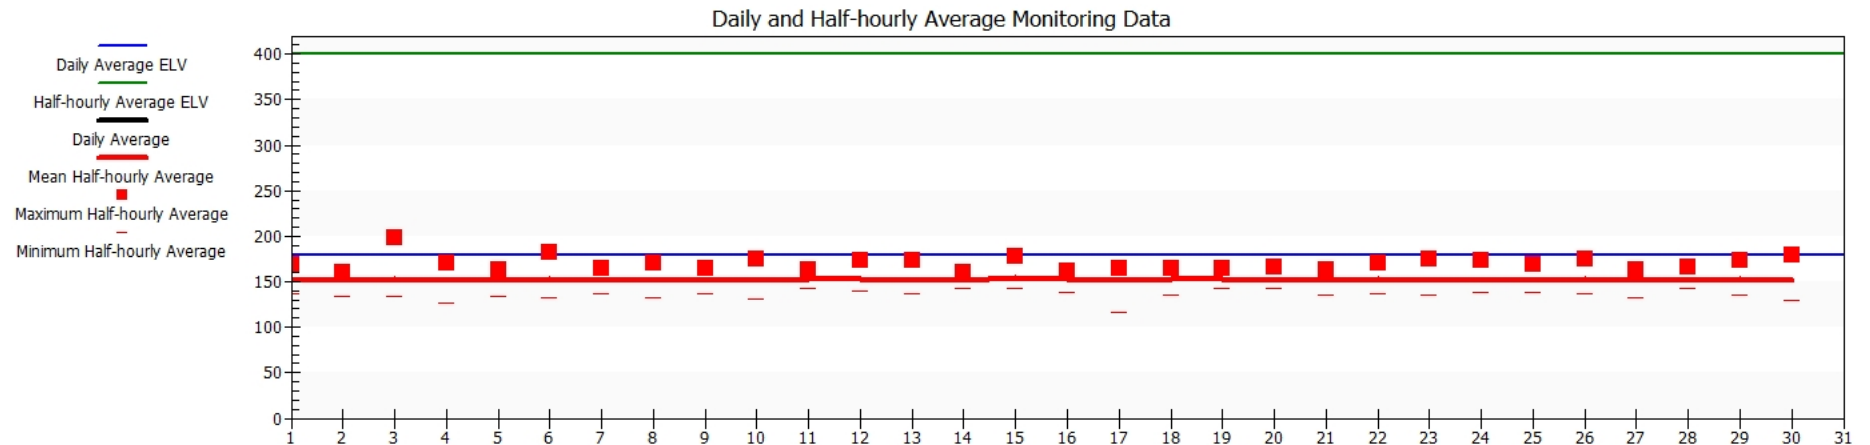

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	
	Monthly maximum	199	Maximum Half-hourly average	168	161	199	170	164	182	165	170	165	174	162	174	174	160	178	162	165	164	165	166	163	171	175	174	169	175	163	165	174	179	
	Monthly mean	152	Mean Half-hourly average	153	152	153	151	151	152	151	152	152	152	152	153	151	152	154	152	152	153	153	152	152	152	152	152	152	153	151	152	153	152	
	Monthly minimum	116	Minimum Half-hourly average	137	134	135	126	134	132	137	133	136	130	142	140	136	142	142	138	116	136	143	142	135	137	135	138	139	137	132	143	135	130	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	
	Monthly maximum	154	Daily average	153	152	153	151	151	152	151	152	152	152	152	153	151	152	154	152	152	153	153	152	152	152	152	152	152	153	151	152	153	152	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC mg/Nm3 at Emission Point A1 For the month of June 2026

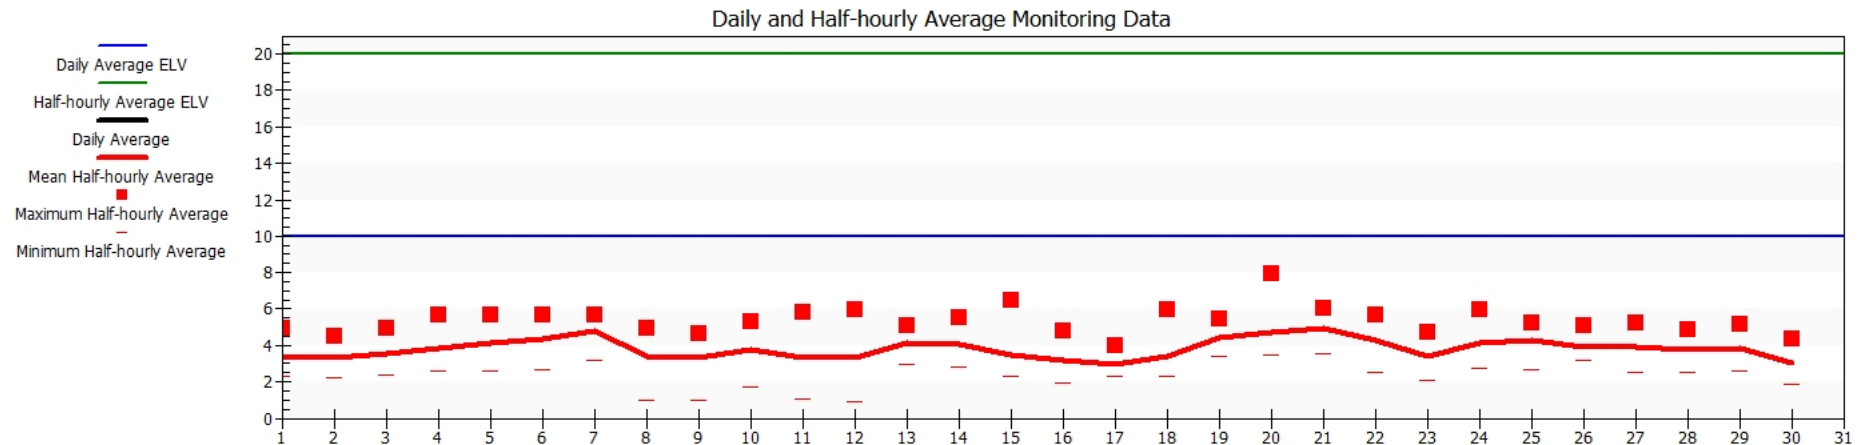

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	
	Monthly maximum	8.0	Maximum Half-hourly average	4.9	4.5	4.9	5.7	5.7	5.7	5.7	4.9	4.6	5.3	5.8	5.9	5.1	5.5	6.5	4.8	4.0	6.0	5.5	8.0	6.0	5.7	4.7	5.9	5.2	5.1	5.3	4.9	5.2	4.3	
	Monthly mean	3.8	Mean Half-hourly average	3.4	3.3	3.6	3.9	4.1	4.3	4.8	3.4	3.3	3.8	3.4	3.4	4.1	4.0	3.5	3.2	3.0	3.4	4.4	4.7	4.9	4.3	3.4	4.2	4.3	3.9	3.9	3.8	3.9	3.0	
	Monthly minimum	0.9	Minimum Half-hourly average	2.3	2.2	2.4	2.6	2.6	2.7	3.2	1.0	1.0	1.7	1.0	0.9	3.0	2.8	2.3	1.9	2.3	2.3	3.4	3.5	3.6	2.5	2.1	2.8	2.7	3.2	2.5	2.5	2.6	1.8	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	4.9	Daily average	3.4	3.3	3.6	3.9	4.1	4.3	4.8	3.4	3.3	3.8	3.4	3.4	4.1	4.0	3.5	3.2	3.0	3.4	4.4	4.7	4.9	4.3	3.4	4.2	4.3	3.9	3.9	3.8	3.9	3.0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH3 mg/Nm3 at Emission Point A1 For the month of June 2026

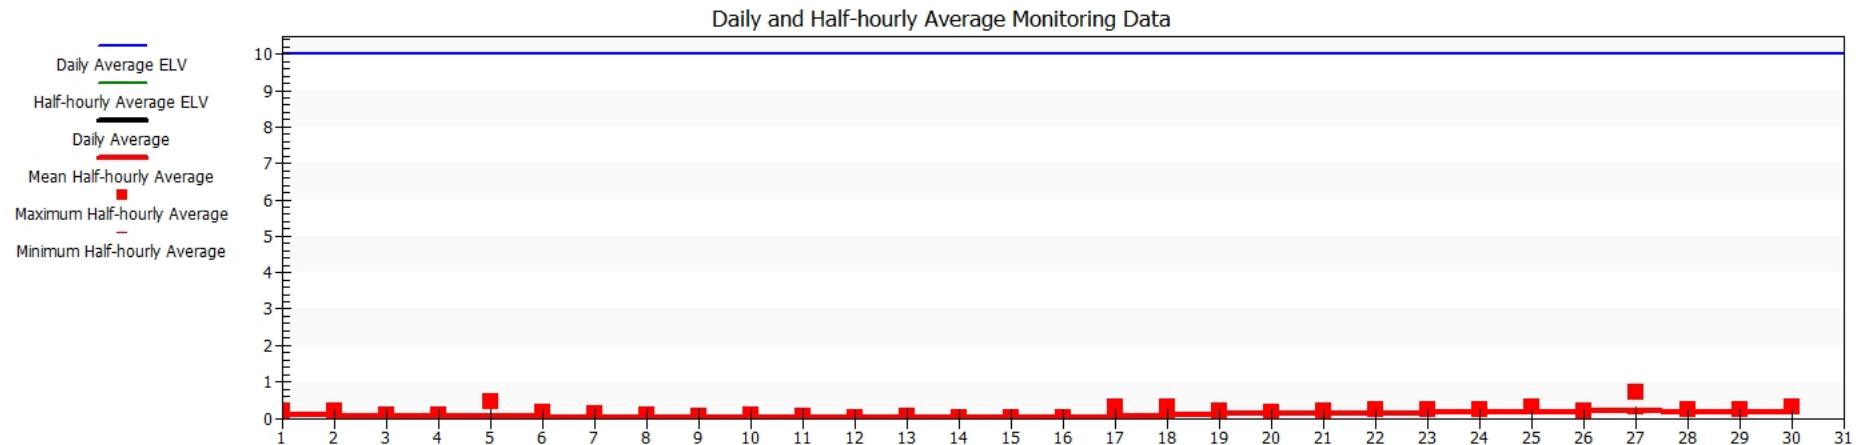

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	0.7	Maximum Half-hourly average	0.2	0.2	0.1	0.1	0.4	0.2	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.3	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.2	0.7	0.2	0.2	0.3		
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.2	0.2	0.2	0.2	0.2		
	Monthly minimum	0.0	Minimum Half-hourly average	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0		
	Monthly maximum	0.2	Daily average	0.1	0.1	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.2	0.2	0.2	0.2	0.2	0.2		
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 1 (A1)

Reporting of Continuously Monitored Emissions to Air for Particulates mg/Nm3 at Emission Point A1 For the month of June 2026

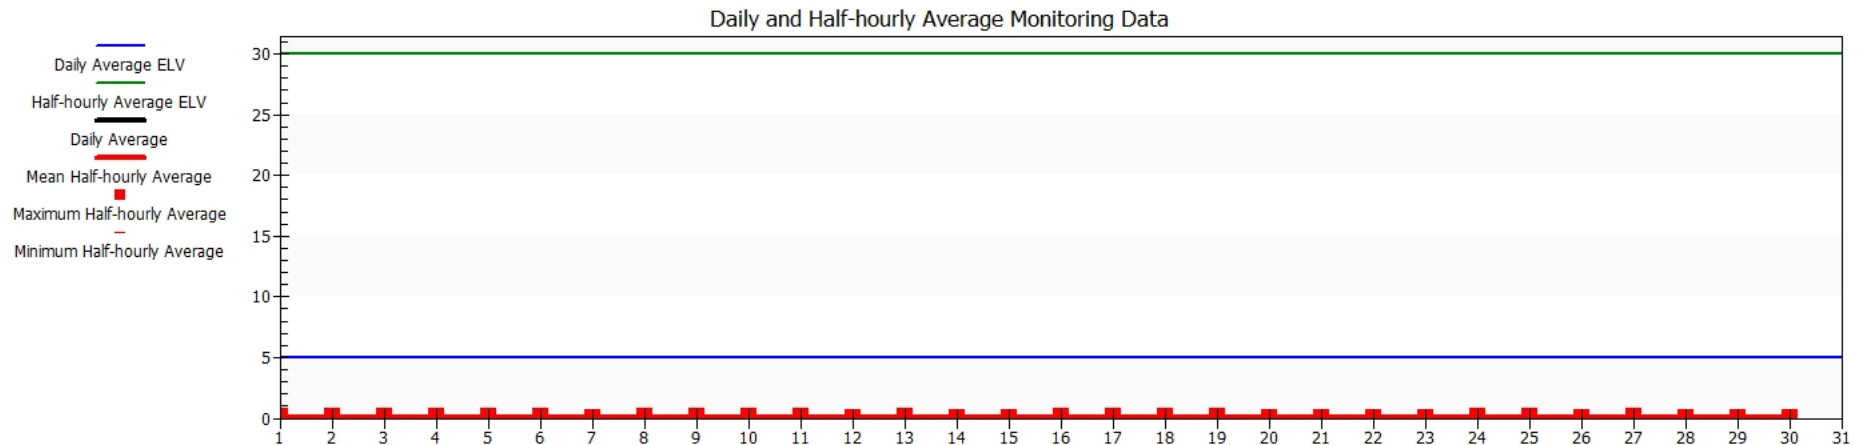

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	
	Monthly maximum	0.2	Maximum Half-hourly average	0.1	0.2	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.1	
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	Monthly minimum	0.1	Minimum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average			Daily average ELV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	Monthly maximum	0.1	Daily average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O mg/Nm3 at Emission Point A1 For the month of June 2026

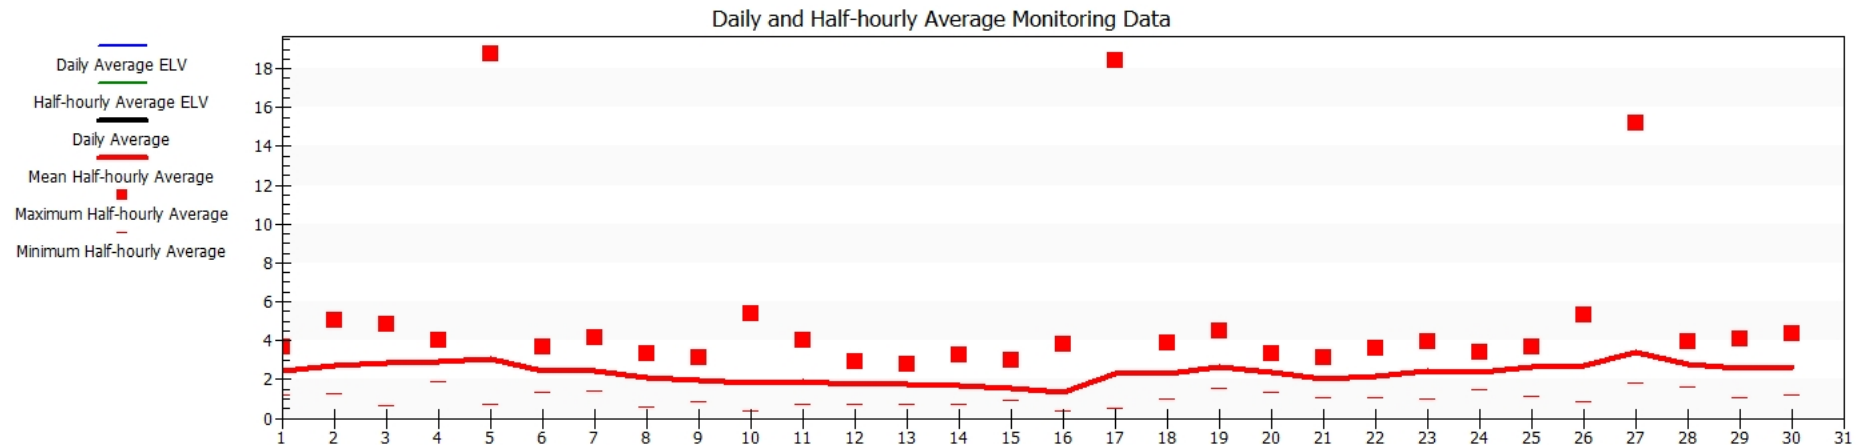

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	18.8	Maximum Half-hourly average	3.7	5.1	4.8	4.0	18.8	3.6	4.2	3.3	3.1	5.4	4.0	2.9	2.8	3.2	3.0	3.8	18.4	3.9	4.5	3.3	3.1	3.6	4.0	3.4	3.7	5.3	15.2	4.0	4.1	4.4		
	Monthly mean	2.3	Mean Half-hourly average	2.4	2.7	2.8	2.9	3.1	2.4	2.4	2.1	1.9	1.8	1.9	1.8	1.7	1.7	1.5	1.4	2.3	2.3	2.6	2.4	2.0	2.2	2.4	2.4	2.6	2.7	3.4	2.8	2.6	2.6		
	Monthly minimum	0.4	Minimum Half-hourly average	1.2	1.2	0.6	1.9	0.7	1.3	1.4	0.6	0.8	0.4	0.7	0.7	0.7	0.7	0.9	0.4	0.5	1.0	1.6	1.4	1.0	1.1	1.0	1.5	1.1	0.8	1.8	1.6	1.1	1.2		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	3.4	Daily average	2.4	2.7	2.8	2.9	3.1	2.4	2.4	2.1	1.9	1.8	1.9	1.8	1.7	1.7	1.5	1.4	2.3	2.3	2.6	2.4	2.0	2.2	2.4	2.4	2.6	2.7	3.4	2.8	2.6	2.6		
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A1 For the month of June 2026

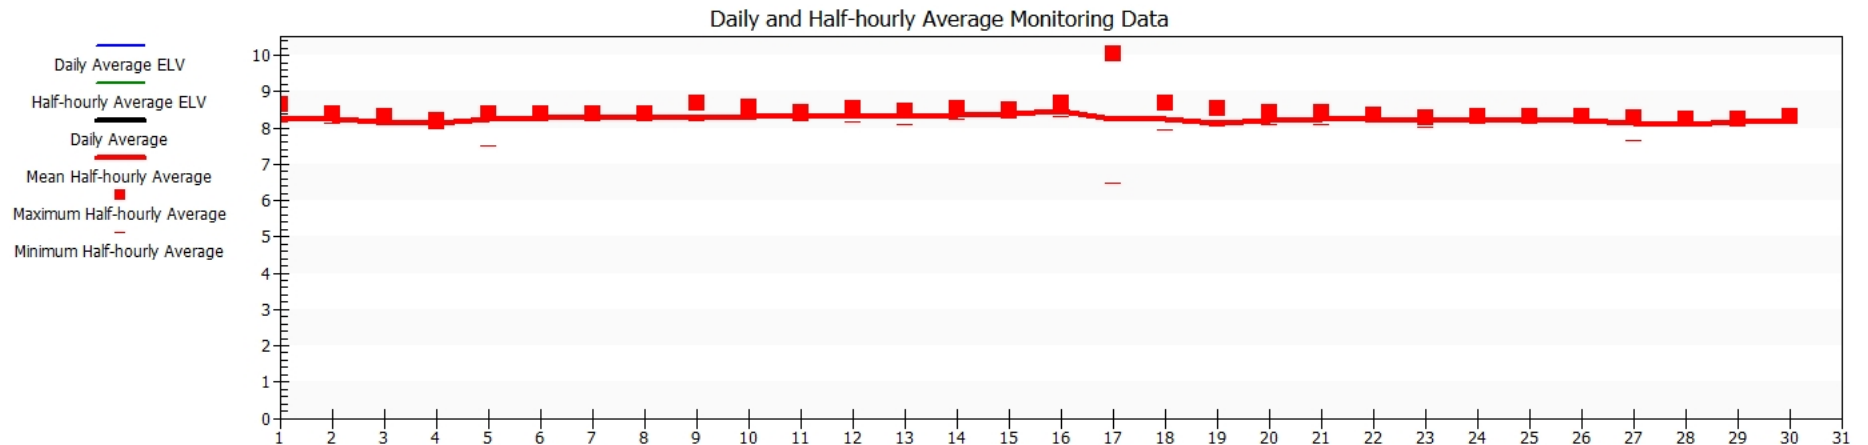

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	10.0	Maximum Half-hourly average	8.6	8.4	8.3	8.2	8.4	8.4	8.4	8.4	8.7	8.6	8.4	8.6	8.5	8.5	8.5	8.7	10.0	8.7	8.5	8.4	8.4	8.3	8.3	8.3	8.3	8.3	8.3	8.2	8.2	8.3		
	Monthly mean	8.2	Mean Half-hourly average	8.3	8.2	8.2	8.1	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4	8.5	8.3	8.3	8.1	8.2	8.3	8.3	8.2	8.2	8.2	8.2	8.1	8.1	8.2	8.2		
	Monthly minimum	6.5	Minimum Half-hourly average	8.2	8.1	8.1	8.0	7.5	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.3	8.3	8.3	6.5	7.9	8.0	8.1	8.1	8.2	8.0	8.1	8.1	8.1	7.6	8.1	8.1	8.1		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	8.5	Daily average	8.3	8.2	8.2	8.1	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4	8.5	8.3	8.3	8.1	8.2	8.3	8.3	8.2	8.2	8.2	8.2	8.1	8.1	8.2	8.2		
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for Dry Oxygen % at Emission Point A1 For the month of June 2026

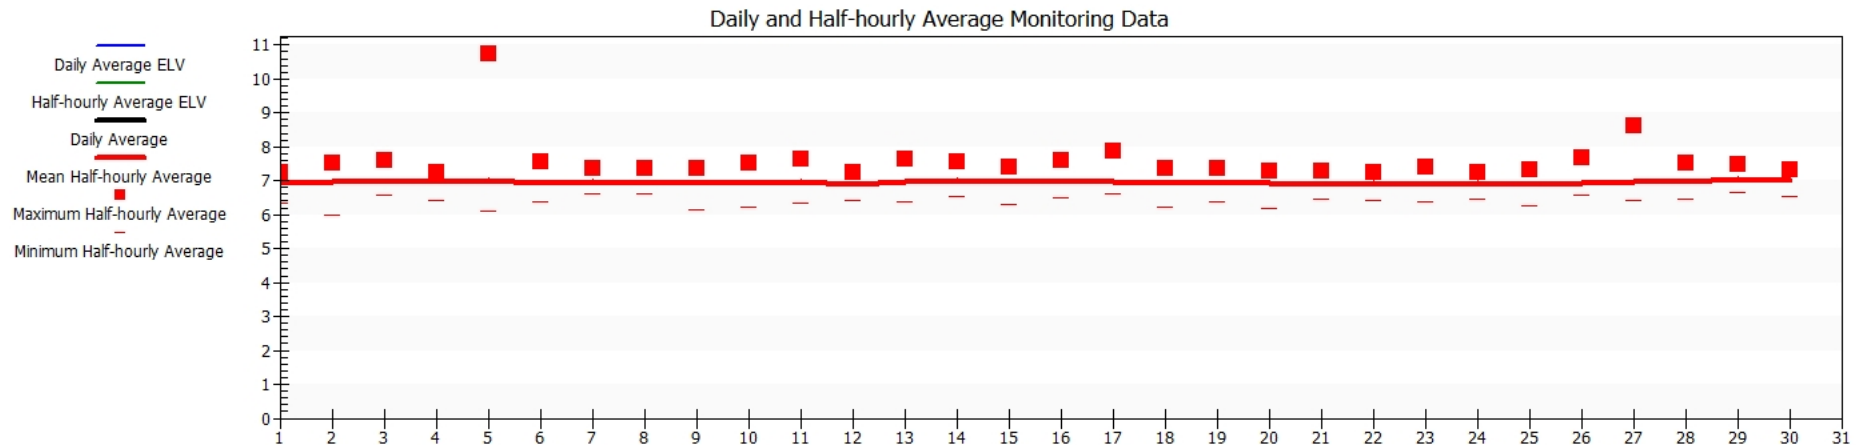

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	10.7	Maximum Half-hourly average	7.2	7.5	7.6	7.3	10.7	7.6	7.3	7.4	7.4	7.5	7.6	7.3	7.6	7.6	7.4	7.6	7.9	7.4	7.4	7.3	7.3	7.2	7.4	7.2	7.3	7.7	8.6	7.5	7.5	7.3		
	Monthly mean	7.0	Mean Half-hourly average	6.9	7.0	7.0	7.0	7.0	6.9	7.0	6.9	6.9	6.9	7.0	6.9	7.0	7.0	7.0	7.0	7.0	6.9	6.9	6.9	6.9	6.9	6.9	6.9	6.9	6.9	7.0	7.0	7.0	7.0		
	Monthly minimum	6.0	Minimum Half-hourly average	6.4	6.0	6.6	6.4	6.1	6.4	6.6	6.6	6.2	6.2	6.3	6.4	6.4	6.6	6.3	6.5	6.6	6.2	6.4	6.2	6.5	6.4	6.4	6.5	6.2	6.6	6.4	6.5	6.7	6.5		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	7.0	Daily average	6.9	7.0	7.0	7.0	7.0	6.9	7.0	6.9	6.9	6.9	7.0	6.9	7.0	7.0	7.0	7.0	7.0	6.9	6.9	6.9	6.9	6.9	6.9	6.9	6.9	7.0	7.0	7.0	7.0			
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N		

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for Moisture % at Emission Point A1 For the month of June 2026

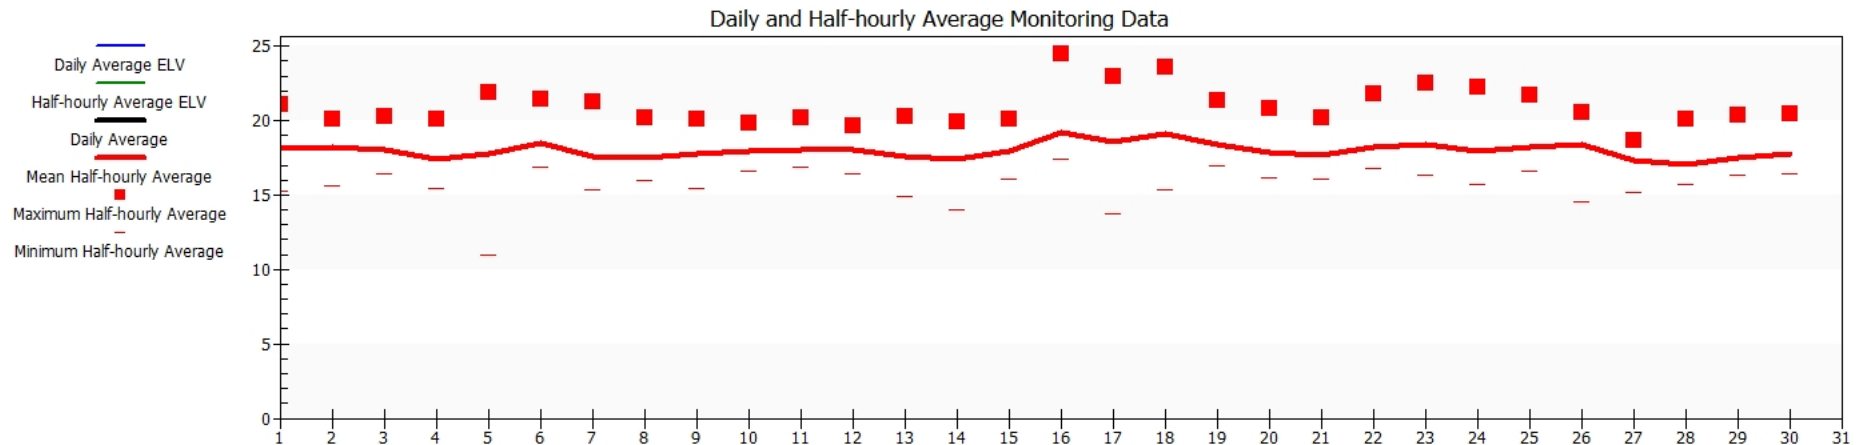

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	24.5	Maximum Half-hourly average	21.1	20.1	20.3	20.1	21.9	21.5	21.3	20.2	20.1	19.8	20.2	19.7	20.3	20.0	20.1	24.5	23.0	23.6	21.4	20.9	20.2	21.8	22.5	22.2	21.7	20.6	18.7	20.1	20.4	20.5		
	Monthly mean	18.0	Mean Half-hourly average	18.1	18.2	18.0	17.5	17.8	18.5	17.6	17.5	17.8	18.0	18.1	18.0	17.6	17.4	17.9	19.2	18.6	19.1	18.4	17.9	17.7	18.2	18.4	17.9	18.2	18.4	17.4	17.1	17.5	17.8		
	Monthly minimum	11.0	Minimum Half-hourly average	15.2	15.6	16.4	15.4	11.0	16.8	15.4	15.9	15.5	16.6	16.8	16.4	14.9	14.0	16.0	17.4	13.7	15.3	17.0	16.1	16.1	16.7	16.3	15.7	16.6	14.5	15.2	15.7	16.3	16.4		
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	19.2	Daily average	18.1	18.2	18.0	17.5	17.8	18.5	17.6	17.5	17.8	18.0	18.1	18.0	17.6	17.4	17.9	19.2	18.6	19.1	18.4	17.9	17.7	18.2	18.4	17.9	18.2	18.4	17.4	17.1	17.5	17.8		
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....


(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 4 (A1)

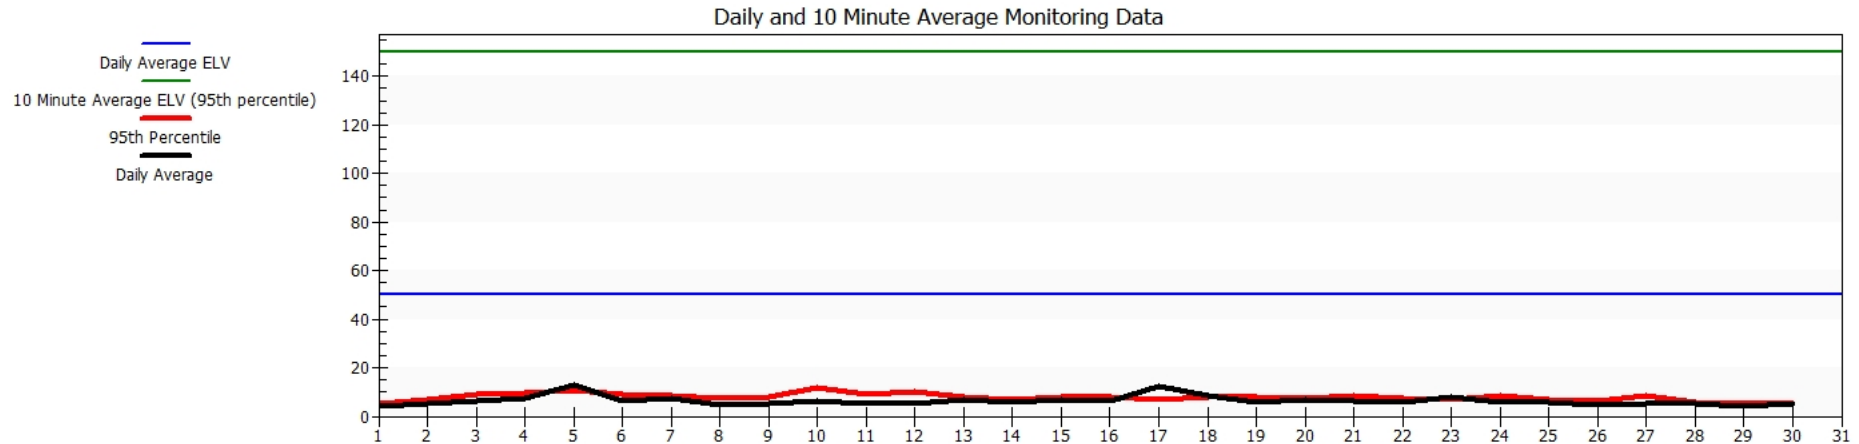Reporting of Continuously Monitored Emissions to Air for CO mg/Nm3 at Emission Point A1 For the month of June 2026

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
10 Minute average			10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
	Monthly Maximum 10-min	441	Maximum 10 Minute average	49	101	52	211	397	24	203	67	44	47	14	23	173	115	230	89	441	372	34	209	141	128	394	87	18	11	57	223	29	282	
	Monthly mean 10-min avgs	6	95th Percentile	5	7	9	10	11	9	8	7	8	12	9	10	8	7	8	8	7	8	8	8	8	7	7	9	7	7	8	6	5	5	
	Monthly Minimum 10-min	0	Minimum 10 Minute average	2	1	3	2	3	3	3	1	1	2	1	0	2	2	2	3	3	2	3	3	3	2	2	2	2	2	1	2	2	1	
	Total Invalid results	3	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	1	0	0	0	0	0	0	0	0	0	0	0	0	0	
			Number of results above 150mg/m³	0	0	0	1	2	0	1	0	0	0	0	0	1	0	1	0	3	1	0	1	0	0	1	0	0	0	0	1	0	1	
	Sum of Exceedances of 95th percentile ELV	0	95th Percentile ELV Exceeded (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
	Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
Monthly maximum		13	Daily average	4	5	6	8	13	6	7	5	5	7	5	5	7	6	7	6	12	9	6	7	7	6	8	6	6	5	5	5	4	5	
No of invalid days		0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		
Sum of exceedances		0	Value Exceeds ELV? (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Environment Agency explanatory note: The 10-minute average ELV is based on the "95th percentile" In this case this means that 95% of the 10 minute averages in the calendar day (= 137) must be below 150 mg/m3, and 5% (= 7) are allowed to be any value above 150 mg/m3. Whilst we expect operators to minimise CO emissions at all times, it is perfectly acceptable for the value of the maximum 10-minute average to be above 150 mg/m3, provided the 95th percentile ELV has been met for that period