





Reporting of Continuously Monitored Emissions to Air for NO_x, Emission Point Report for Jul, 2025

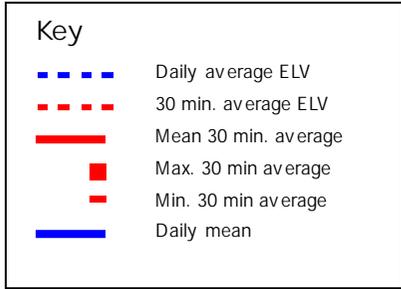

97th Percentile = 130.6
 No. of valid averages = 1270

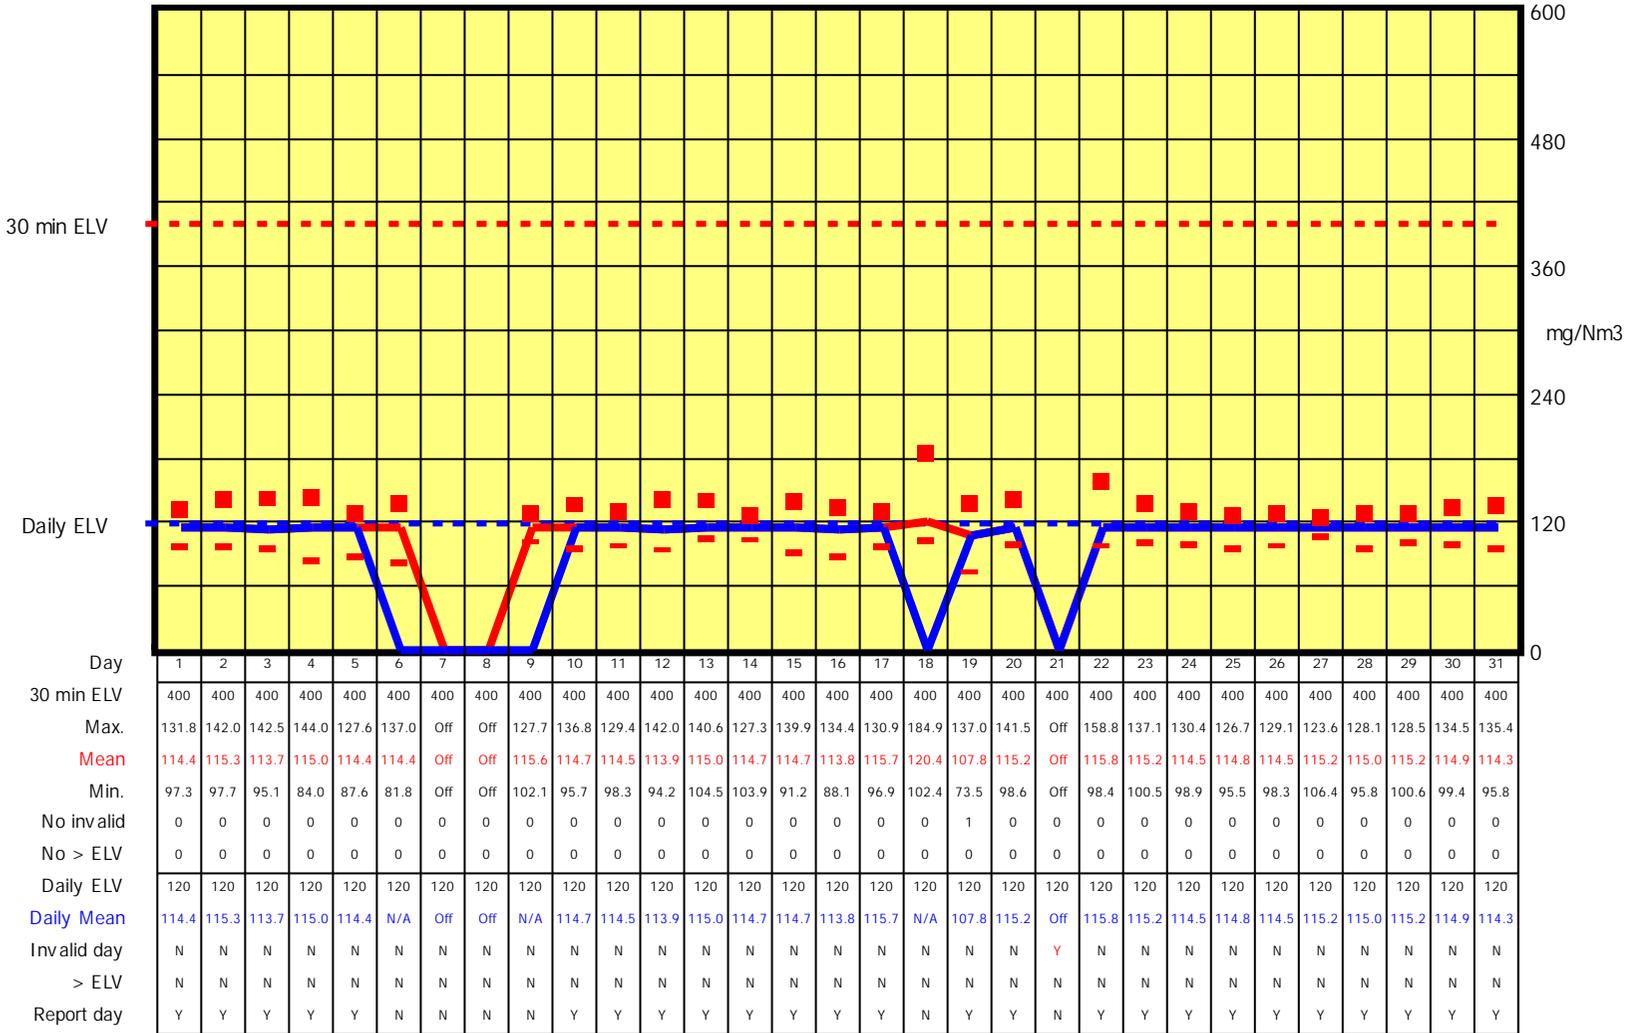

Month summary	
30 min ELV	
Monthly max.	184.9
Monthly mean	114.6
Monthly min.	73.5
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	115.8
No. invalid days	1
No. > ELV	0
No. report days	25

Data is as processed without repairs.

Signature Redacted

authorised to sign on behalf of the company

Date 14.10.2025



Permit No: PPC/A/1181922

Facility: Westfield Energy

Operator: Westfield Energy Recovery Ltd

Form No: Air 4 (A1)

Reporting of Continuously Monitored Emissions to Air for CO, Emission Point Report for Jul, 2025

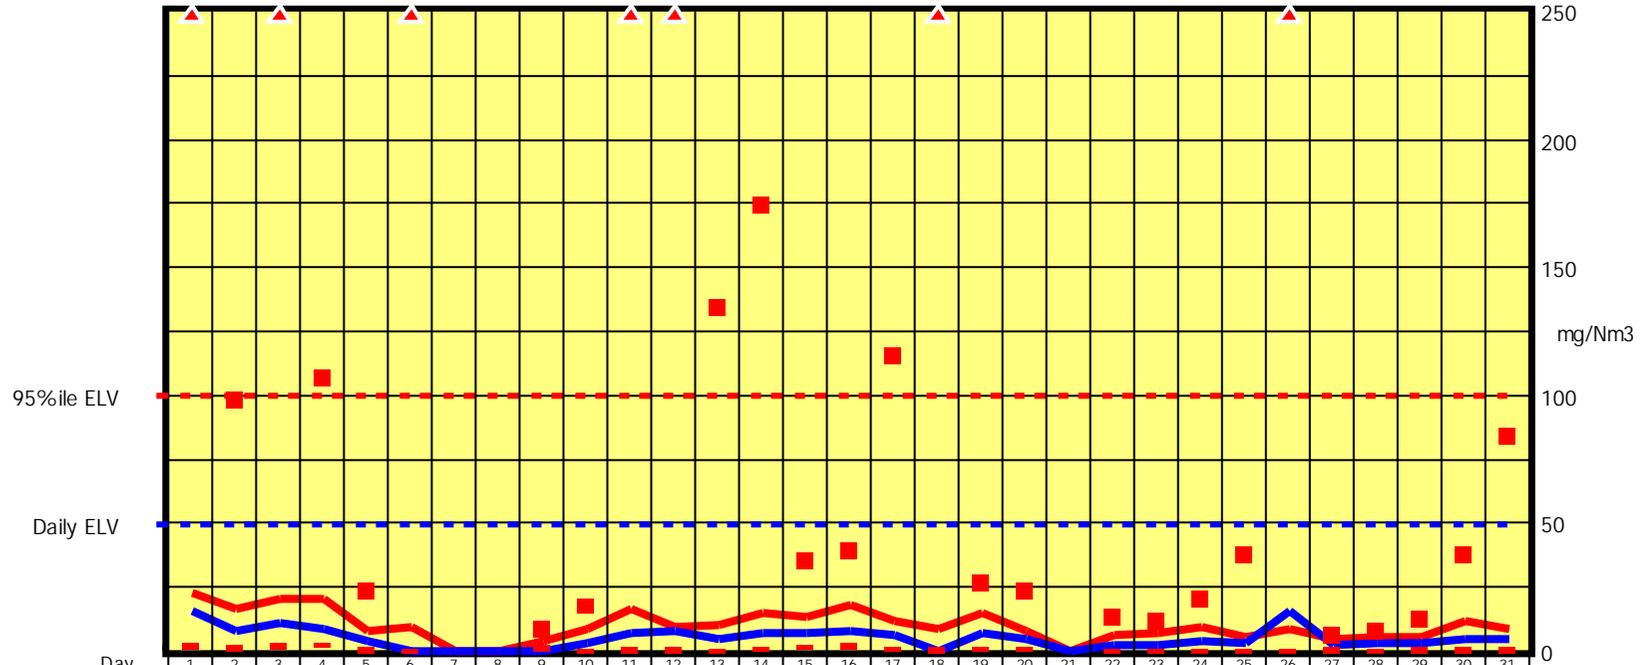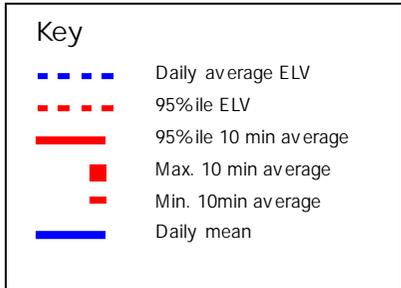

Month summary	
10 minute data	
Monthly max.	1640.3
Monthly mean	6.9
Monthly min.	0.0
Total invalid	3
Sum > ELV	18
Total %ile exceed.	0
Daily ELV	
Monthly max	15.9
No. invalid days	1
No. > ELV	0
No. report days	25

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
95%ile 10 min ELV	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	100	
Max.	718.7	98.5	408.0	106.9	23.6	1640.3	Off	Off	8.8	17.7	295.9	448.7	134.4	174.3	35.1	39.1	115.6	468.9	26.9	23.9	Off	13.6	12.0	20.2	38.0	966.9	6.5	7.8	12.3	37.9	84.5	
10 min 95%ile	22.5	16.7	20.6	20.7	7.6	9.6	Off	Off	4.2	8.5	16.8	9.7	10.0	15.2	13.3	18.0	11.5	8.5	14.6	8.2	Off	6.4	6.9	9.2	5.2	8.5	4.7	5.4	5.5	11.9	9.0	
Min.	2.0	1.4	1.9	2.3	0.5	0.1	Off	Off	1.3	0.0	0.4	0.5	0.1	0.8	1.4	2.0	0.9	0.2	0.8	0.8	Off	0.0	0.1	0.0	0.0	0.1	0.4	0.1	0.5	0.1	0.6	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	1	0	0	
No > ELV	3	0	1	1	0	3	0	0	0	0	2	1	1	1	0	0	1	1	0	0	0	0	0	0	0	3	0	0	0	0	0	
ELV exceeded?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Daily ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
Daily Mean	15.8	7.8	11.0	8.3	3.9	N/A	Off	Off	N/A	3.5	7.2	7.6	4.7	7.3	7.4	7.9	6.3	N/A	7.0	4.4	Off	2.6	2.6	3.7	2.9	15.9	2.7	2.8	3.0	4.5	5.1	
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	N	N	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature

Redacted
authorised to sign on behalf of the company

Date 14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO₂, Emission Point Report for Jul, 2025

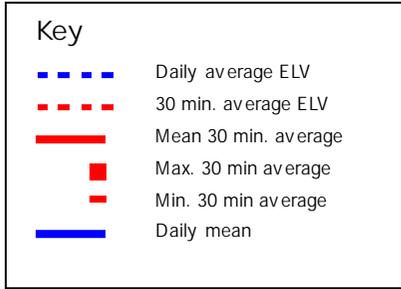

97th Percentile = 9.0
No. of valid averages = 1270

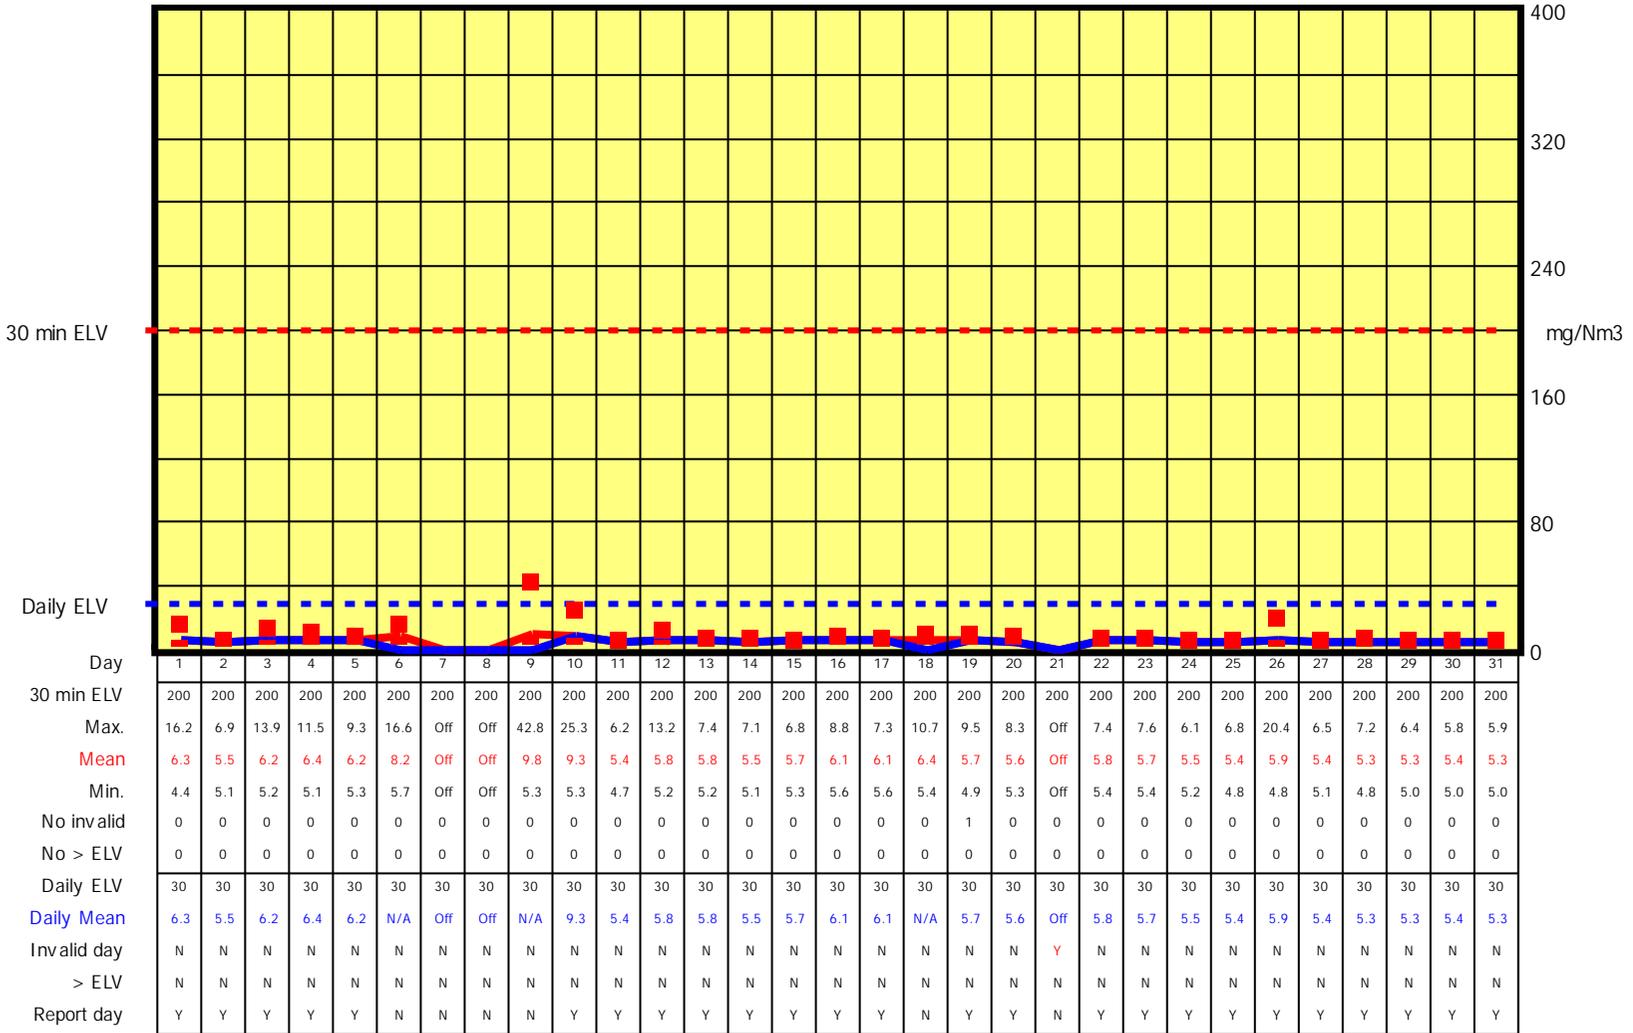

Month summary	
30 min ELV	
Monthly max.	42.8
Monthly mean	6.0
Monthly min.	4.4
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	9.3
No. invalid days	1
No. > ELV	0
No. report days	25

Data is as processed without repairs.


Signature

Redacted
authorised to sign on behalf of the company


Date 14.10.2025



Reporting of Continuously Monitored Emissions to Air for HCL, Emission Point Report for Jul, 2025

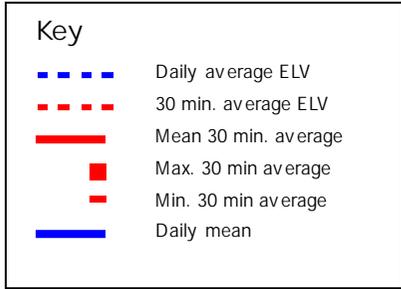

97th Percentile = 6.4
 No. of valid averages = 1270

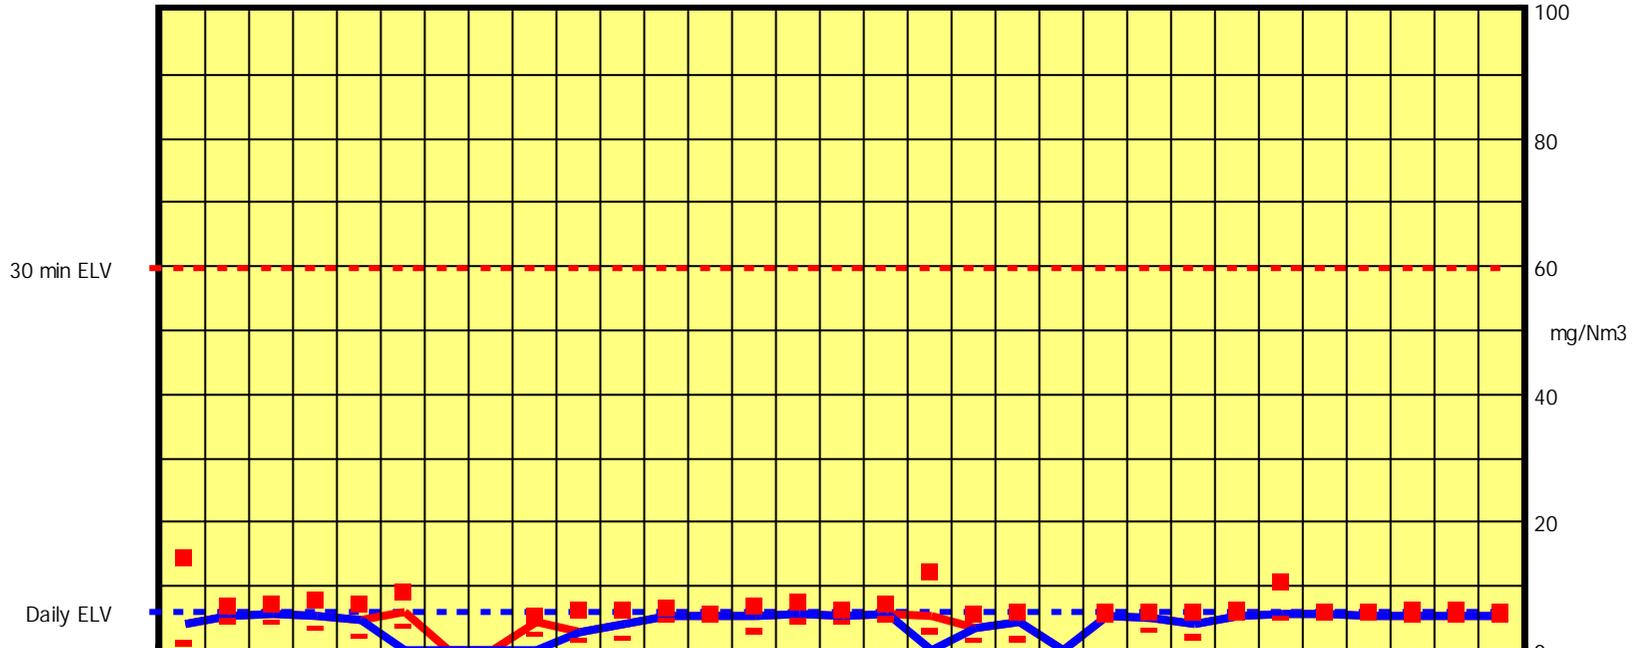

Month summary	
30 min ELV	
Monthly max.	14.4
Monthly mean	5.1
Monthly min.	1.1
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	5.7
No. invalid days	1
No. > ELV	0
No. report days	25

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
Max.	14.4	6.9	7.3	7.7	7.3	9.1	Off	Off	5.4	6.4	6.4	6.6	5.7	7.0	7.4	6.2	7.1	12.3	5.7	5.9	Off	6.0	5.8	6.0	6.3	10.6	5.8	6.0	6.3	6.3	6.0
Mean	4.0	5.5	5.5	5.4	4.7	5.9	Off	Off	4.3	2.9	4.2	5.3	5.4	5.2	5.5	5.4	5.5	5.2	3.6	4.4	Off	5.5	5.2	4.1	5.5	5.7	5.5	5.5	5.4	5.5	5.4
Min.	1.1	4.6	4.4	3.5	2.2	3.8	Off	Off	2.5	1.6	1.9	4.7	4.7	2.9	4.5	4.4	4.9	3.0	1.5	1.7	Off	4.9	3.2	2.1	5.1	5.1	5.2	5.2	4.9	4.8	4.9
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Daily ELV	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	
Daily Mean	4.0	5.5	5.5	5.4	4.7	N/A	Off	Off	N/A	2.9	4.2	5.3	5.4	5.2	5.5	5.4	5.5	N/A	3.6	4.4	Off	5.5	5.2	4.1	5.5	5.7	5.5	5.5	5.4	5.5	5.4
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	Y	N	N	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature

Redacted

authorised to sign on behalf of the company

Date

14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH₃, Emission Point Report for Jul, 2025

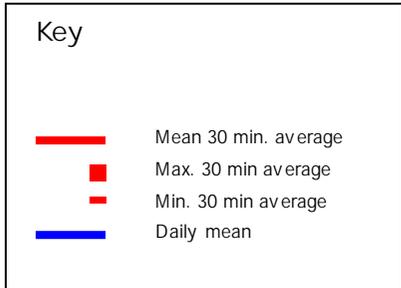

97th Percentile = 2.1
No. of valid averages = 1270

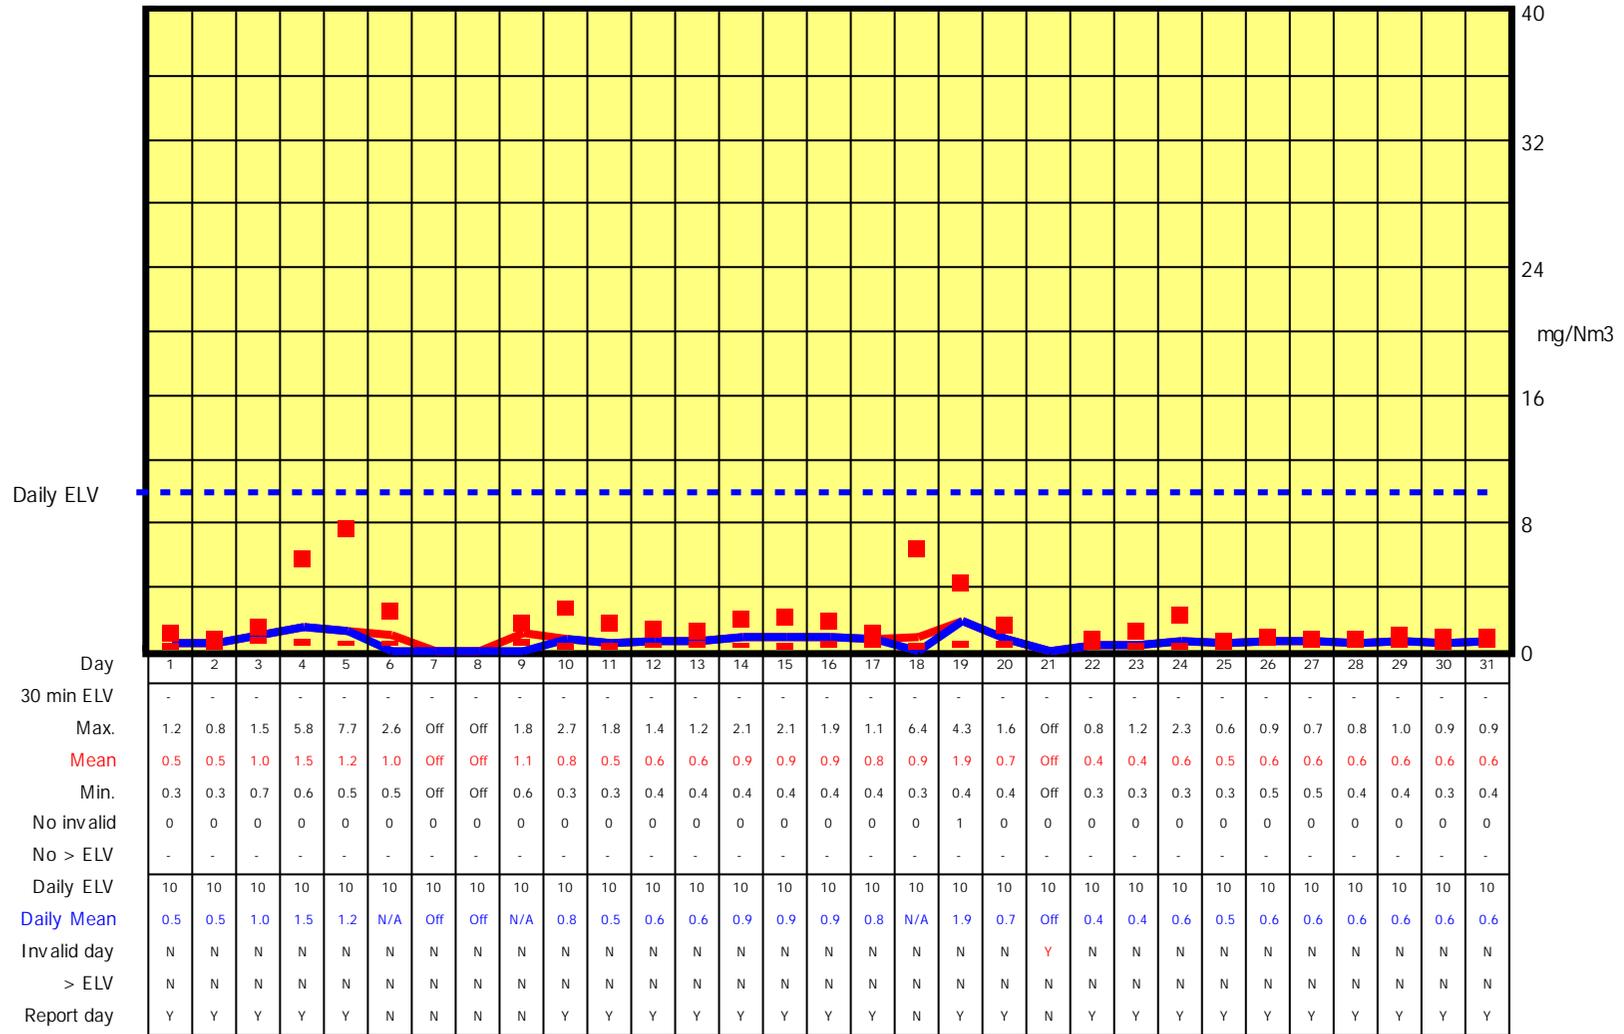

Month summary	
30 min ELV	
Monthly max.	7.7
Monthly mean	0.8
Monthly min.	0.3
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	1.9
No. invalid days	1
No. > ELV	0
No. report days	25

Data is as processed without repairs.

Signature

Redacted
authorised to sign on behalf of the company

Date 14.10.2025

Permit No: PPC/A/1181922


Facility: Westfield Energy

Operator: Westfield Energy Recovery Ltd


Form No: Air 2 (A1)



Reporting of Continuously Monitored Emissions to Air for TOC, Emission Point Report for Jul, 2025

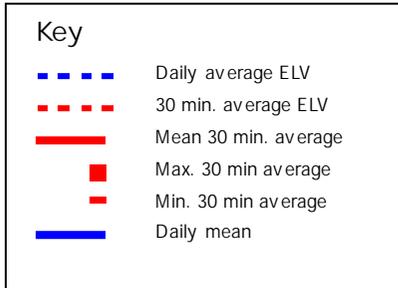

97th Percentile = 0.1
No. of valid averages = 1270

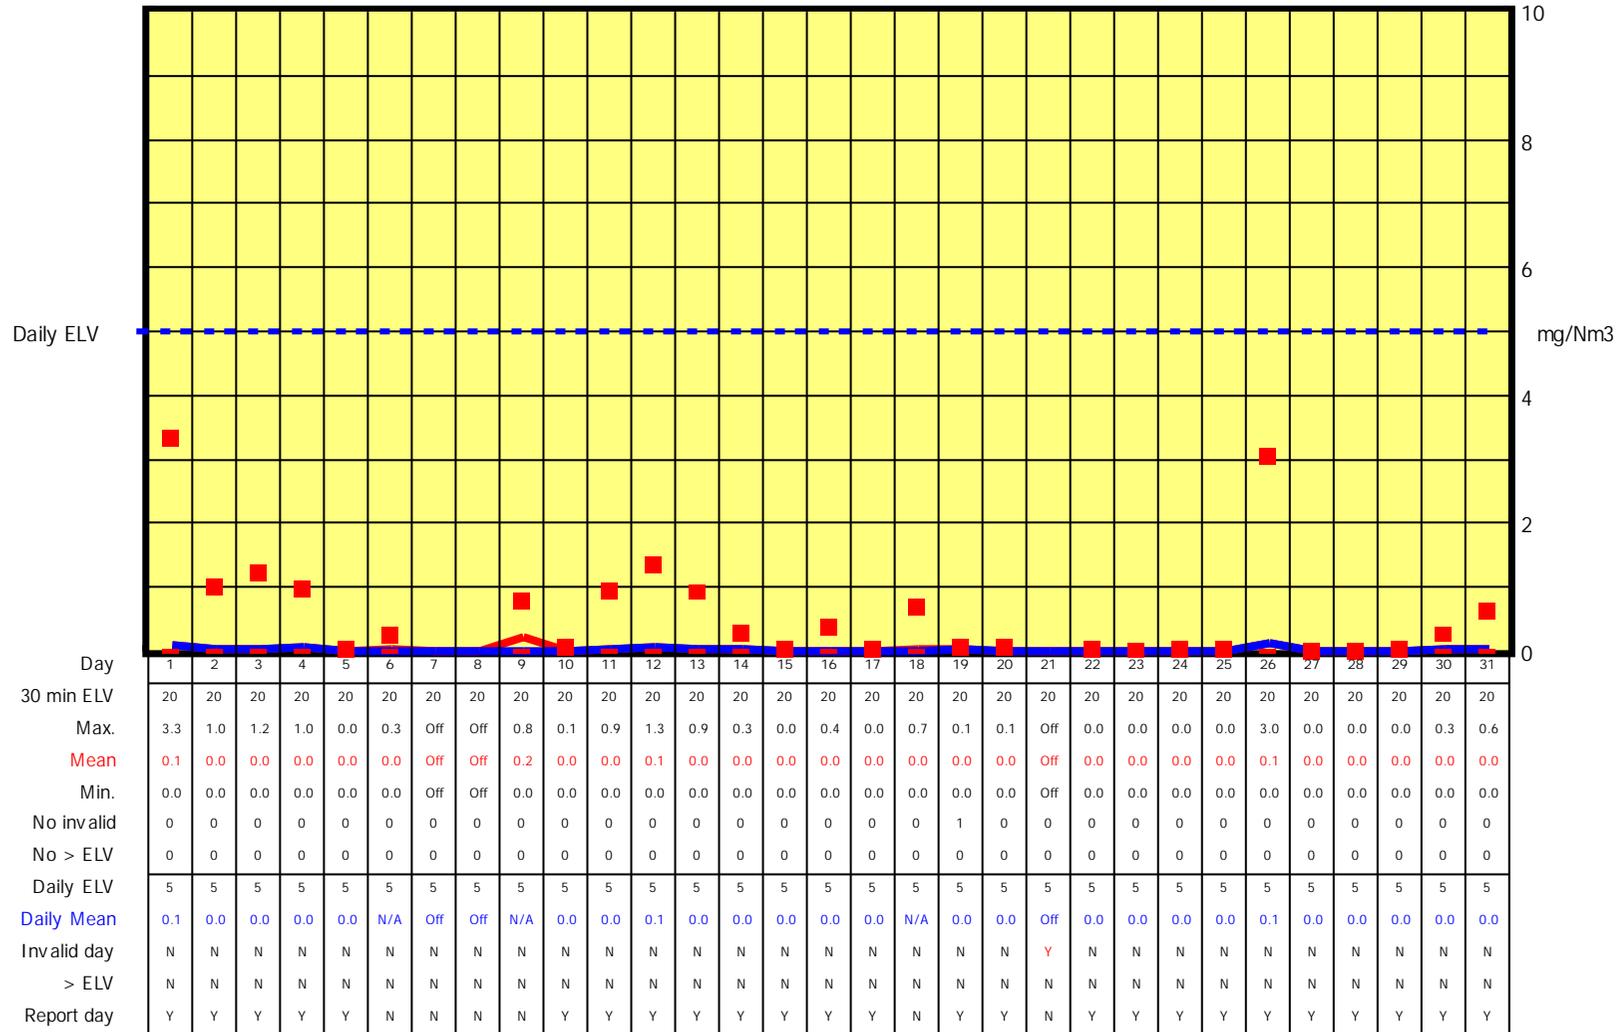

Month summary	
30 min ELV	
Monthly max.	3.3
Monthly mean	0.0
Monthly min.	0.0
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	0.1
No. invalid days	1
No. > ELV	0
No. report days	25

Data is as processed without repairs.

Signature

Redacted

authorised to sign on behalf of the company

Date

14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O, Emission Point Report for Jul, 2025

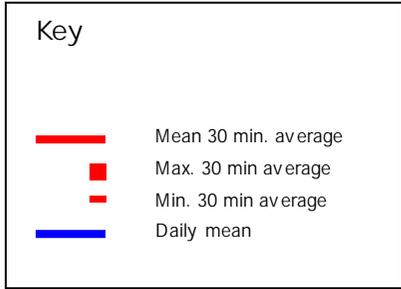

97th Percentile = 7.9
No. of valid averages = 1270

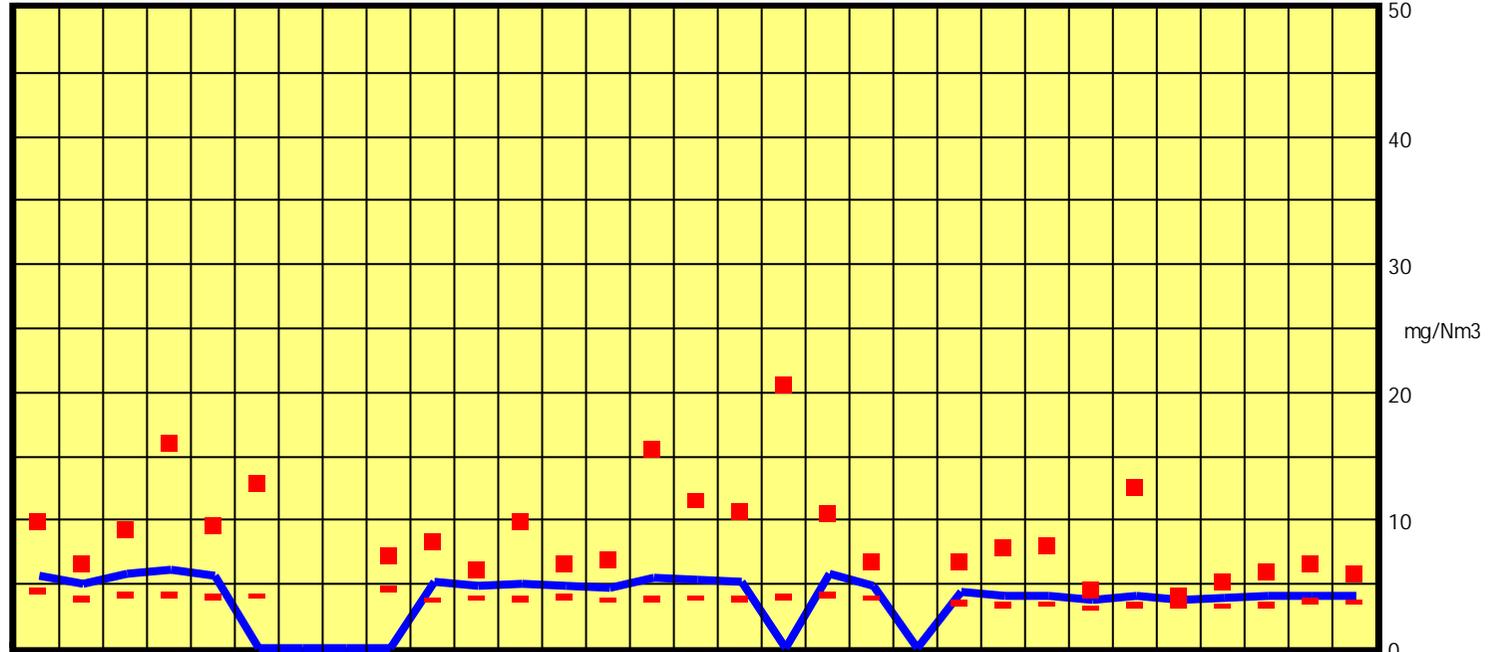

Month summary	
30 min ELV	
Monthly max.	20.6
Monthly mean	4.8
Monthly min.	3.1
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	6.1
No. invalid days	1
No. > ELV	0
No. report days	25

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	9.9	6.5	9.3	16.0	9.6	12.9	Off	Off	7.3	8.3	6.1	9.8	6.6	6.9	15.6	11.6	10.6	20.6	10.6	6.7	Off	6.8	7.8	8.0	4.5	12.6	4.1	5.2	6.0	6.6	5.8	
Mean	5.7	5.1	5.8	6.1	5.7	5.3	Off	Off	5.8	5.2	4.9	5.0	4.8	4.8	5.5	5.3	5.2	5.3	5.8	4.8	Off	4.4	4.1	4.0	3.7	4.1	3.7	4.0	4.1	4.1	4.1	
Min.	4.4	3.8	4.1	4.1	4.0	4.1	Off	Off	4.7	3.8	3.9	3.9	4.0	3.8	3.8	3.9	3.9	4.0	4.2	4.0	Off	3.5	3.4	3.4	3.1	3.4	3.4	3.3	3.4	3.6	3.6	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily Mean	5.7	5.1	5.8	6.1	5.7	N/A	Off	Off	N/A	5.2	4.9	5.0	4.8	4.8	5.5	5.3	5.2	N/A	5.8	4.8	Off	4.4	4.1	4.0	3.7	4.1	3.7	4.0	4.1	4.1		
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	N	N	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		

Data is as processed without repairs.

Signature

Redacted

authorised to sign on behalf of the company

Date

14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO₂, Emission Point Report for Jul, 2025

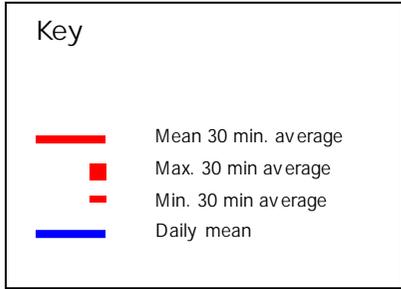

97th Percentile = 8.2
No. of valid averages = 1270

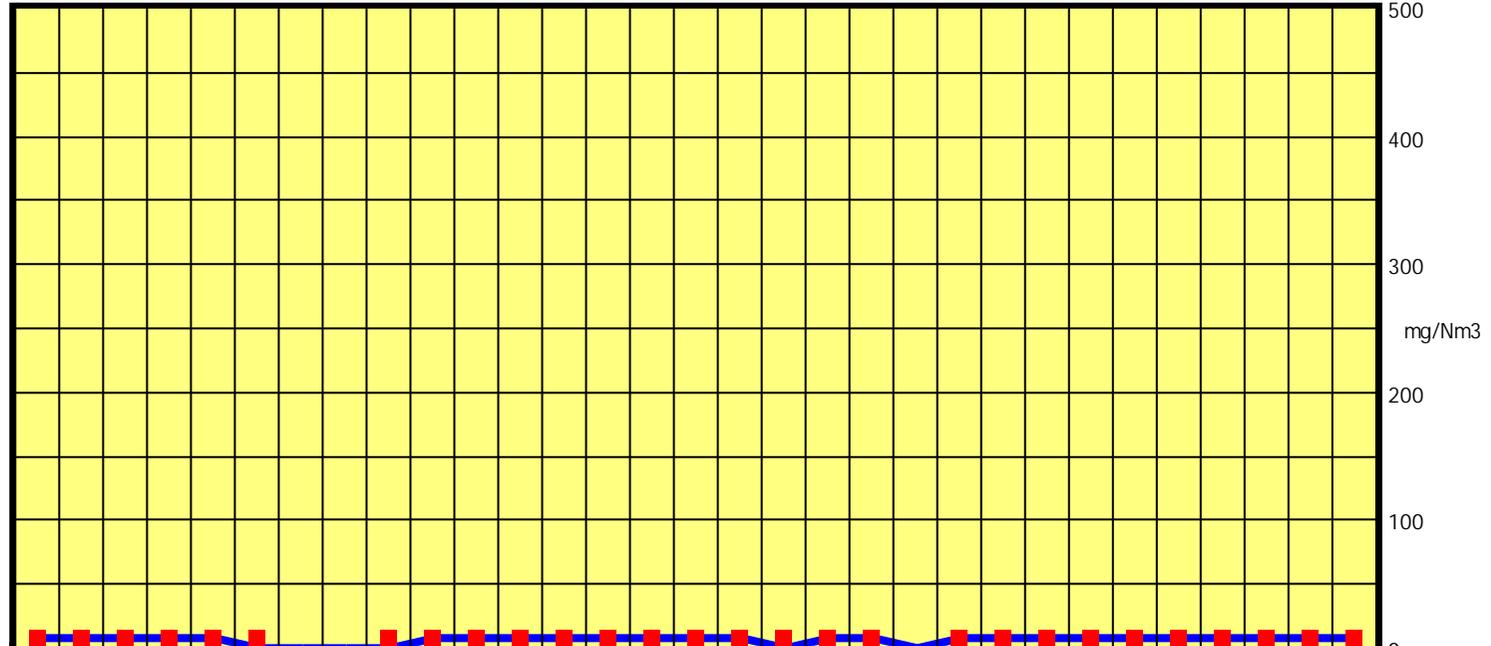

Month summary	
30 min ELV	
Monthly max.	8.4
Monthly mean	8.1
Monthly min.	7.9
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	8.1
No. invalid days	1
No. > ELV	0
No. report days	25

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	8.1	8.1	8.2	8.3	8.2	8.3	Off	Off	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.4	8.2	8.2	Off	8.2	8.2	8.1	8.1	8.2	8.2	8.2	8.2	8.2	8.1	
Mean	8.1	8.1	8.1	8.1	8.1	8.1	Off	Off	8.1	8.1	8.1	8.1	8.1	8.1	8.0	8.1	8.1	8.2	8.1	8.1	Off	8.1	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1
Min.	8.0	8.0	8.0	8.0	8.0	8.0	Off	Off	8.0	8.0	8.0	8.0	8.0	8.0	7.9	8.0	8.0	8.1	7.9	8.0	Off	7.9	7.9	7.9	7.9	8.0	8.0	7.9	8.0	8.0	8.0	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily Mean	8.1	8.1	8.1	8.1	8.1	N/A	Off	Off	N/A	8.1	8.1	8.1	8.1	8.1	8.0	8.1	8.1	N/A	8.1	8.1	Off	8.1	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	8.1	
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	N	N	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		

Data is as processed without repairs.

Signature

Redacted
authorised to sign on behalf of the company

Date 14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for O₂, Emission Point Report for Jul, 2025

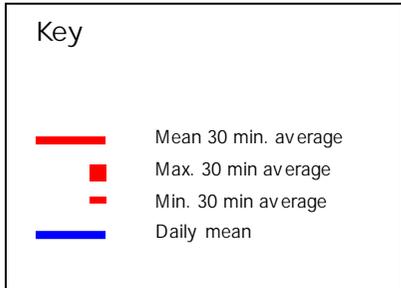

97th Percentile = 8.8
No. of valid averages = 1270

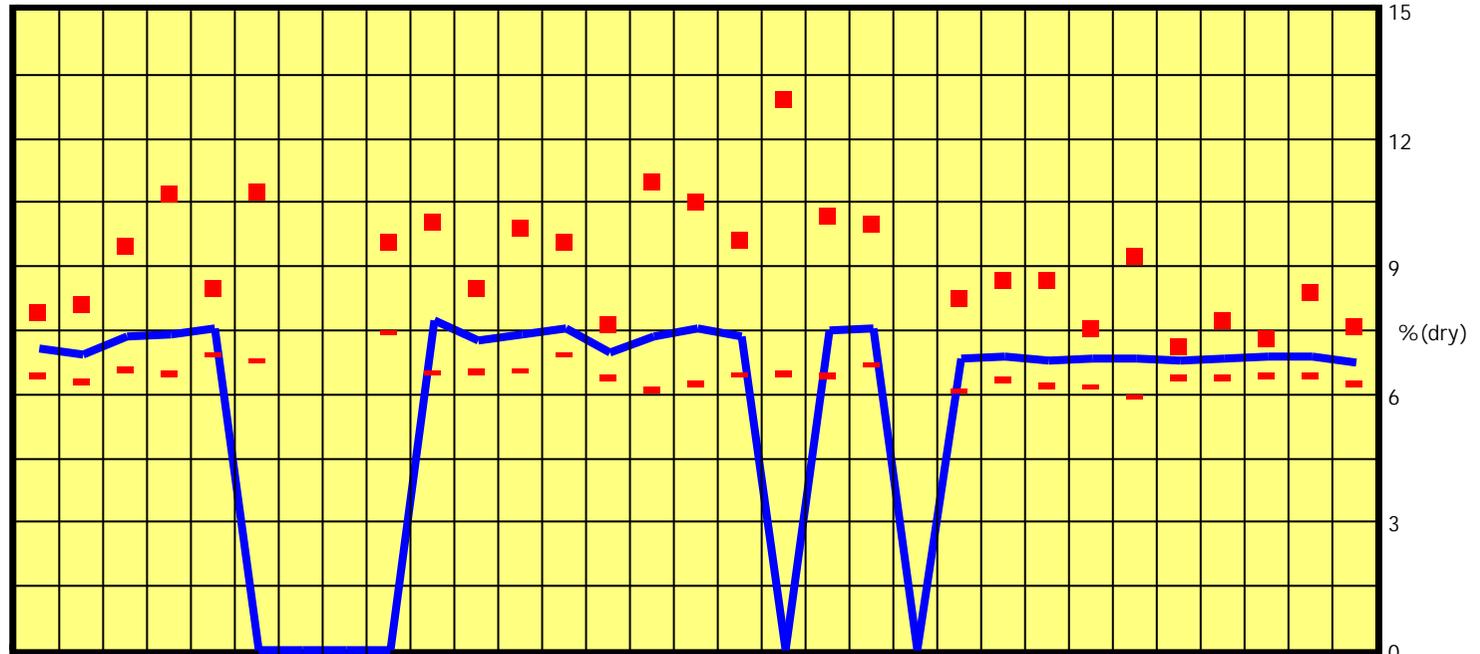

Month summary	
30 min ELV	
Monthly max.	12.9
Monthly mean	7.2
Monthly min.	5.9
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	7.7
No. invalid days	1
No. > ELV	0
No. report days	25

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	7.9	8.1	9.5	10.7	8.5	10.7	Off	Off	9.6	10.0	8.5	9.9	9.6	7.6	11.0	10.5	9.6	12.9	10.2	10.0	Off	8.2	8.7	8.7	7.5	9.2	7.1	7.7	7.3	8.4	7.6	
Mean	7.1	6.9	7.4	7.4	7.5	7.5	Off	Off	8.4	7.7	7.3	7.4	7.6	7.0	7.3	7.5	7.4	7.2	7.5	7.6	Off	6.9	6.9	6.8	6.8	6.9	6.8	6.9	6.9	6.9	6.8	
Min.	6.4	6.3	6.6	6.5	6.9	6.8	Off	Off	7.5	6.5	6.5	6.5	6.9	6.4	6.1	6.3	6.5	6.5	6.4	6.7	Off	6.1	6.4	6.2	6.2	5.9	6.4	6.4	6.4	6.4	6.2	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily Mean	7.1	6.9	7.4	7.4	7.5	N/A	Off	Off	N/A	7.7	7.3	7.4	7.6	7.0	7.3	7.5	7.4	N/A	7.5	7.6	Off	6.9	6.9	6.8	6.8	6.9	6.8	6.9	6.9	6.9	6.8	
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	N	N	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y		

Data is as processed without repairs.

Signature

Redacted

authorised to sign on behalf of the company

Date

14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for H2O, Emission Point Report for Jul, 2025

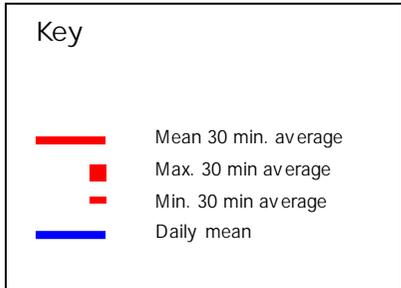

97th Percentile = 20.9
No. of valid averages = 1270

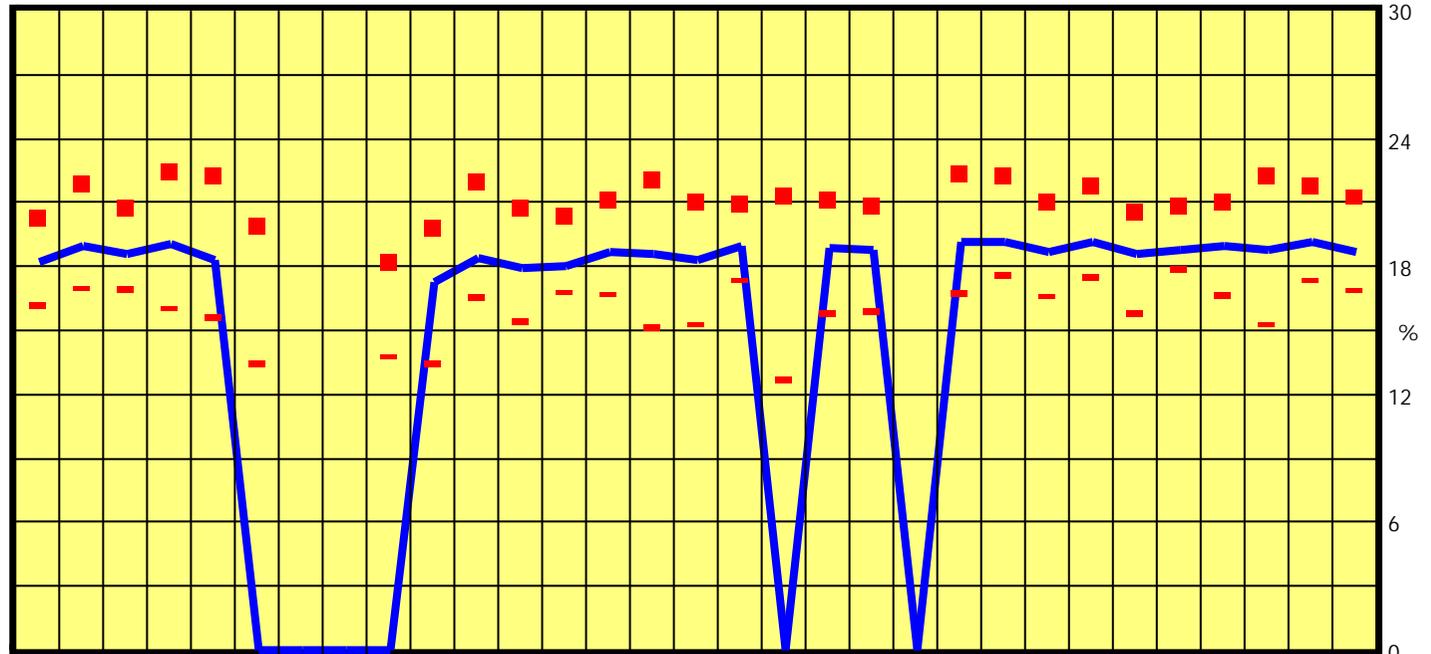

Month summary	
30 min ELV	
Monthly max.	22.5
Monthly mean	18.6
Monthly min.	12.7
Total invalid	1
Sum > ELV	0
Daily ELV	
Monthly max	19.2
No. invalid days	1
No. > ELV	0
No. report days	25

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	20.3	21.8	20.8	22.5	22.3	19.9	Off	Off	18.2	19.9	22.0	20.8	20.4	21.1	22.0	21.1	20.9	21.3	21.2	20.8	Off	22.3	22.2	21.0	21.8	20.5	20.8	21.0	22.2	21.8	21.3
Mean	18.2	18.9	18.6	19.1	18.3	17.7	Off	Off	16.8	17.2	18.4	17.9	18.1	18.7	18.5	18.3	19.0	18.9	18.9	18.8	Off	19.2	19.2	18.7	19.1	18.6	18.8	18.9	18.7	19.2	18.7
Min.	16.2	17.0	16.9	16.0	15.6	13.4	Off	Off	13.8	13.5	16.6	15.4	16.8	16.7	15.1	15.3	17.4	12.7	15.8	15.9	Off	16.7	17.6	16.6	17.5	15.8	17.9	16.6	15.3	17.4	16.9
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	18.2	18.9	18.6	19.1	18.3	N/A	Off	Off	N/A	17.2	18.4	17.9	18.1	18.7	18.5	18.3	19.0	N/A	18.9	18.8	Off	19.2	19.2	18.7	19.1	18.6	18.8	18.9	18.7	19.2	18.7
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	N	N	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature

Redacted

authorised to sign on behalf of the company

Date

14.10.2025


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for Dust, Emission Point Report for Jul, 2025

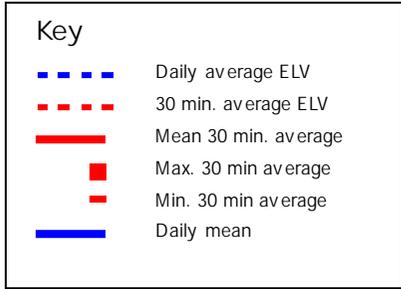

97th Percentile = 0.6
No. of valid averages = 1271

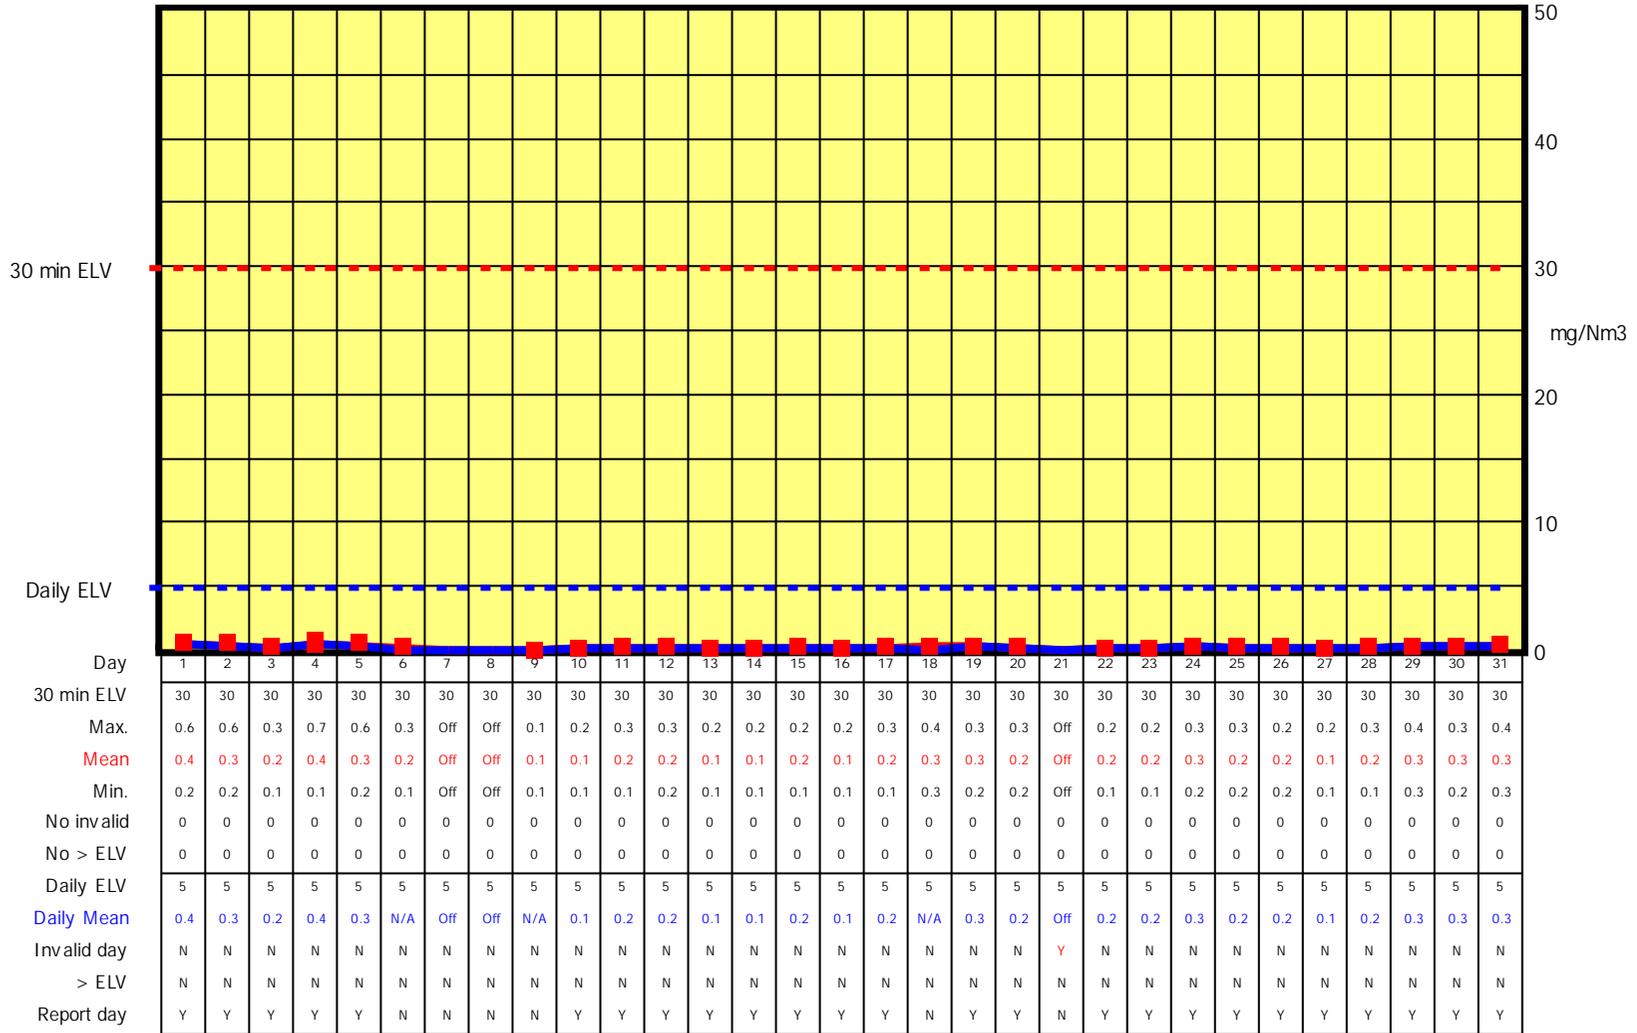

Month summary	
30 min ELV	
Monthly max.	0.7
Monthly mean	0.2
Monthly min.	0.1
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	0.4
No. invalid days	1
No. > ELV	0
No. report days	25

Data is as processed without repairs.

Signature

Redacted

authorised to sign on behalf of the company

Date

14.10.2025