


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for NO<sub>x</sub>, Emission Point Report for May, 2026

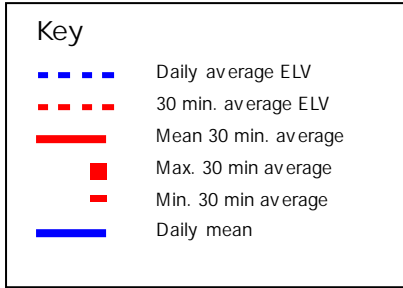

97th Percentile = 131.0  
No. of valid averages = 1487

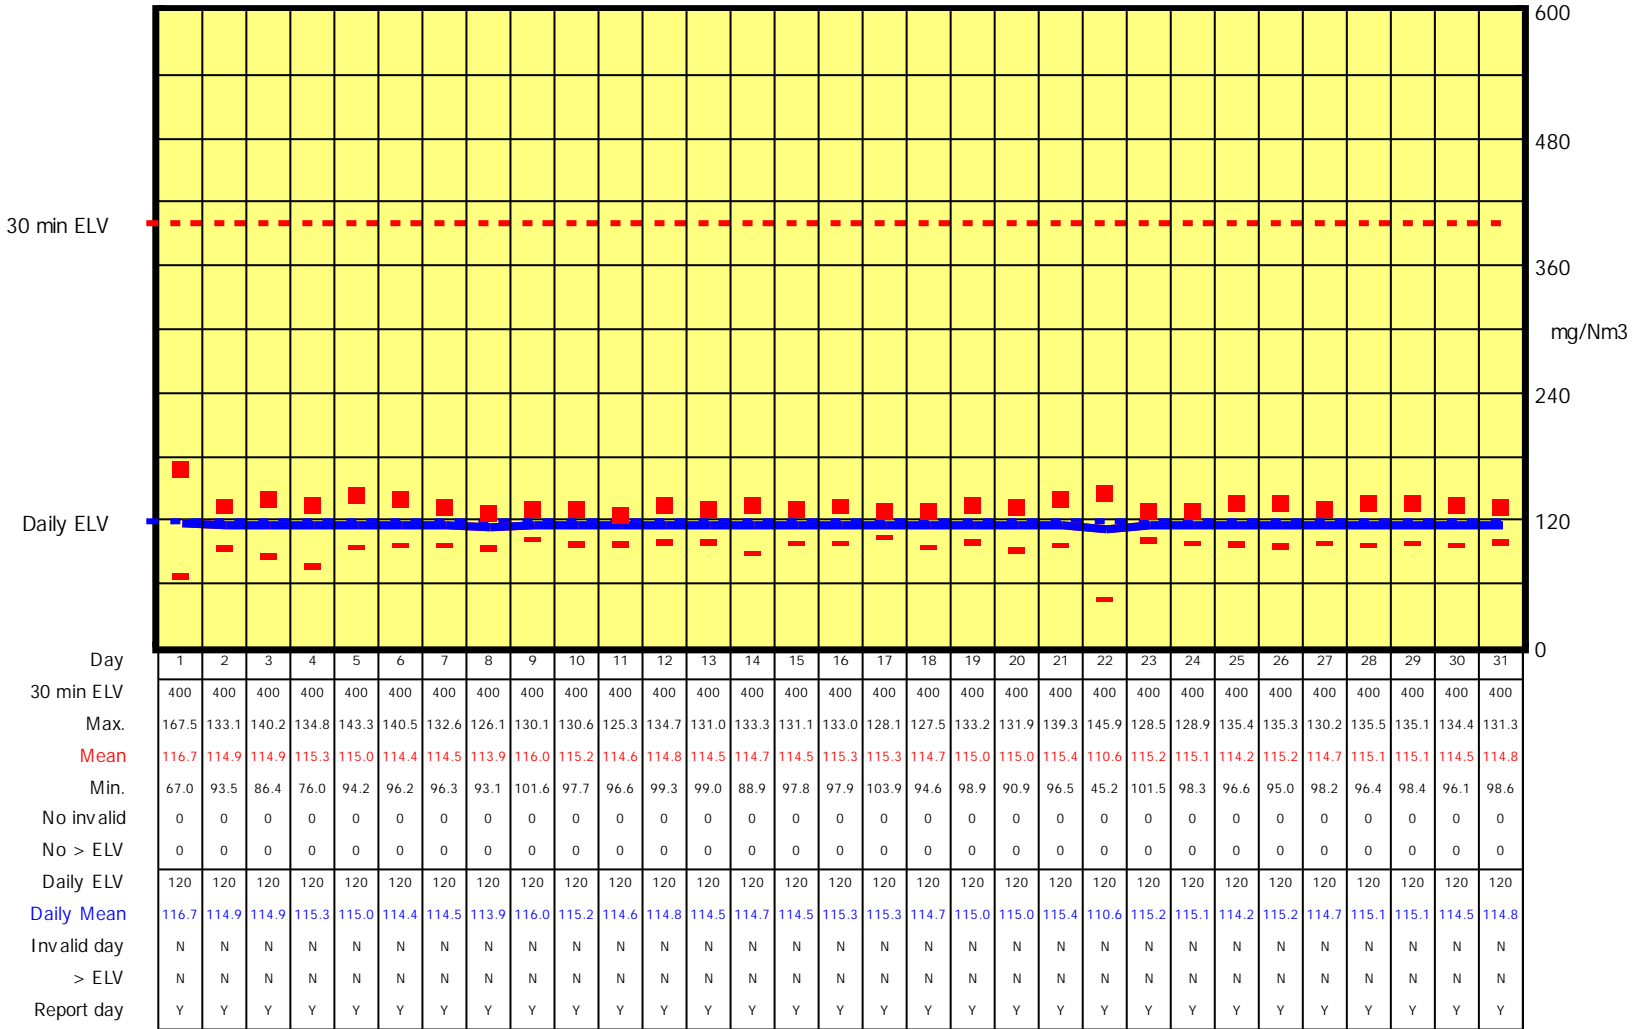

Month summary	
<b>30 min ELV</b>	
Monthly max.	167.5
Monthly mean	114.8
Monthly min.	45.2
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	116.7
No. invalid days	0
No. > ELV	0
No. report days	31



Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_

Reporting of Continuously Monitored Emissions to Air for CO, Emission Point Report for May, 2026

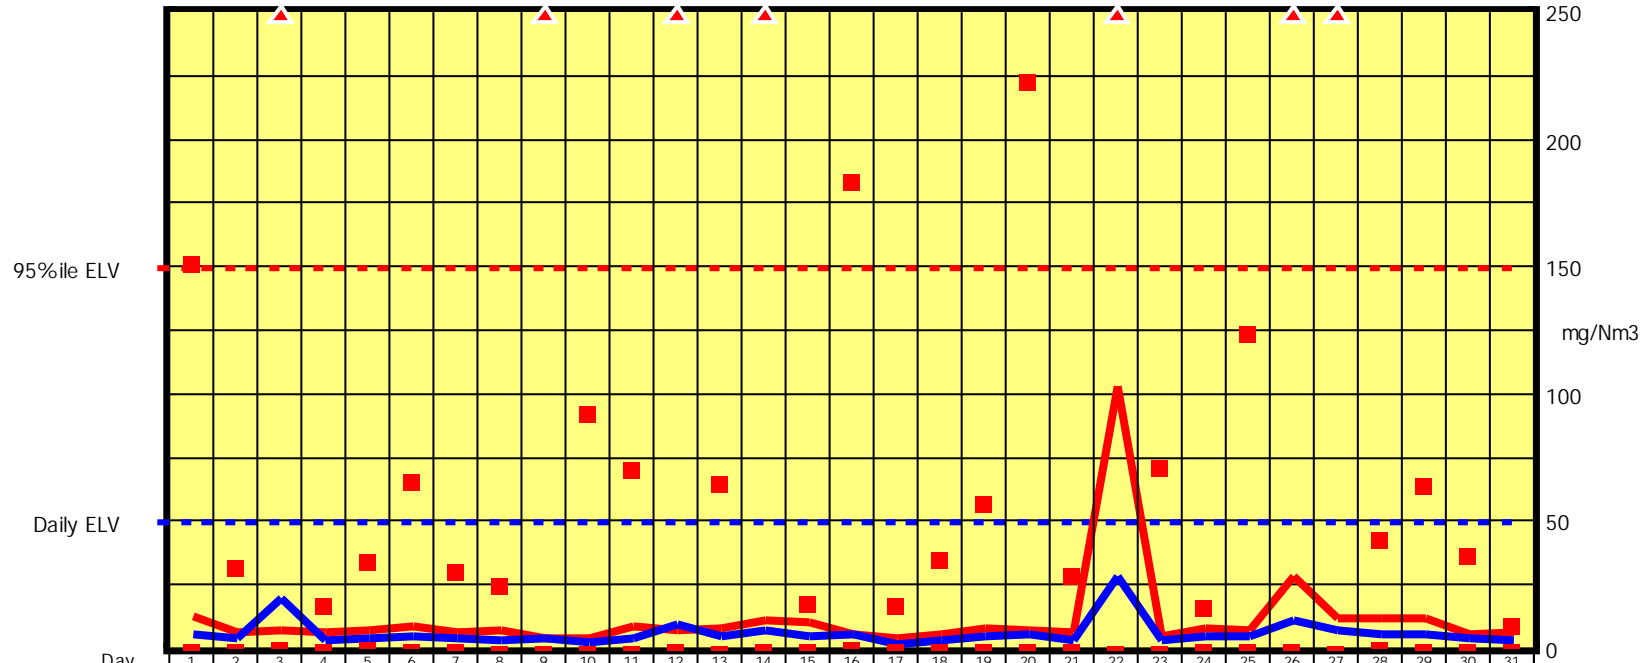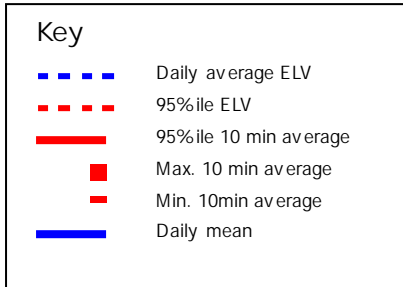

Month summary	
<b>10 minute data</b>	
Monthly max.	1568.4
Monthly mean	5.9
Monthly min.	0.0
Total invalid	3
Sum > ELV	19
Total %ile exceed.	0
<b>Daily ELV</b>	
Monthly max	28.1
No. invalid days	0
No. > ELV	0
No. report days	31

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
95%ile 10 min ELV	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
Max.	151.1	31.3	1285.3	16.7	34.2	65.1	29.7	24.6	328.7	92.0	69.8	375.0	64.3	370.5	17.1	182.9	16.4	34.3	56.4	222.1	28.3	1568.4	70.6	15.6	123.4	375.7	262.2	42.6	63.3	36.2	8.9	
10 min 95%ile	12.4	6.3	7.1	5.9	7.1	8.4	6.7	7.4	3.7	3.8	8.4	6.7	8.1	11.2	9.9	5.6	3.6	5.7	7.9	7.1	6.6	103.2	5.0	7.9	7.3	28.1	11.9	12.1	11.5	5.5	6.1	
Min.	0.4	0.7	1.1	0.5	1.1	0.8	0.3	0.0	0.0	0.0	0.1	0.3	0.0	0.2	0.6	1.2	0.2	0.3	0.6	0.1	0.2	0.0	0.0	0.6	0.2	0.6	0.0	1.2	0.2	0.4	0.7	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0	
No > ELV	1	0	2	0	0	0	0	0	1	0	0	3	0	1	0	1	0	0	0	1	0	6	0	0	0	1	2	0	0	0	0	
ELV exceeded?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Daily ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
Daily Mean	5.8	4.1	19.3	3.2	4.0	5.1	4.3	3.1	3.7	2.6	3.6	9.5	4.4	6.7	4.4	5.6	1.9	2.9	4.7	5.1	3.4	28.1	2.9	4.3	4.5	10.8	7.4	5.3	5.8	3.7	2.8	
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO<sub>2</sub>, Emission Point Report for May, 2026

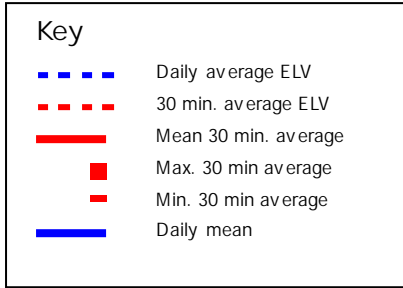

97th Percentile = 8.0  
No. of valid averages = 1487

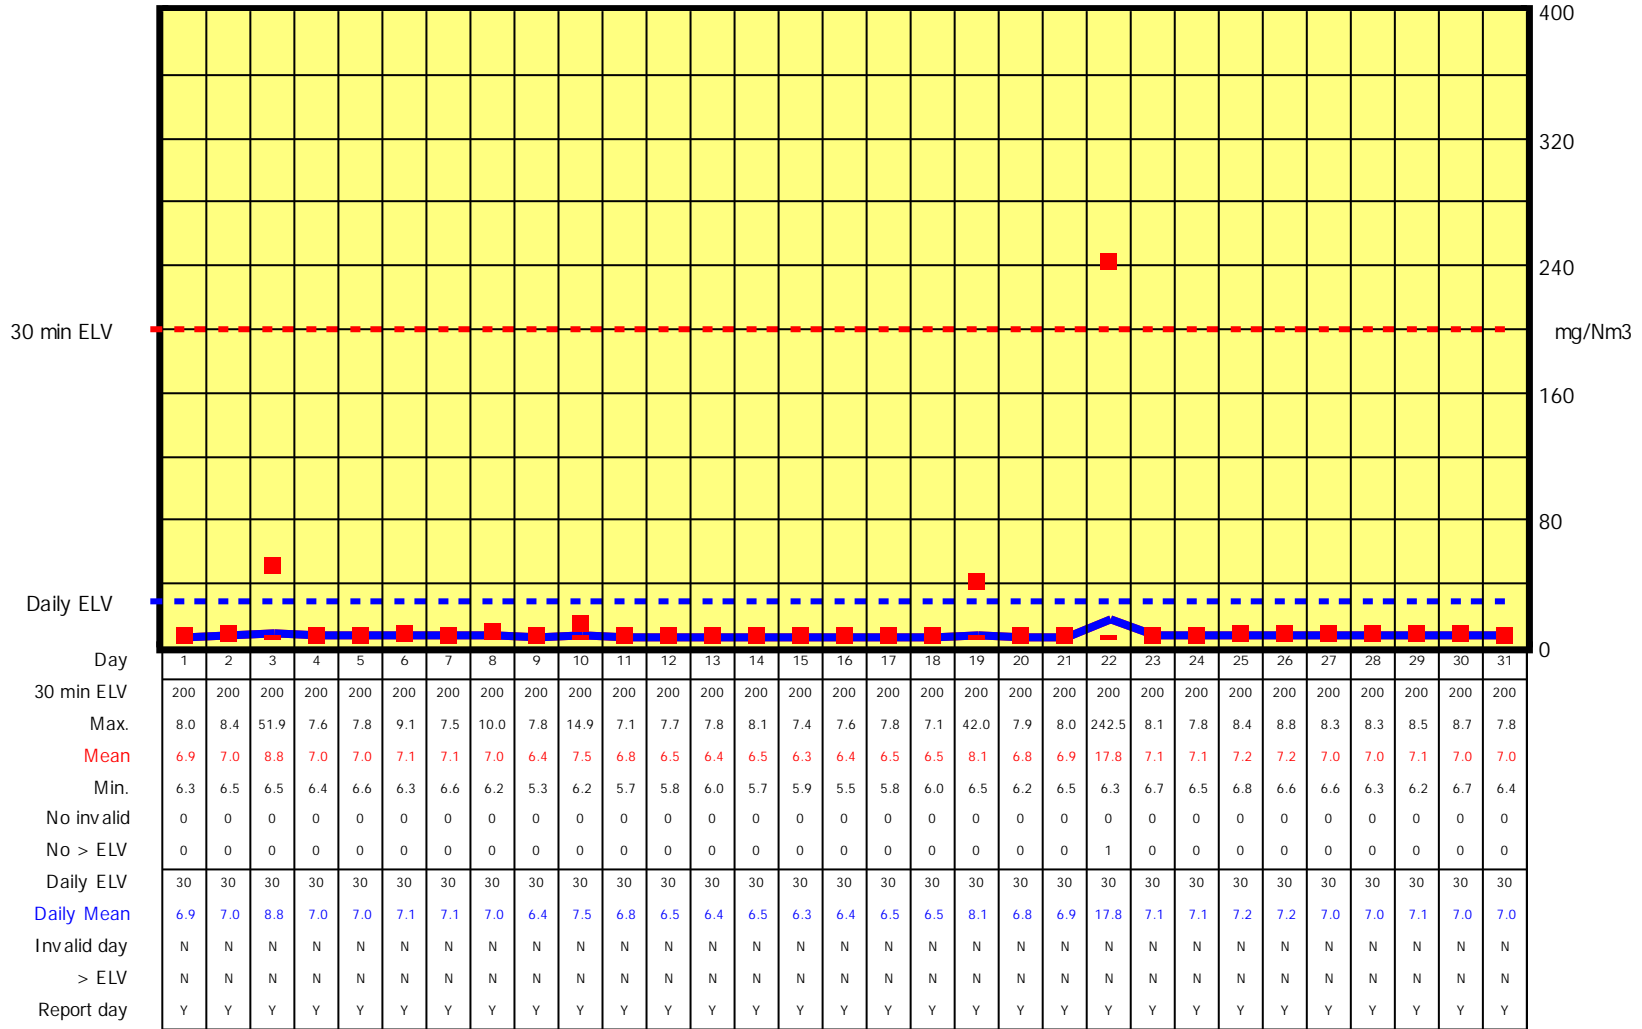

Month summary	
<b>30 min ELV</b>	
Monthly max.	242.5
Monthly mean	7.3
Monthly min.	5.3
Total invalid	0
Sum > ELV	1
<b>Daily ELV</b>	
Monthly max	17.8
No. invalid days	0
No. > ELV	0
No. report days	31

Data is as processed without repairs.

Signature \_\_\_\_\_  
authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCL, Emission Point Report for May, 2026

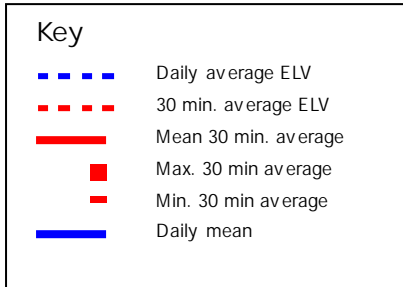

97th Percentile = 5.7  
No. of valid averages = 1487

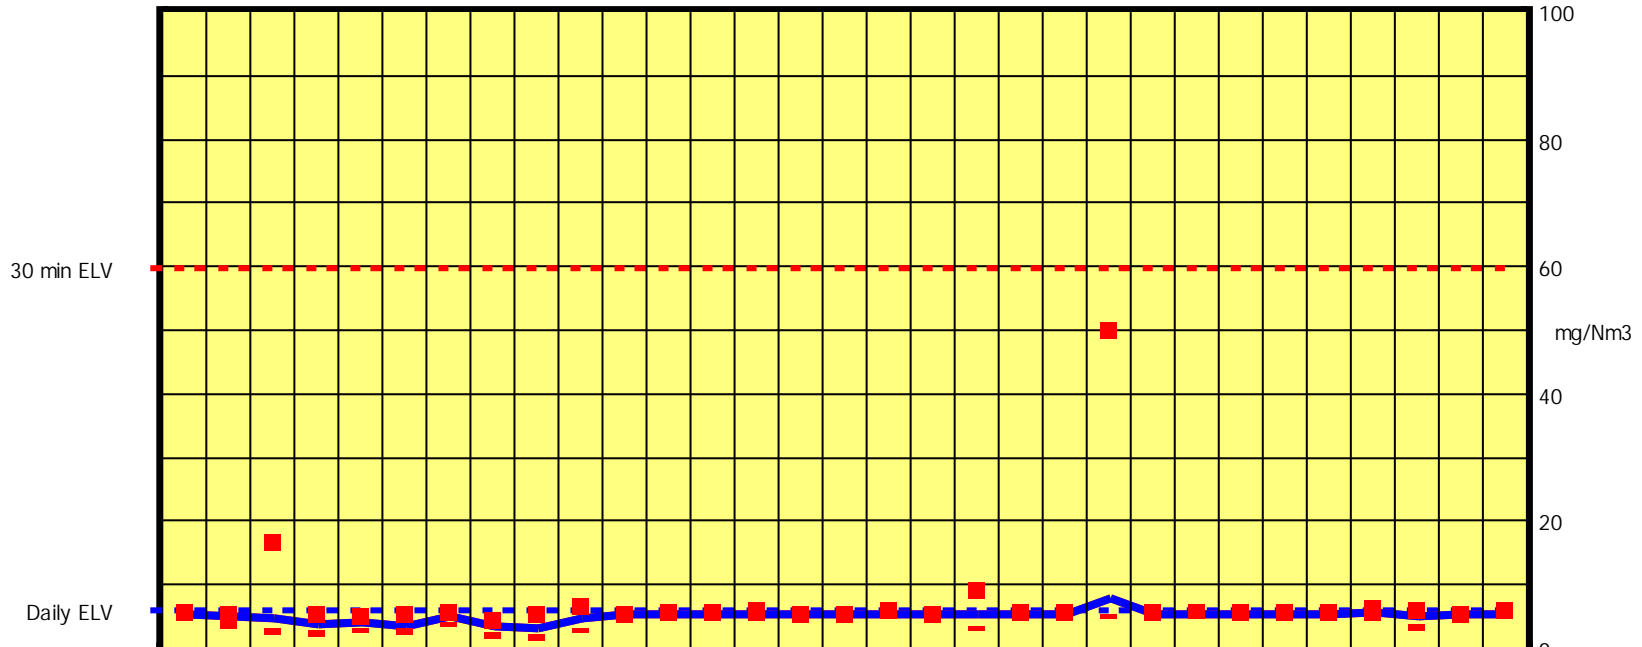

Month summary	
<b>30 min ELV</b>	
Monthly max.	50.1
Monthly mean	5.1
Monthly min.	1.8
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	7.7
No. invalid days	0
No. > ELV	1
No. report days	31

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
Max.	5.6	5.4	16.6	5.3	5.1	5.3	5.5	4.5	5.4	6.5	5.5	5.7	5.7	5.9	5.5	5.5	5.9	5.5	9.1	5.6	5.6	50.1	5.6	5.8	5.8	5.6	5.6	6.2	6.0	5.5	6.0
Mean	5.3	5.1	4.7	3.7	4.0	3.5	5.1	3.3	3.1	4.8	5.3	5.3	5.4	5.4	5.4	5.3	5.3	5.3	5.3	5.3	5.4	7.7	5.4	5.5	5.5	5.4	5.4	5.6	5.1	5.3	5.4
Min.	4.7	3.6	2.6	2.4	2.9	2.7	3.8	2.1	1.8	2.9	5.0	4.9	5.0	5.0	5.0	5.0	5.1	4.7	3.1	4.7	5.1	5.1	5.0	5.3	5.4	4.8	4.9	4.8	3.3	4.8	5.1
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	
Daily Mean	5.3	5.1	4.7	3.7	4.0	3.5	5.1	3.3	3.1	4.8	5.3	5.3	5.4	5.4	5.4	5.3	5.3	5.3	5.3	5.3	5.4	7.7	5.4	5.5	5.5	5.4	5.4	5.6	5.1	5.3	5.4
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH<sub>3</sub>, Emission Point Report for May, 2026

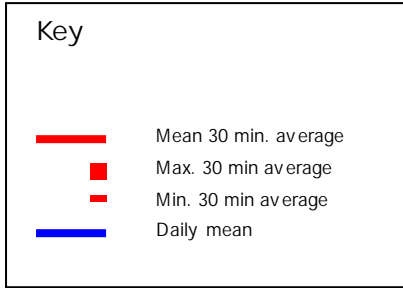

97th Percentile = 2.0  
No. of valid averages = 1487

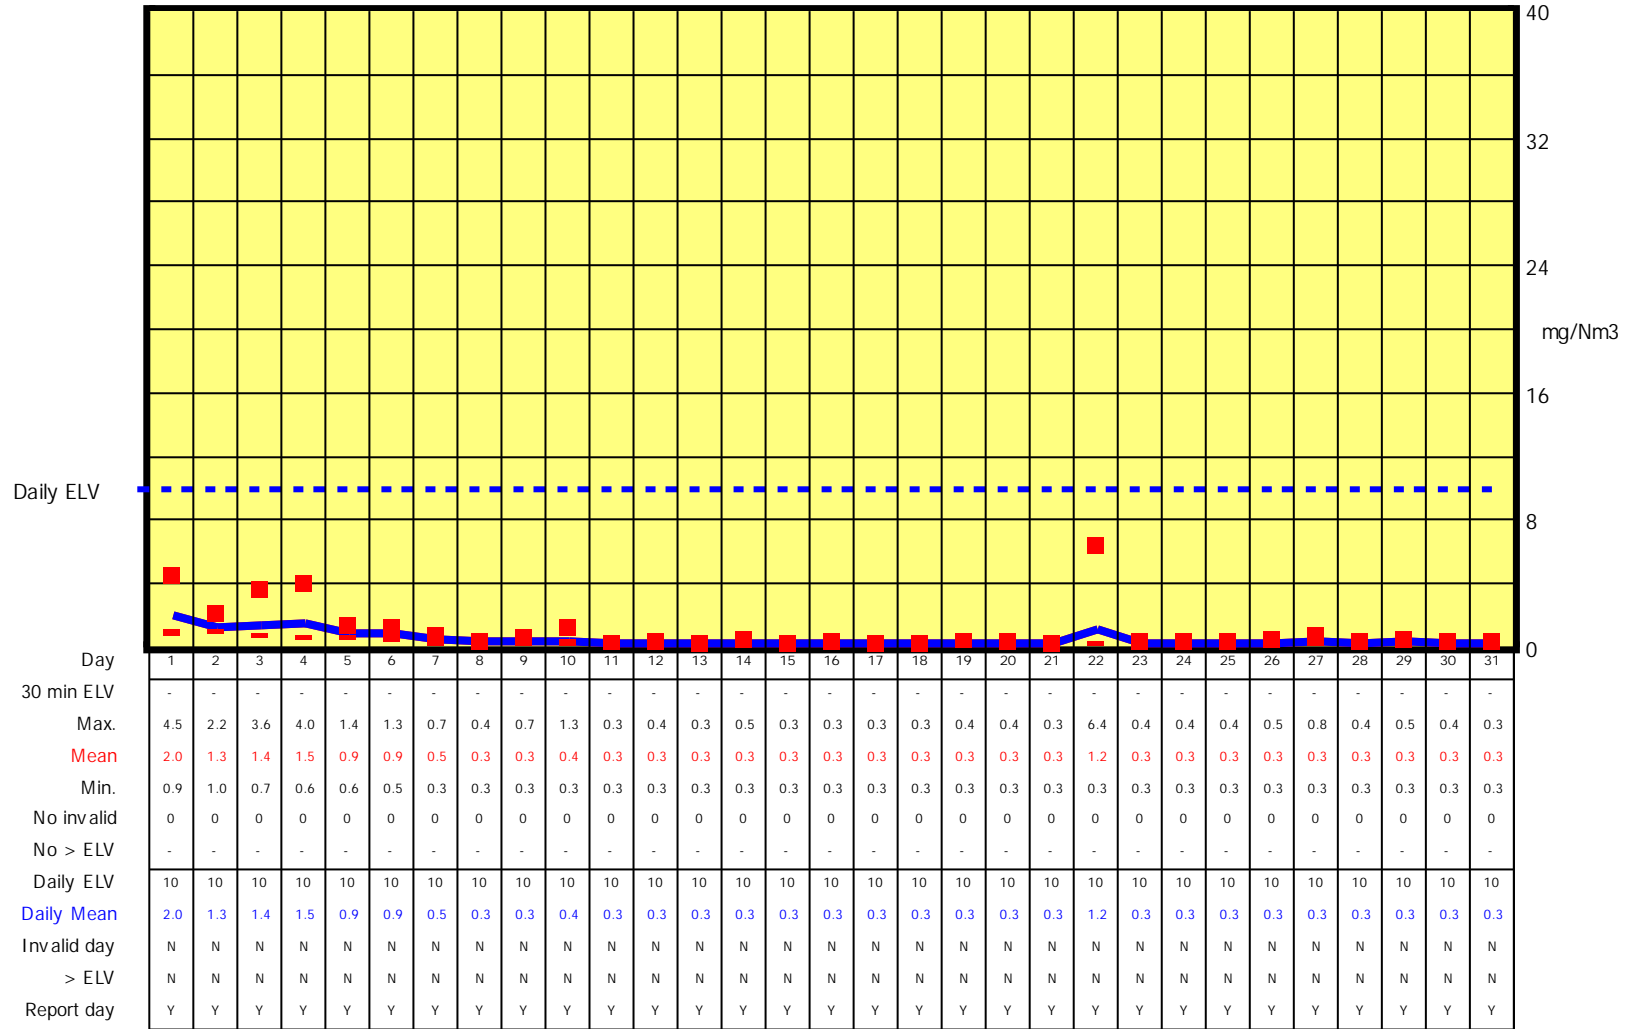

Month summary	
<b>30 min ELV</b>	
Monthly max.	6.4
Monthly mean	0.5
Monthly min.	0.3
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	2.0
No. invalid days	0
No. > ELV	0
No. report days	31

Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC, Emission Point Report for May, 2026

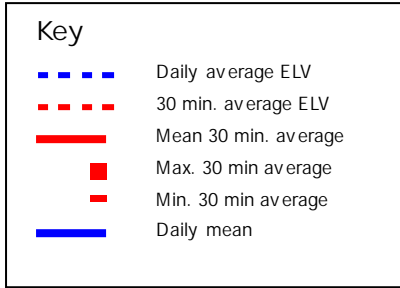

97th Percentile = 0.1  
 No. of valid averages = 1487

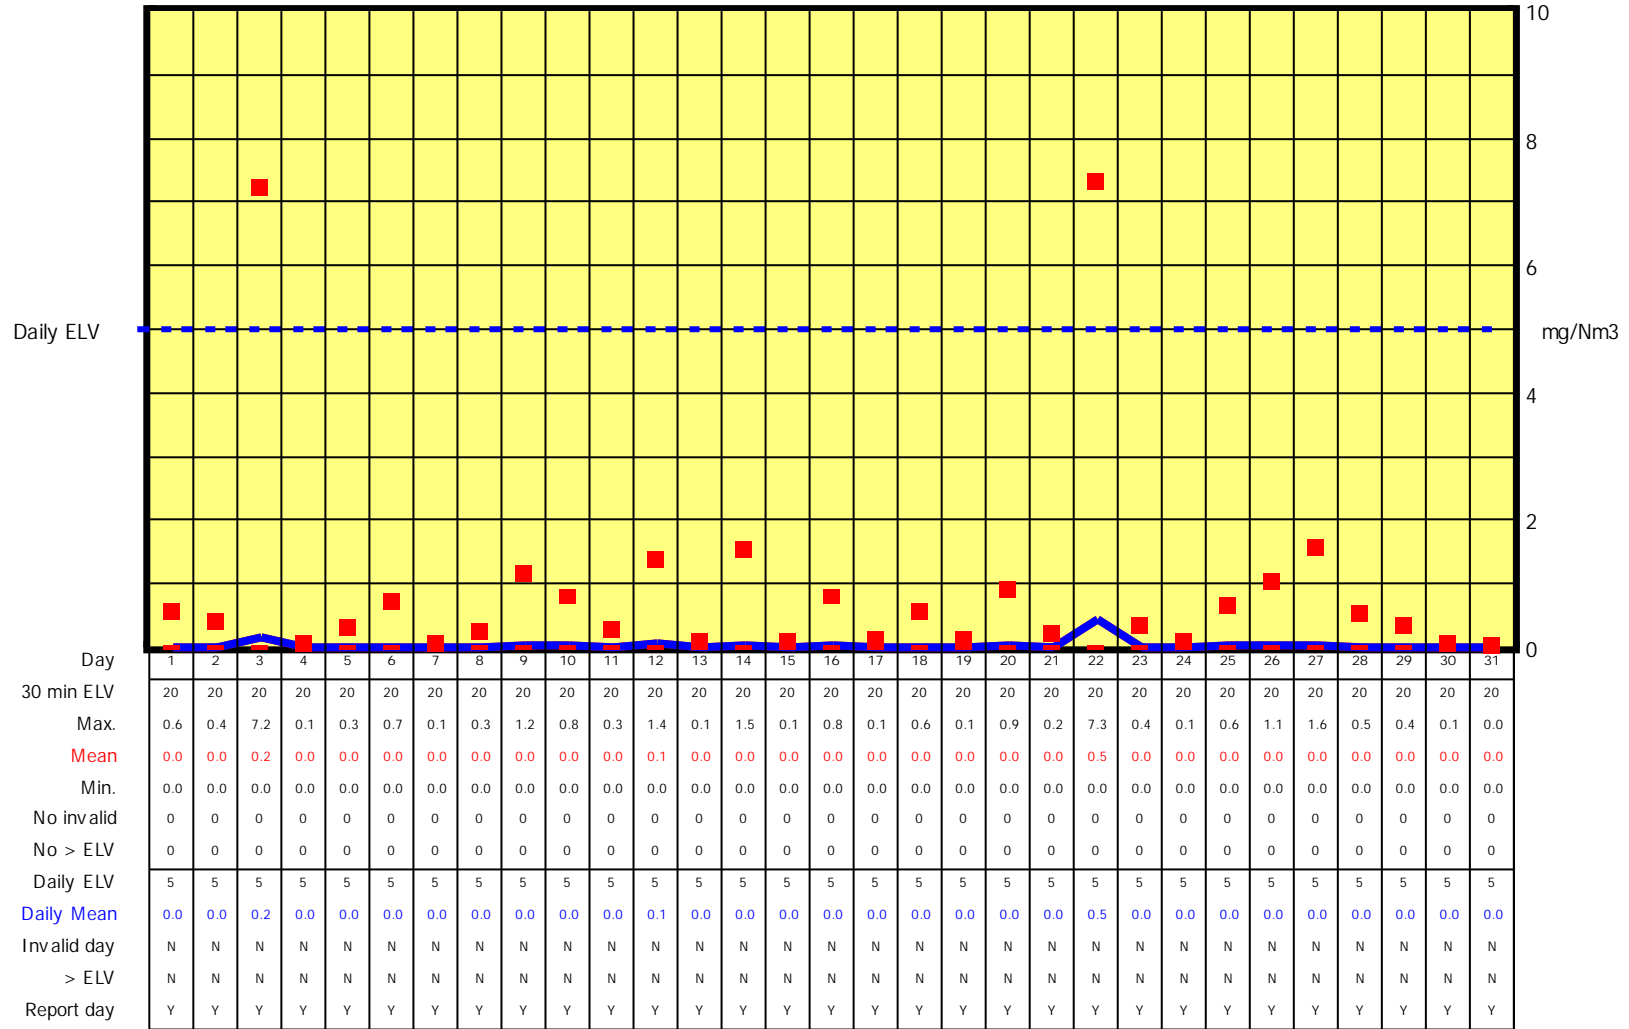

Month summary	
<b>30 min ELV</b>	
Monthly max.	7.3
Monthly mean	0.0
Monthly min.	0.0
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	0.5
No. invalid days	0
No. > ELV	0
No. report days	31

Data is as processed without repairs.

Signature \_\_\_\_\_  
 authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O, Emission Point Report for May, 2026

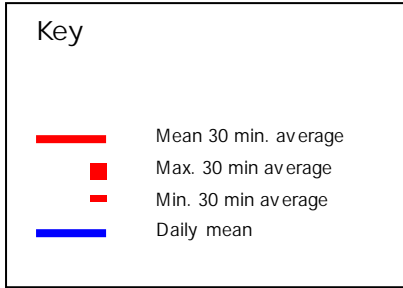

97th Percentile = 5.3  
 No. of valid averages = 1487

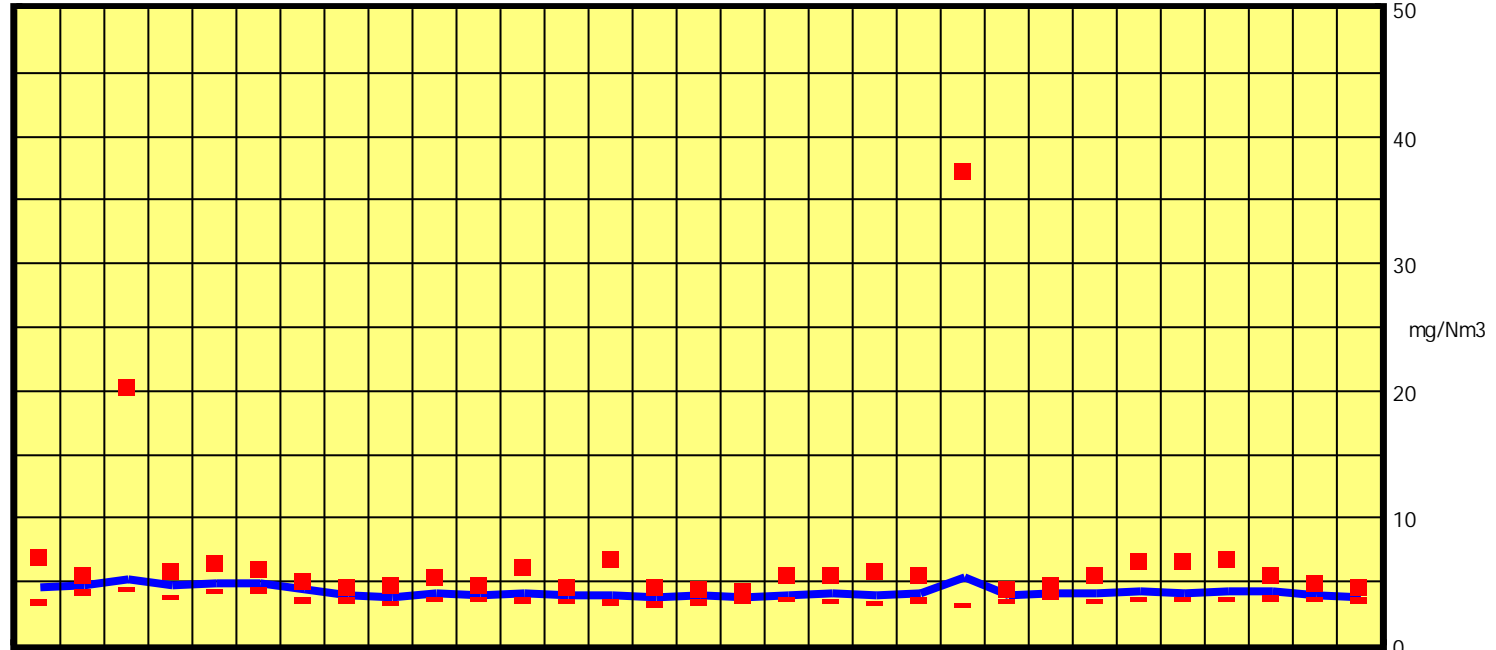

Month summary	
<b>30 min ELV</b>	
Monthly max.	37.2
Monthly mean	4.2
Monthly min.	3.2
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	5.3
No. invalid days	0
No. > ELV	0
No. report days	31

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	6.9	5.5	20.3	5.8	6.5	6.0	5.1	4.5	4.7	5.3	4.7	6.2	4.6	6.8	4.5	4.5	4.2	5.5	5.4	5.8	5.4	37.2	4.4	4.7	5.5	6.5	6.6	6.8	5.5	4.8	4.5
Mean	4.5	4.7	5.2	4.7	4.8	4.8	4.4	3.9	3.8	4.0	3.9	4.0	4.0	4.0	3.8	3.9	3.8	3.9	4.1	4.0	4.1	5.3	3.9	4.1	4.0	4.2	4.2	4.3	4.3	3.9	3.9
Min.	3.4	4.2	4.4	3.8	4.2	4.3	3.5	3.5	3.3	3.6	3.6	3.6	3.5	3.4	3.2	3.4	3.6	3.6	3.4	3.3	3.6	3.2	3.5	3.8	3.4	3.6	3.6	3.6	3.7	3.6	3.6
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	4.5	4.7	5.2	4.7	4.8	4.8	4.4	3.9	3.8	4.0	3.9	4.0	4.0	4.0	3.8	3.9	3.8	3.9	4.1	4.0	4.1	5.3	3.9	4.1	4.0	4.2	4.2	4.3	4.3	3.9	3.9
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO<sub>2</sub>, Emission Point Report for May, 2026

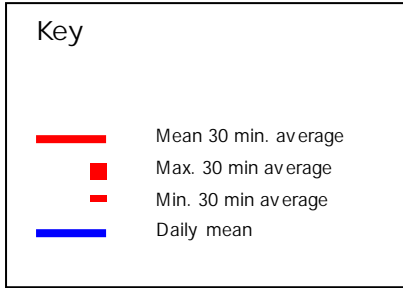

97th Percentile = 8.3  
No. of valid averages = 1487

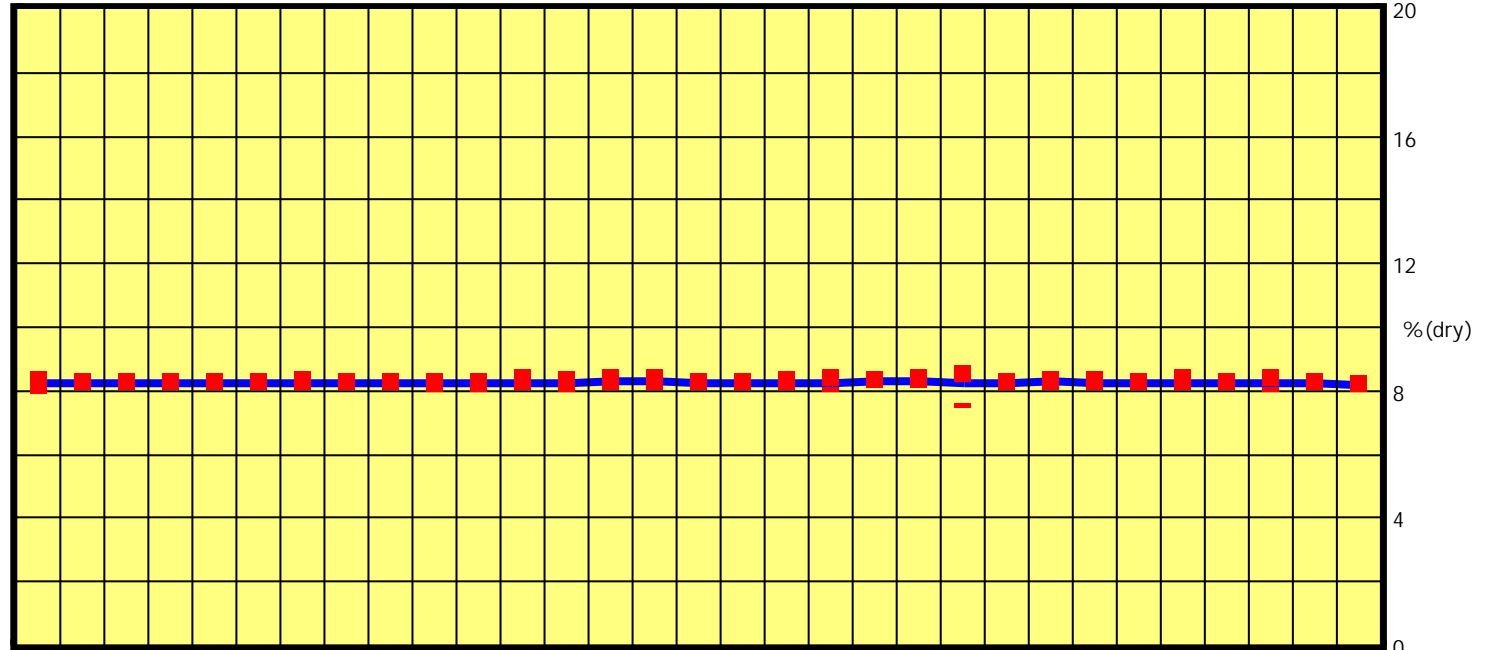

Month summary	
<b>30 min ELV</b>	
Monthly max.	8.5
Monthly mean	8.2
Monthly min.	7.5
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	8.3
No. invalid days	0
No. > ELV	0
No. report days	31

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	8.4	8.3	8.3	8.3	8.3	8.3	8.4	8.3	8.3	8.3	8.3	8.4	8.3	8.4	8.4	8.3	8.3	8.4	8.4	8.4	8.4	8.5	8.3	8.4	8.4	8.3	8.4	8.3	8.4	8.3	8.3
Mean	8.2	8.3	8.2	8.2	8.3	8.2	8.2	8.3	8.3	8.2	8.2	8.3	8.2	8.3	8.3	8.3	8.2	8.3	8.3	8.3	8.3	8.2	8.2	8.3	8.3	8.3	8.3	8.2	8.2	8.2	8.2
Min.	8.0	8.2	8.2	8.1	8.1	8.1	8.1	8.2	8.2	8.1	8.1	8.1	8.1	8.2	8.1	8.2	8.1	8.1	8.1	8.1	8.2	8.2	7.5	8.2	8.2	8.1	8.1	8.1	8.1	8.1	8.1
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	8.2	8.3	8.2	8.2	8.3	8.2	8.2	8.3	8.3	8.2	8.2	8.3	8.2	8.3	8.3	8.3	8.2	8.3	8.3	8.3	8.3	8.2	8.2	8.3	8.3	8.3	8.3	8.2	8.2	8.2	8.2
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for O<sub>2</sub>, Emission Point Report for May, 2026

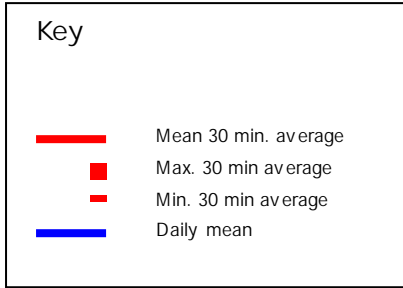

97th Percentile = 7.8  
No. of valid averages = 1487

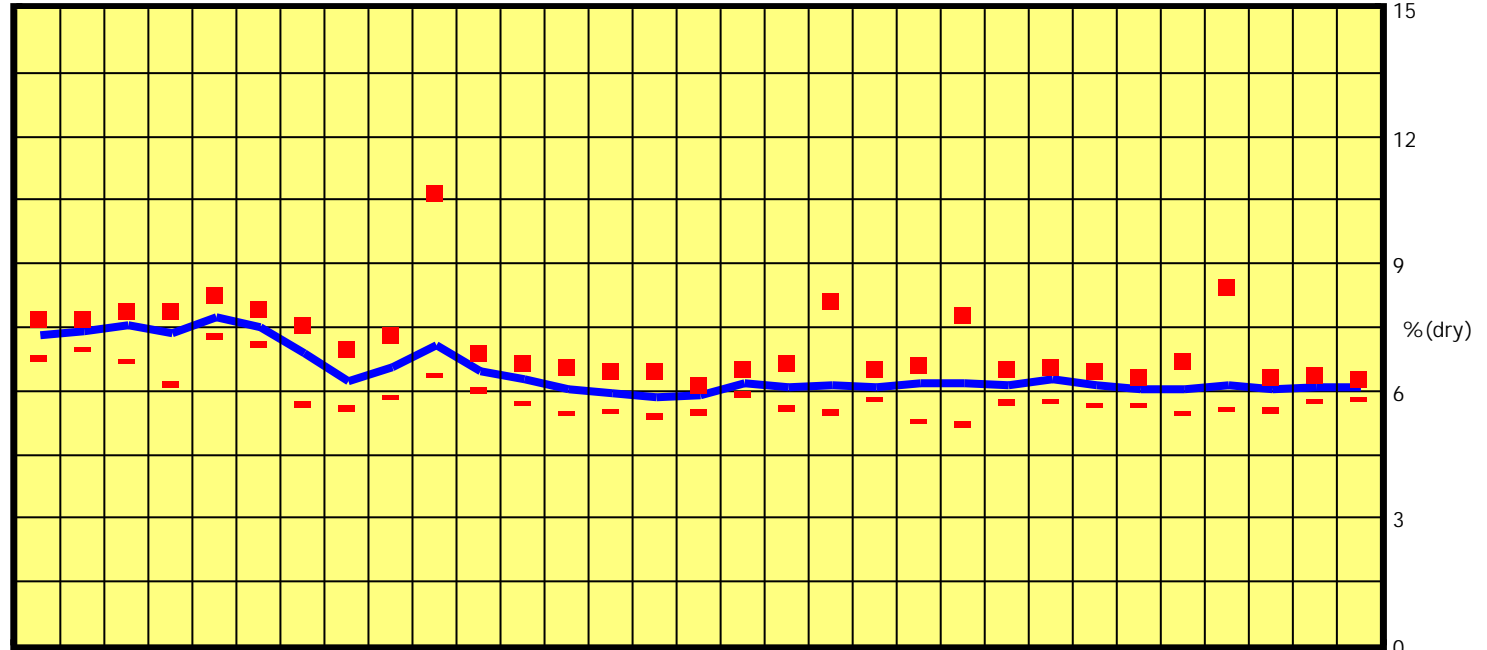

Month summary	
<b>30 min ELV</b>	
Monthly max.	10.7
Monthly mean	6.4
Monthly min.	5.2
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	7.7
No. invalid days	0
No. > ELV	0
No. report days	31

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	7.7	7.7	7.9	7.9	8.3	7.9	7.5	7.0	7.3	10.7	6.9	6.7	6.5	6.4	6.5	6.1	6.5	6.6	8.1	6.5	6.6	7.8	6.5	6.6	6.5	6.3	6.7	8.4	6.3	6.4	6.3	
Mean	7.3	7.4	7.5	7.3	7.7	7.5	6.9	6.2	6.6	7.1	6.5	6.3	6.1	6.0	5.8	5.9	6.2	6.1	6.1	6.1	6.2	6.2	6.1	6.3	6.1	6.0	6.0	6.1	6.0	6.1	6.1	
Min.	6.8	7.0	6.7	6.1	7.3	7.1	5.7	5.6	5.9	6.4	6.0	5.7	5.5	5.5	5.4	5.5	5.9	5.6	5.5	5.8	5.3	5.2	5.7	5.8	5.7	5.7	5.5	5.6	5.6	5.8	5.8	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily Mean	7.3	7.4	7.5	7.3	7.7	7.5	6.9	6.2	6.6	7.1	6.5	6.3	6.1	6.0	5.8	5.9	6.2	6.1	6.1	6.1	6.2	6.2	6.1	6.3	6.1	6.0	6.0	6.1	6.0	6.1		
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature \_\_\_\_\_

authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for H2O, Emission Point Report for May, 2026

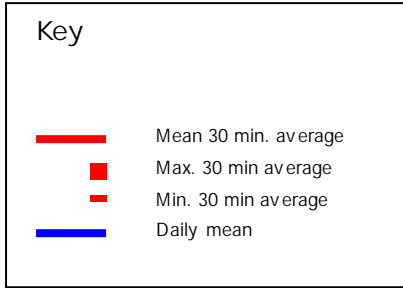

97th Percentile = 21.0  
No. of valid averages = 1487

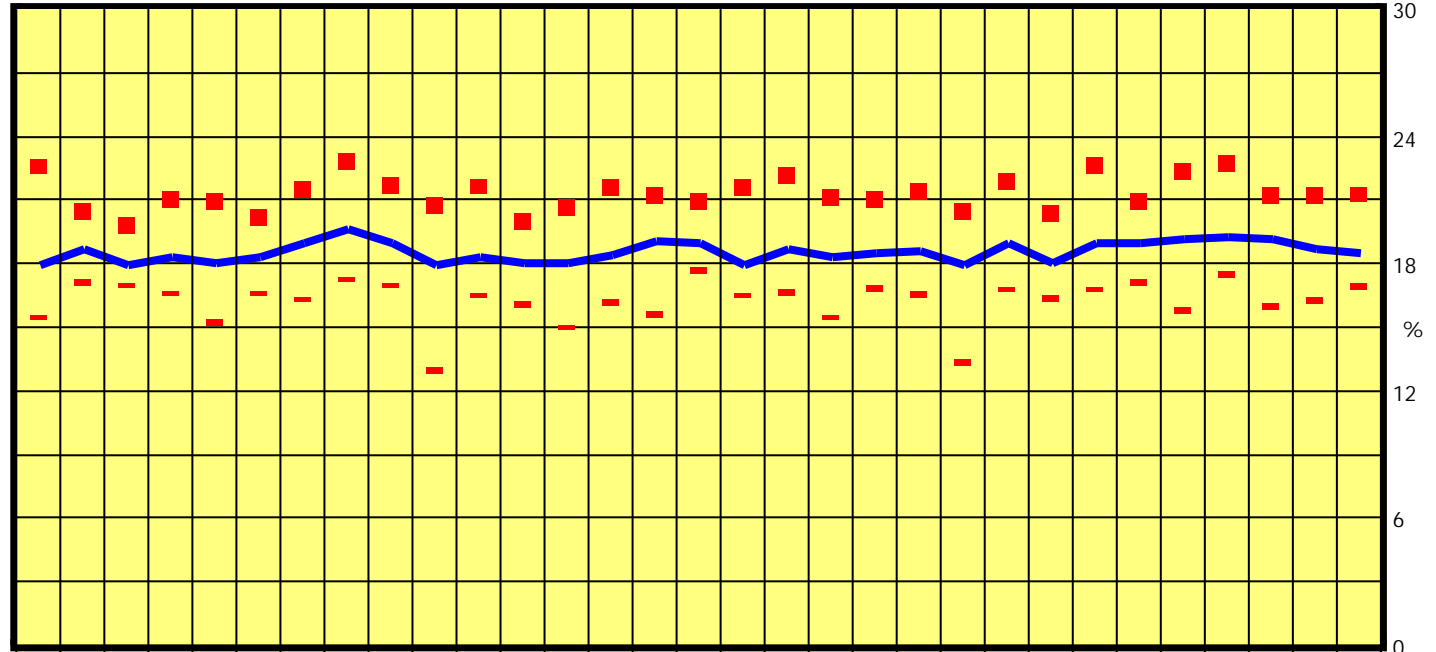

Month summary	
<b>30 min ELV</b>	
Monthly max.	22.9
Monthly mean	18.6
Monthly min.	13.0
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	19.6
No. invalid days	0
No. > ELV	0
No. report days	31

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	22.6	20.5	19.8	21.0	21.0	20.2	21.5	22.9	21.7	20.7	21.7	20.0	20.7	21.6	21.2	20.9	21.6	22.2	21.1	21.1	21.4	20.5	21.9	20.3	22.6	21.0	22.4	22.7	21.3	21.2	21.3
Mean	18.0	18.7	18.0	18.3	18.0	18.3	19.0	19.6	19.0	18.0	18.3	18.1	18.0	18.4	19.1	19.0	18.0	18.7	18.3	18.5	18.6	17.9	18.9	18.0	19.0	19.0	19.2	19.3	19.1	18.7	18.5
Min.	15.5	17.1	17.0	16.6	15.3	16.6	16.3	17.3	17.0	13.0	16.5	16.1	15.0	16.2	15.6	17.7	16.5	16.6	15.5	16.9	16.5	13.3	16.8	16.4	16.8	17.1	15.8	17.5	16.0	16.3	16.9
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	18.0	18.7	18.0	18.3	18.0	18.3	19.0	19.6	19.0	18.0	18.3	18.1	18.0	18.4	19.1	19.0	18.0	18.7	18.3	18.5	18.6	17.9	18.9	18.0	19.0	19.0	19.2	19.3	19.1	18.7	18.5
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature \_\_\_\_\_  
authorised to sign on behalf of the company

Date \_\_\_\_\_


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for Dust, Emission Point Report for May, 2026

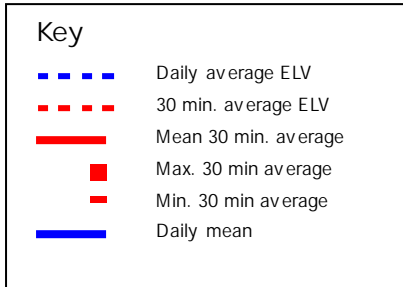

97th Percentile = 1.2  
No. of valid averages = 1487

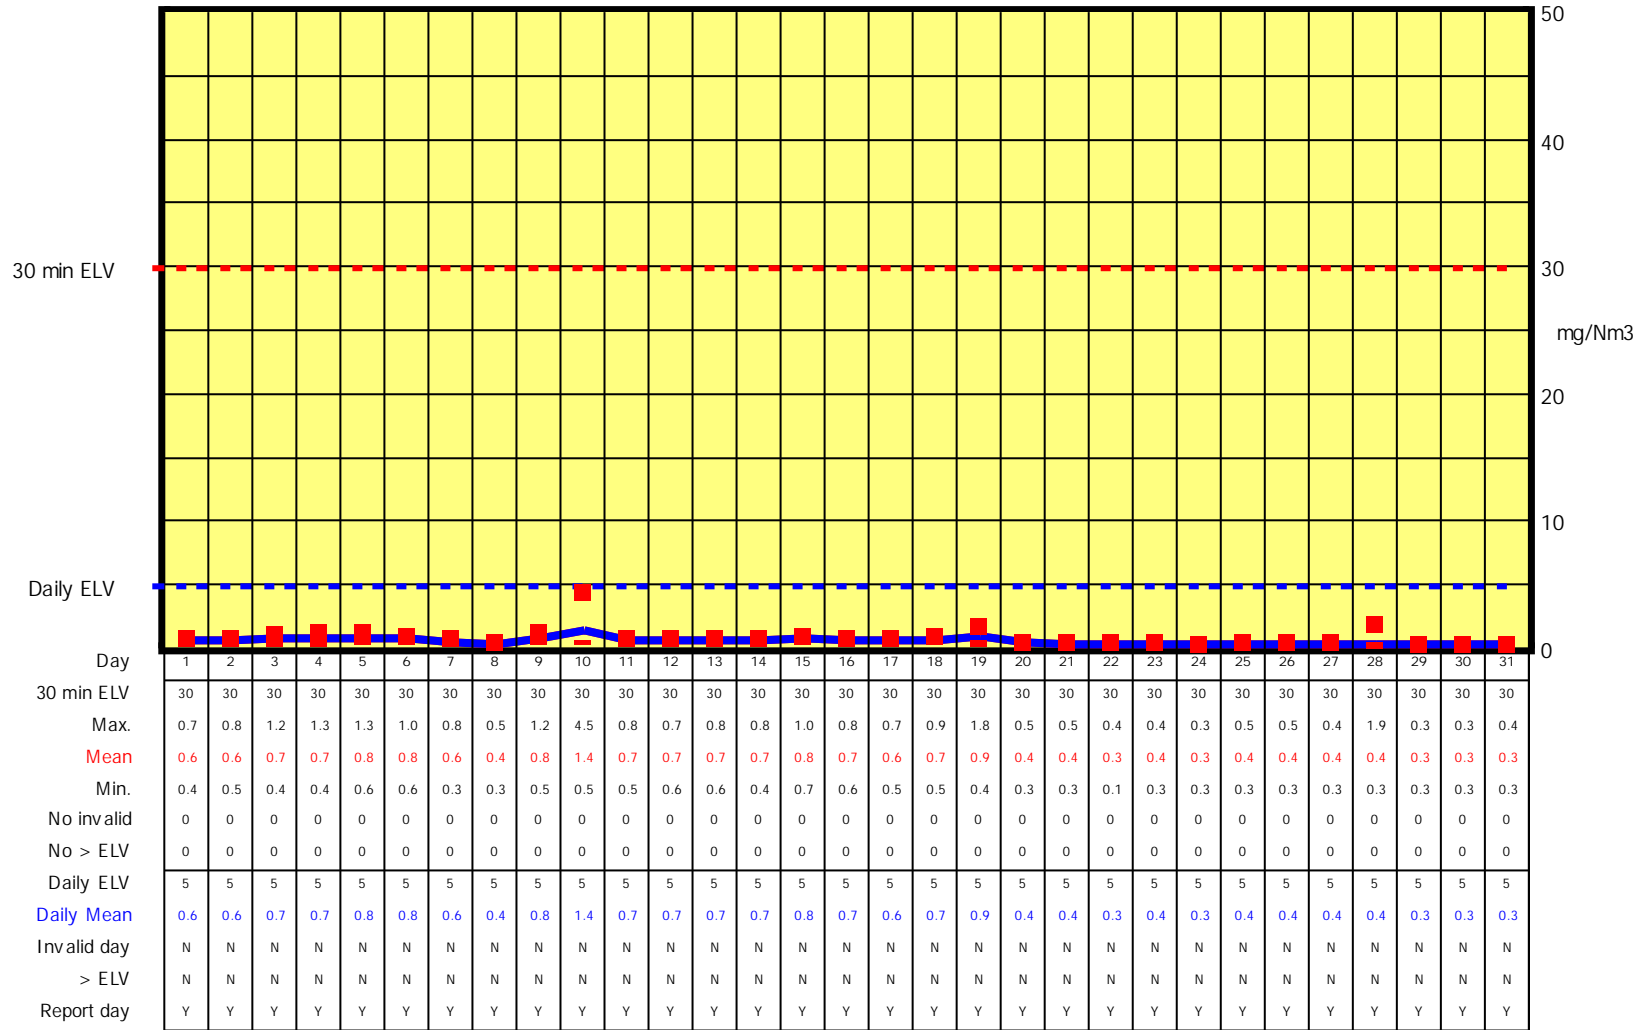

Month summary	
<b>30 min ELV</b>	
Monthly max.	4.5
Monthly mean	0.6
Monthly min.	0.1
Total invalid	0
Sum > ELV	0
<b>Daily ELV</b>	
Monthly max	1.4
No. invalid days	0
No. > ELV	0
No. report days	31

Data is as processed without repairs.

Signature \_\_\_\_\_  
authorised to sign on behalf of the company

Date \_\_\_\_\_