


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A1 For the month of December 2025

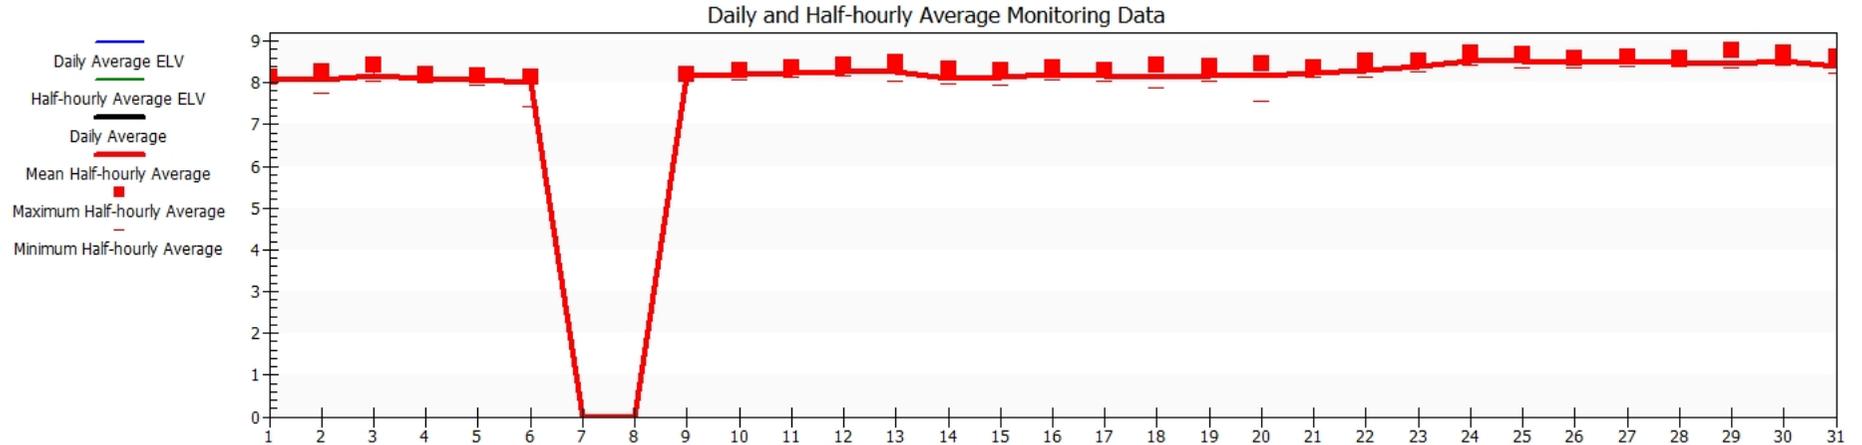

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	8.8	Maximum Half-hourly average	8.1	8.3	8.4	8.2	8.2	8.1	Off	Off	8.2	8.3	8.4	8.4	8.5	8.3	8.3	8.4	8.3	8.4	8.4	8.5	8.4	8.5	8.5	8.7	8.7	8.6	8.6	8.6	8.8	8.7	8.6
	Monthly mean	8.3	Mean Half-hourly average	8.1	8.1	8.2	8.1	8.1	8.0	Off	Off	8.2	8.2	8.2	8.3	8.3	8.1	8.1	8.2	8.2	8.1	8.2	8.2	8.2	8.3	8.4	8.5	8.5	8.5	8.5	8.5	8.5	8.5	8.4
	Monthly minimum	7.4	Minimum Half-hourly average	8.0	7.7	8.1	8.0	7.9	7.4	Off	Off	8.1	8.1	8.1	8.2	8.0	8.0	7.9	8.1	8.0	7.9	8.0	7.6	8.1	8.1	8.3	8.4	8.4	8.4	8.4	8.4	8.4	8.2	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A																						
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	8.5	Daily average	8.1	8.1	8.2	8.1	8.1	8.0	Off	Off	8.2	8.2	8.2	8.3	8.3	8.1	8.1	8.2	8.2	8.1	8.2	8.2	8.2	8.3	8.4	8.5	8.5	8.5	8.5	8.5	8.5	8.4	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for Dry Oxygen % at Emission Point A1 For the month of December 2025

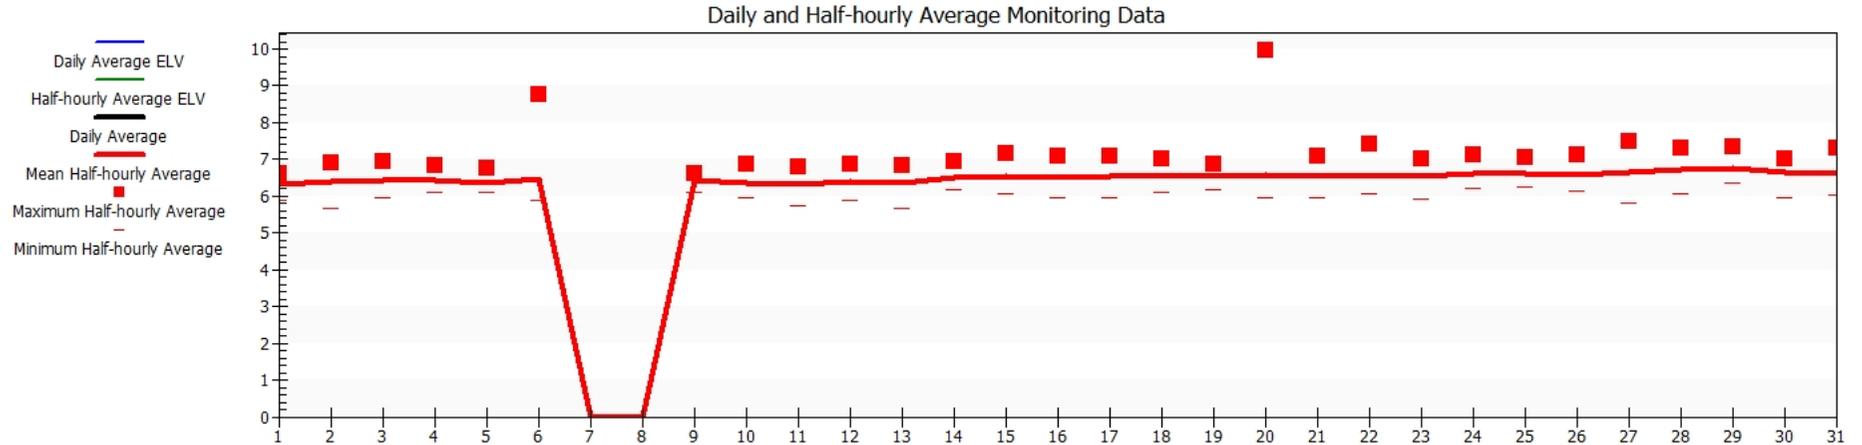

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	10.0	Maximum Half-hourly average	6.6	6.9	7.0	6.8	6.8	8.8	Off	Off	6.6	6.9	6.8	6.9	6.8	7.0	7.2	7.1	7.1	7.0	6.9	10.0	7.1	7.4	7.0	7.1	7.0	7.1	7.5	7.3	7.4	7.0	7.3	
	Monthly mean	6.5	Mean Half-hourly average	6.3	6.4	6.4	6.4	6.4	6.5	Off	Off	6.4	6.4	6.3	6.4	6.4	6.5	6.5	6.5	6.5	6.5	6.5	6.6	6.5	6.5	6.5	6.6	6.6	6.6	6.6	6.7	6.8	6.7	6.6	
	Monthly minimum	5.7	Minimum Half-hourly average	5.9	5.7	5.9	6.1	6.1	5.9	Off	Off	6.1	6.0	5.7	5.9	5.7	6.2	6.1	6.0	6.0	6.1	6.2	6.0	6.0	6.1	5.9	6.2	6.3	6.1	5.8	6.1	6.4	5.9	6.0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A											
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	6.8	Daily average	6.3	6.4	6.4	6.4	6.4	6.5	Off	Off	6.4	6.4	6.3	6.4	6.4	6.5	6.5	6.5	6.5	6.5	6.5	6.6	6.5	6.5	6.5	6.6	6.6	6.6	6.6	6.7	6.8	6.7	6.6	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for Moisture % at Emission Point A1 For the month of December 2025

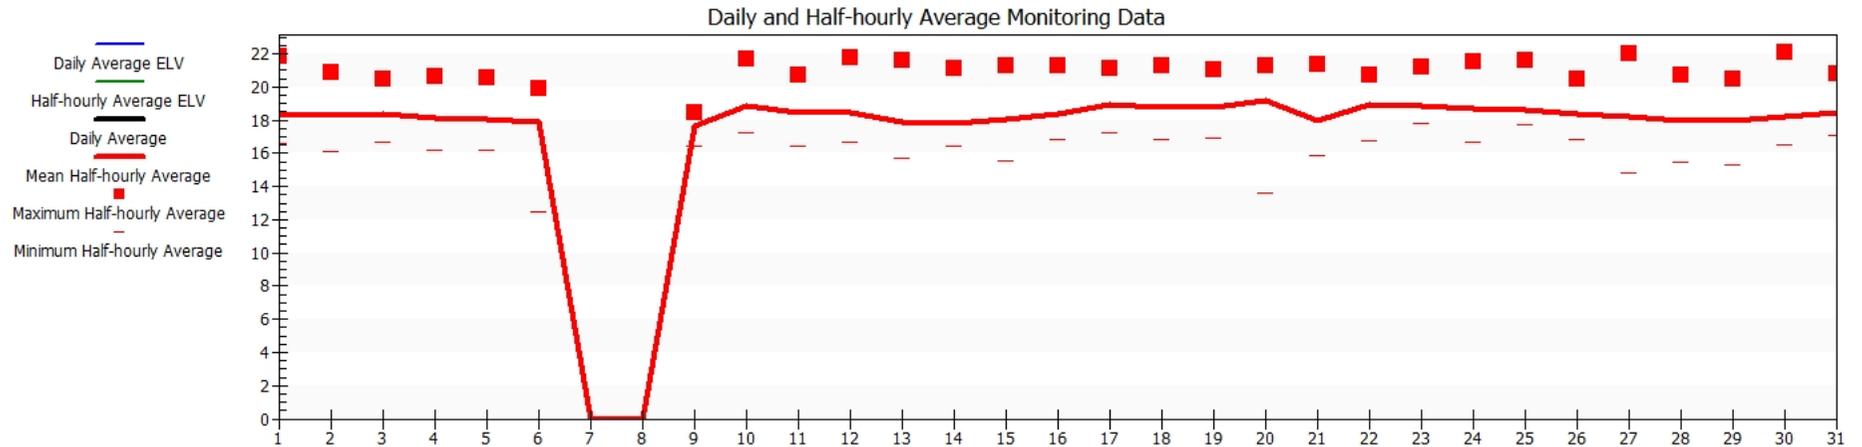

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	22.1	Maximum Half-hourly average	21.8	20.8	20.5	20.6	20.5	19.9	Off	Off	18.5	21.7	20.7	21.8	21.6	21.1	21.3	21.3	21.1	21.2	21.0	21.3	21.4	20.7	21.2	21.5	21.6	20.4	22.0	20.7	20.5	22.1	20.8	
	Monthly mean	18.4	Mean Half-hourly average	18.4	18.3	18.4	18.2	18.1	17.9	Off	Off	17.7	18.8	18.5	18.5	17.9	17.8	18.0	18.3	18.9	18.7	18.8	19.1	18.0	18.9	18.8	18.7	18.6	18.3	18.2	17.9	18.0	18.2	18.5	
	Monthly minimum	12.5	Minimum Half-hourly average	16.6	16.1	16.7	16.2	16.2	12.5	Off	Off	16.4	17.2	16.4	16.7	15.7	16.4	15.5	16.8	17.2	16.9	16.9	13.6	15.8	16.8	17.8	16.7	17.7	16.8	14.8	15.5	15.3	16.5	17.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A																						
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	19.1	Daily average	18.4	18.3	18.4	18.2	18.1	17.9	Off	Off	17.7	18.8	18.5	18.5	17.9	17.8	18.0	18.3	18.9	18.7	18.8	19.1	18.0	18.9	18.8	18.7	18.6	18.3	18.2	17.9	18.0	18.2	18.5	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCl mg/Nm3 at Emission Point A1 For the month of December 2025

Daily and Half-hourly Average Monitoring Data

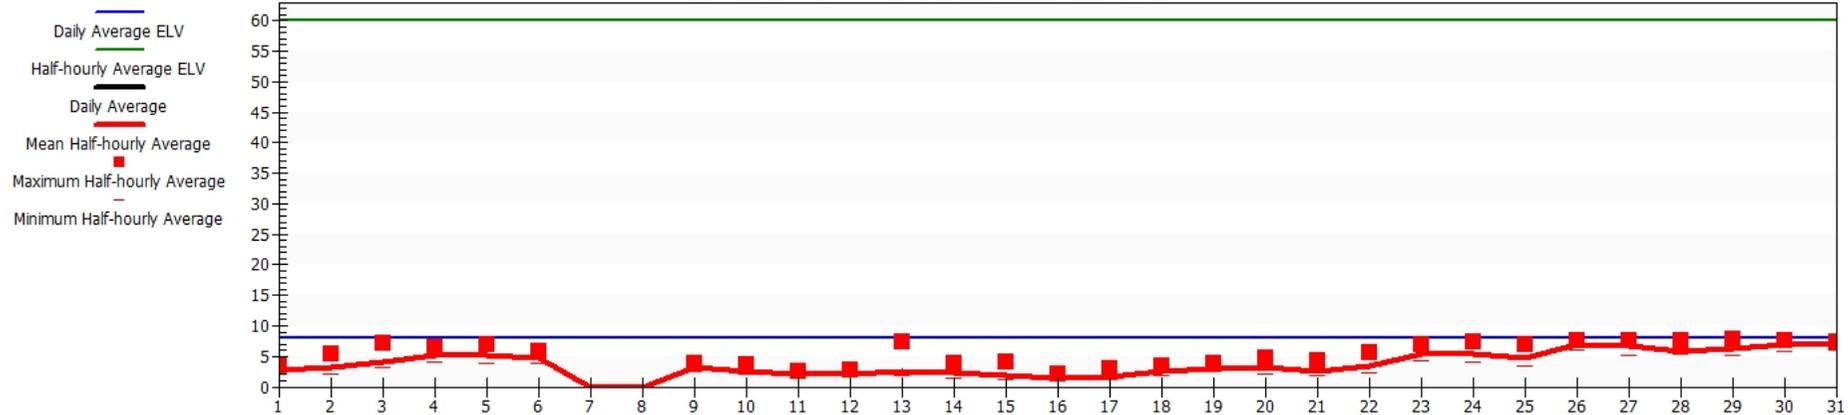

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0		
	Monthly maximum	7.7	Maximum Half-hourly average	3.7	5.5	7.1	6.5	6.9	5.8	Off	Off	3.7	3.7	2.6	2.8	7.4	3.9	4.1	2.2	3.1	3.3	3.8	4.7	4.3	5.7	6.8	7.3	6.8	7.6	7.6	7.5	7.7	7.6	7.2	
	Monthly mean	3.9	Mean Half-hourly average	2.8	3.1	4.0	5.1	5.2	4.7	Off	Off	3.3	2.5	2.0	2.1	2.6	2.4	1.9	1.3	1.6	2.5	3.0	3.1	2.6	3.4	5.4	5.4	4.6	6.9	6.6	5.9	6.3	6.8	6.8	
	Monthly minimum	1.2	Minimum Half-hourly average	2.3	2.0	3.1	4.0	3.9	3.8	Off	Off	2.6	2.0	1.7	1.7	1.9	1.4	1.2	1.2	1.2	1.8	2.5	2.1	1.9	2.4	4.3	4.1	3.4	6.0	5.1	5.3	5.2	5.8	6.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	
	Monthly maximum	6.9	Daily average	2.8	3.1	4.0	5.1	5.2	4.7	Off	Off	3.3	2.5	2.0	2.1	2.6	2.4	1.9	1.3	1.6	2.5	3.0	3.1	2.6	3.4	5.4	5.4	4.6	6.9	6.6	5.9	6.3	6.8	6.8	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO2 mg/Nm3 at Emission Point A1 For the month of December 2025

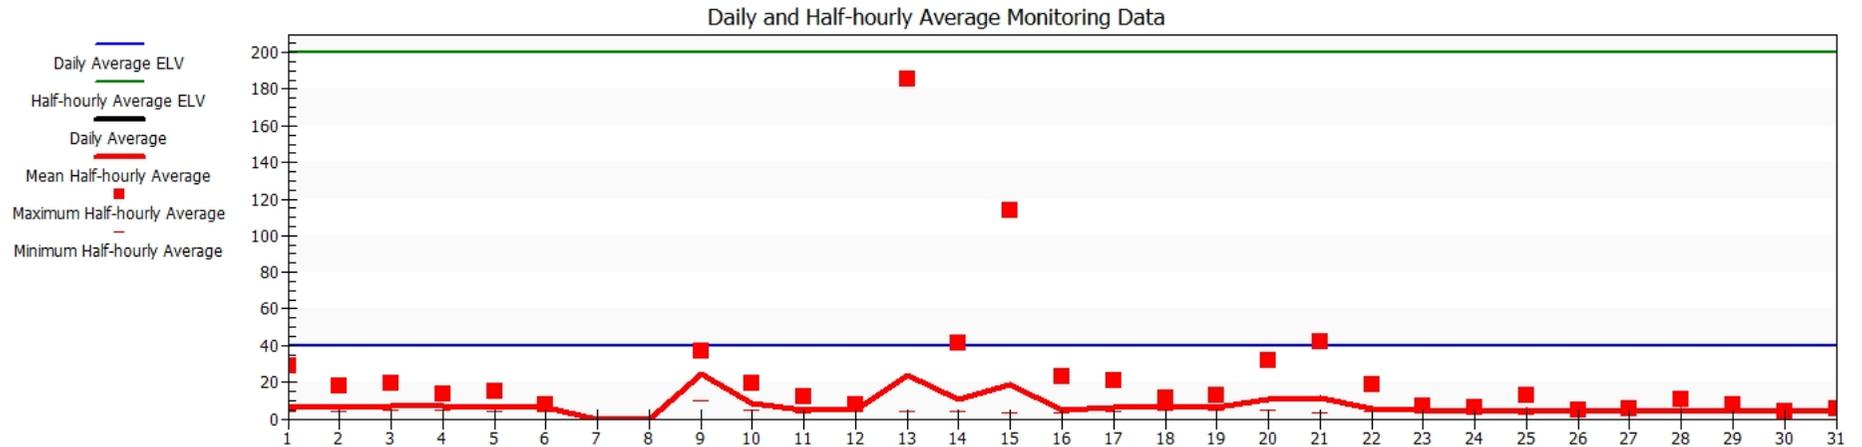

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200		
	Monthly maximum	186	Maximum Half-hourly average	29	18	20	13	15	8	Off	Off	37	19	12	8	186	41	114	23	21	11	13	32	42	19	7	6	13	5	5	11	7	4	6	
	Monthly mean	8	Mean Half-hourly average	7	6	7	7	6	6	Off	Off	24	8	5	5	24	10	19	5	6	6	6	10	11	5	5	4	4	4	4	5	4	4	4	
	Monthly minimum	3	Minimum Half-hourly average	4	4	5	5	4	4	Off	Off	10	5	4	4	4	4	4	3	4	4	5	5	3	4	4	3	3	3	3	3	4	3	3	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40		
	Monthly maximum	24	Daily average	7	6	7	7	6	6	Off	Off	24	8	5	5	24	10	19	5	6	6	6	10	11	5	5	4	4	4	4	5	4	4	4	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for NOx mg/Nm3 at Emission Point A1 For the month of December 2025

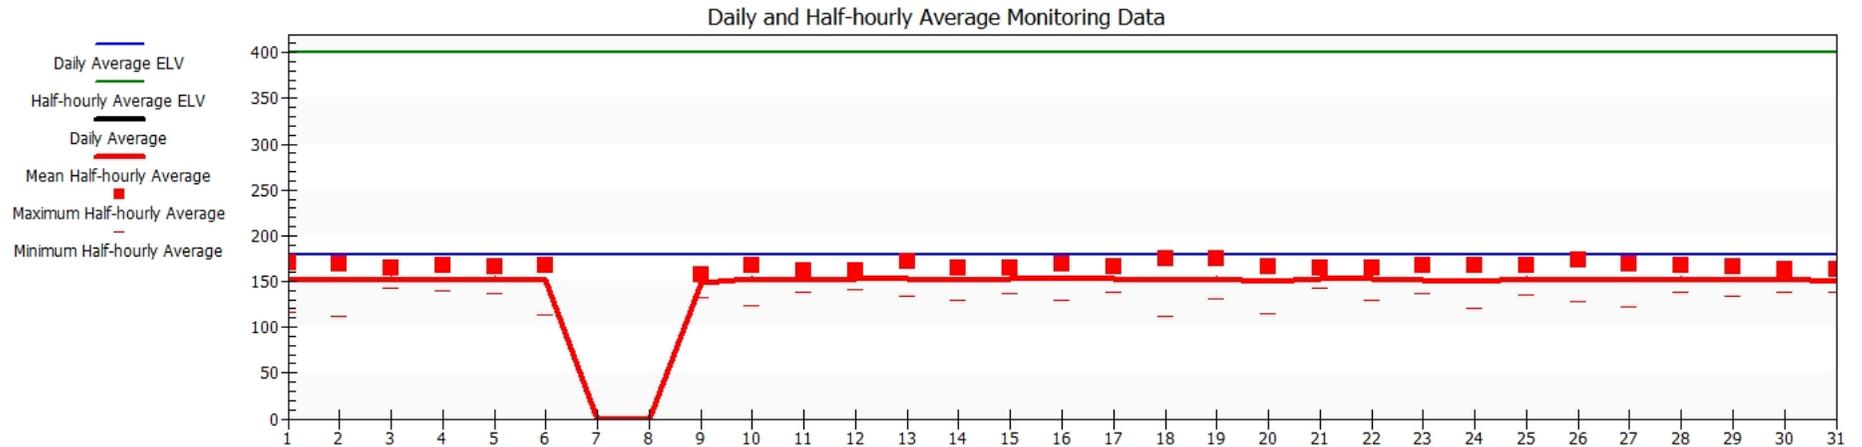

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400		
	Monthly maximum	174	Maximum Half-hourly average	171	170	165	167	166	168	Off	Off	157	168	162	162	171	165	165	169	166	174	174	166	165	165	167	167	167	173	168	168	166	162	163	
	Monthly mean	152	Mean Half-hourly average	151	152	153	152	153	151	Off	Off	148	153	152	152	152	151	153	153	153	151	153	150	153	152	152	150	153	152	151	153	151	153	151	
	Monthly minimum	112	Minimum Half-hourly average	116	112	143	140	136	114	Off	Off	132	123	138	142	133	129	137	129	138	113	132	116	142	130	137	121	135	128	122	139	135	138	138	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180		
	Monthly maximum	153	Daily average	151	152	153	152	153	151	Off	Off	148	153	152	152	152	151	153	153	153	151	153	150	153	152	152	150	153	152	151	153	151	153	151	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC mg/Nm3 at Emission Point A1 For the month of December 2025

Daily and Half-hourly Average Monitoring Data

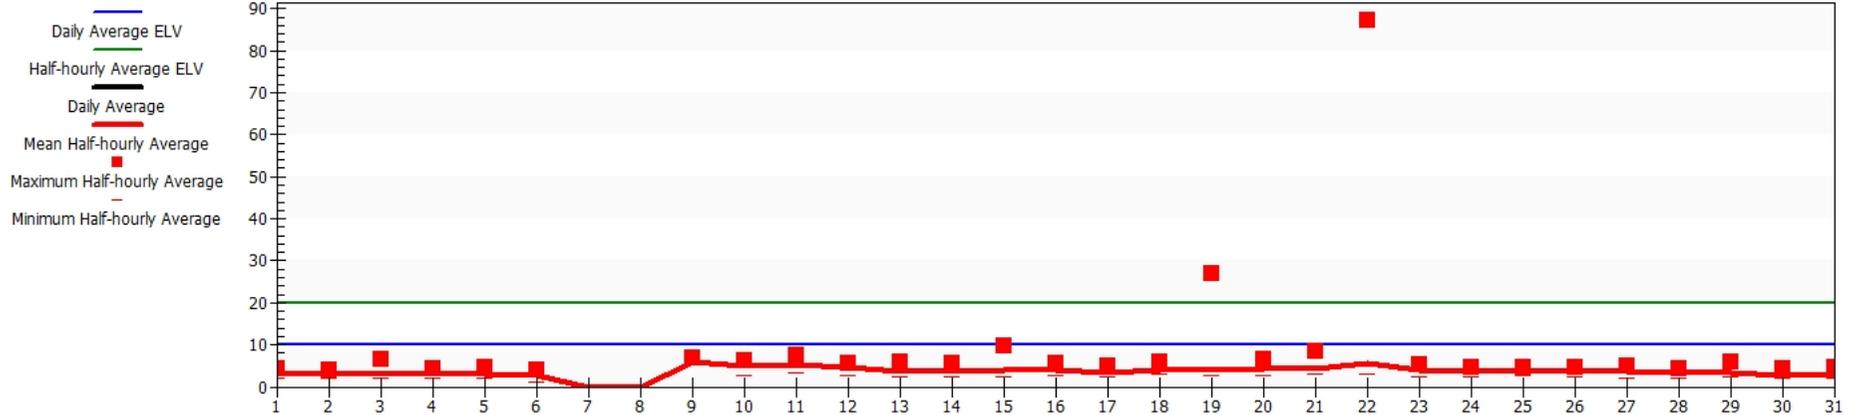

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0		
	Monthly maximum	87.2	Maximum Half-hourly average	4.3	4.0	6.5	4.2	4.8	3.9	Off	Off	6.9	6.3	7.5	5.6	6.0	5.4	9.7	5.6	4.9	5.8	27.1	6.4	8.5	87.2	5.3	4.6	4.6	4.7	4.8	4.3	5.9	4.1	4.5	
	Monthly mean	3.8	Mean Half-hourly average	3.0	3.0	3.1	3.2	3.0	2.7	Off	Off	5.9	4.9	5.4	4.5	3.8	3.6	3.9	4.0	3.5	3.9	4.1	4.4	4.3	5.7	3.9	3.8	3.7	3.6	3.6	3.2	3.2	2.8	2.6	
	Monthly minimum	1.2	Minimum Half-hourly average	2.0	2.0	2.0	2.1	1.9	1.2	Off	Off	5.2	2.7	3.4	2.8	2.3	2.5	2.2	2.8	2.5	2.9	2.7	2.8	3.1	3.1	2.5	2.3	2.9	2.5	2.2	2.0	2.4	2.0	2.0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	2	No of exceedances of ELV	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	1	0	0	0	0	0	0	0	
Daily average		Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0		
	Monthly maximum	5.9	Daily average	3.0	3.0	3.1	3.2	3.0	2.7	Off	Off	5.9	4.9	5.4	4.5	3.8	3.6	3.9	4.0	3.5	3.9	4.1	4.4	4.3	5.7	3.9	3.8	3.7	3.6	3.6	3.2	3.2	2.8	2.6	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH3 mg/Nm3 at Emission Point A1 For the month of December 2025

Daily and Half-hourly Average Monitoring Data

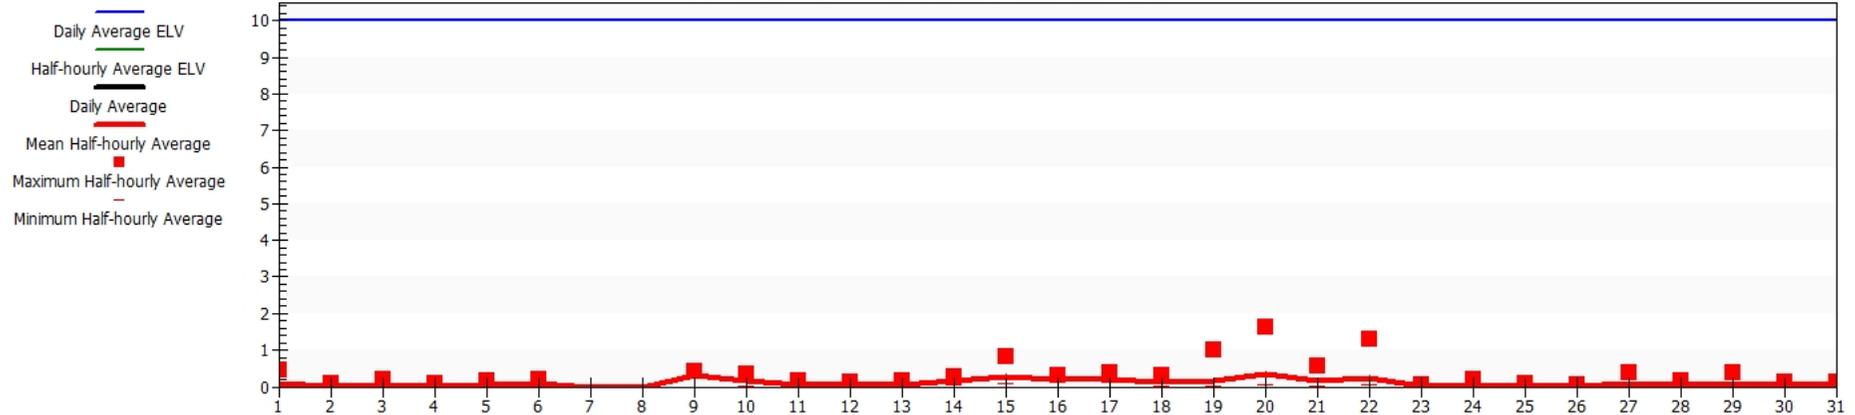

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	1.6	Maximum Half-hourly average	0.5	0.1	0.2	0.1	0.2	0.2	Off	Off	0.4	0.4	0.1	0.1	0.2	0.3	0.8	0.3	0.4	0.3	1.0	1.6	0.6	1.3	0.1	0.2	0.1	0.0	0.4	0.2	0.4	0.1	0.1	
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.0	0.0	0.0	0.1	0.1	Off	Off	0.3	0.2	0.1	0.0	0.1	0.2	0.3	0.2	0.2	0.1	0.2	0.3	0.2	0.2	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	
	Monthly minimum	0.0	Minimum Half-hourly average	0.0	0.0	0.0	0.0	0.0	0.1	Off	Off	0.2	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A																						
Daily average		Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	0.3	Daily average	0.1	0.0	0.0	0.0	0.1	0.1	Off	Off	0.3	0.2	0.1	0.0	0.1	0.2	0.3	0.2	0.2	0.1	0.2	0.3	0.2	0.2	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 1 (A1)

Reporting of Continuously Monitored Emissions to Air for Particulates mg/Nm3 at Emission Point A1 For the month of December 2025

Daily and Half-hourly Average Monitoring Data

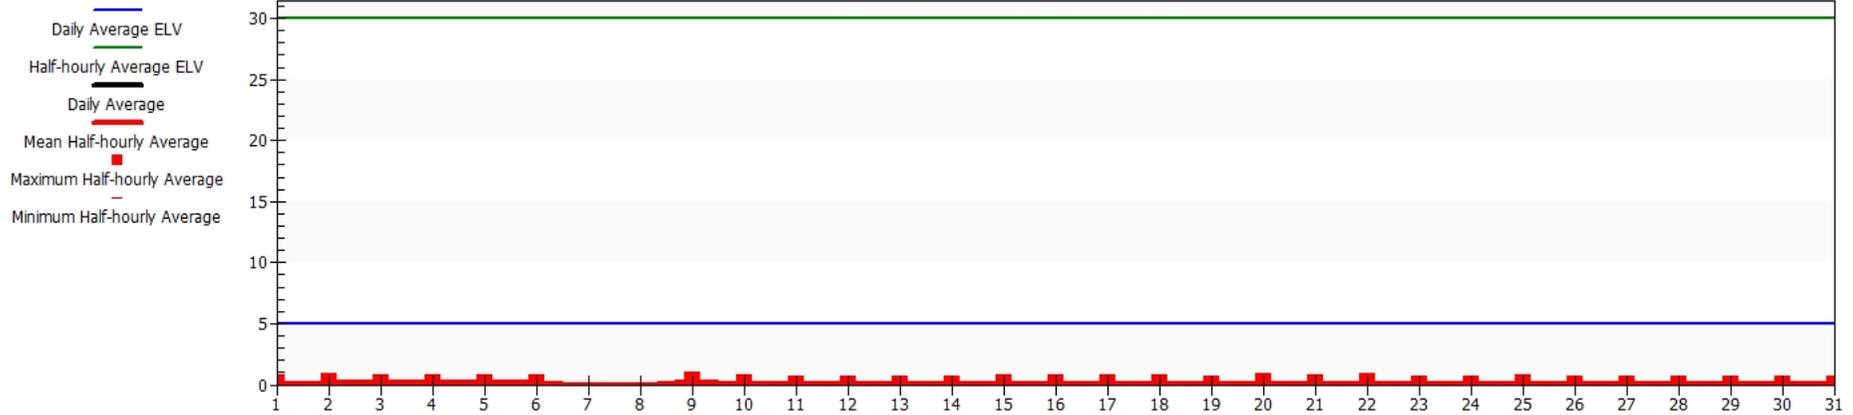

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average		Half-hourly average ELV	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	
	Monthly maximum	0.4	Maximum Half-hourly average	0.2	0.2	0.2	0.2	0.2	0.2	Off	Off	0.4	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.3	0.1	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.2	0.2	0.2	0.2	0.1	Off	Off	0.3	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	Monthly minimum	0.0	Minimum Half-hourly average	0.0	0.1	0.1	0.1	0.1	0.1	Off	Off	0.2	0.1	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	Off	Off	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily average		Daily average ELV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	
	Monthly maximum	0.3	Daily average	0.1	0.2	0.2	0.2	0.2	0.1	Off	Off	0.3	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446


Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O mg/Nm3 at Emission Point A1 For the month of December 2025

Daily and Half-hourly Average Monitoring Data

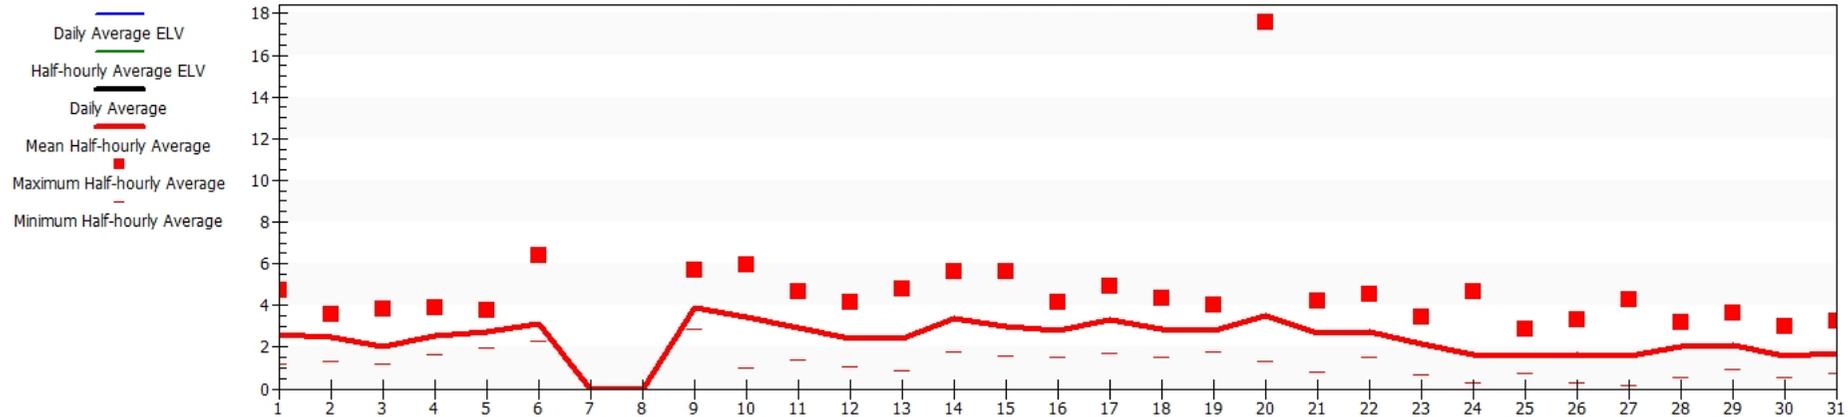


Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
Half-hourly average		Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	17.6	Maximum Half-hourly average	4.7	3.6	3.8	3.9	3.7	6.4	Off	Off	5.7	5.9	4.7	4.1	4.8	5.7	5.6	4.1	4.9	4.3	4.0	17.6	4.2	4.5	3.4	4.6	2.8	3.3	4.3	3.2	3.7	3.0	3.2	
	Monthly mean	2.5	Mean Half-hourly average	2.6	2.5	2.0	2.5	2.7	3.1	Off	Off	3.9	3.5	2.9	2.4	2.4	3.3	3.0	2.8	3.3	2.9	2.8	3.5	2.7	2.7	2.2	1.6	1.6	1.6	1.6	2.0	2.1	1.6	1.7	
	Monthly minimum	0.2	Minimum Half-hourly average	1.2	1.3	1.2	1.7	2.0	2.3	Off	Off	2.8	1.0	1.4	1.0	0.9	1.8	1.6	1.5	1.7	1.5	1.8	1.3	0.8	1.5	0.7	0.3	0.7	0.3	0.2	0.6	0.9	0.6	0.7	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A											
Daily average		Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
	Monthly maximum	3.9	Daily average	2.6	2.5	2.0	2.5	2.7	3.1	Off	Off	3.9	3.5	2.9	2.4	2.4	3.3	3.0	2.8	3.3	2.9	2.8	3.5	2.7	2.7	2.2	1.6	1.6	1.6	1.6	2.0	2.1	1.6	1.7	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Reporting of Continuously Monitored Emissions to Air for CO mg/Nm3 at Emission Point A1 For the month of December 2025

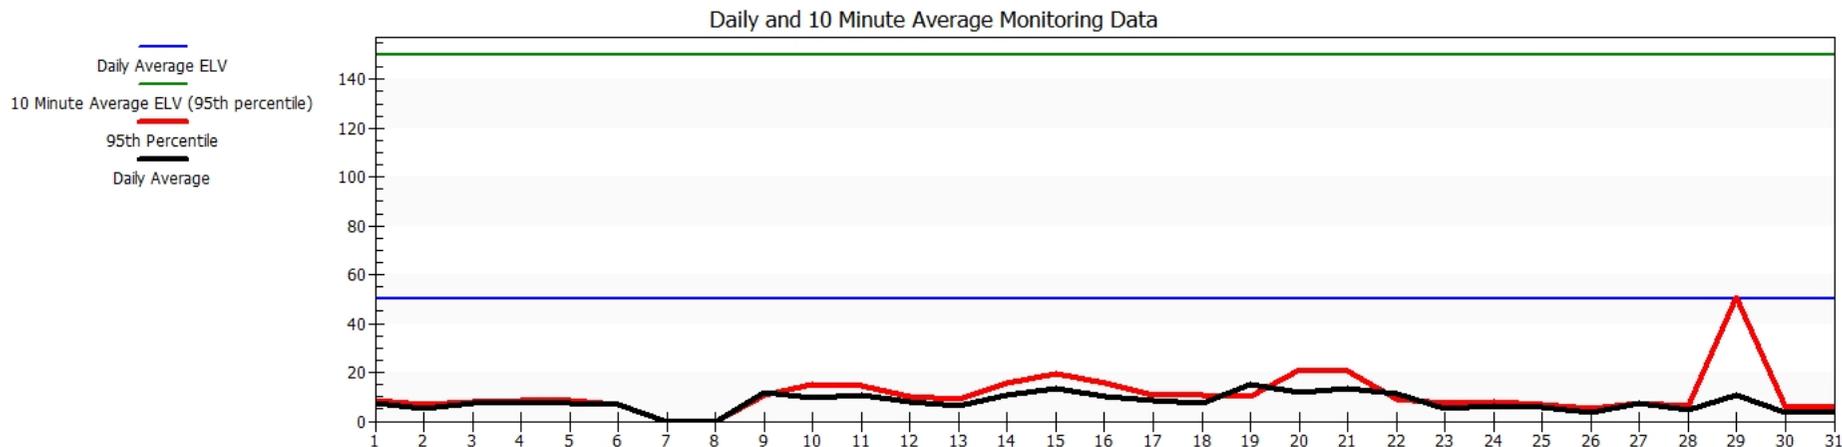

Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31		
10 Minute average		10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150		
	Monthly Maximum 10-min	1164	Maximum 10 Minute average	350	65	352	138	170	170	Off	Off	28	46	105	102	79	424	677	317	179	43	1164	235	324	790	26	109	263	39	186	137	277	16	10	
	Monthly mean 10-min avgs	8	95th Percentile	9	7	8	8	9	7	Off	Off	11	15	15	10	9	16	20	15	11	11	10	21	21	9	8	8	7	5	8	6	51	6	6	
	Monthly Minimum 10-min	0	Minimum 10 Minute average	2	2	2	2	3	0	Off	Off	7	2	4	3	2	2	1	3	2	3	4	3	3	3	2	1	1	2	1	1	2	1	2	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
			Number of results above 150mg/m³	1	0	1	0	1	1	Off	Off	0	0	0	0	0	0	2	2	1	2	0	1	2	3	1	0	0	1	0	2	0	1	0	0
		Sum of Exceedances of 95th percentile ELV	0																																
Daily average		Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
	Monthly maximum	15	Daily average	7	5	7	7	8	7	Off	Off	12	10	11	8	6	11	14	10	8	7	15	12	13	11	5	6	6	4	7	5	11	4	4	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV? (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Environment Agency explanatory note: The 10-minute average ELV is based on the "95th percentile" In this case this means that 95% of the 10 minute averages in the calendar day (= 137) must be below 150 mg/m3, and 5% (= 7) are allowed to be any value above 150 mg/m3. Whilst we expect operators to minimise CO emissions at all times, it is perfectly acceptable for the value of the maximum 10-minute average to be above 150 mg/m3, provided the 95th percentile ELV has been met for that period