Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 6 (A1)

mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05


Reporting of Continuously Monitored Emissions to Air for NO_x, Emission Point Report for Aug, 2026

Key

- Daily average ELV
- 30 min. average ELV
- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 127.2

No. of valid averages = 1488

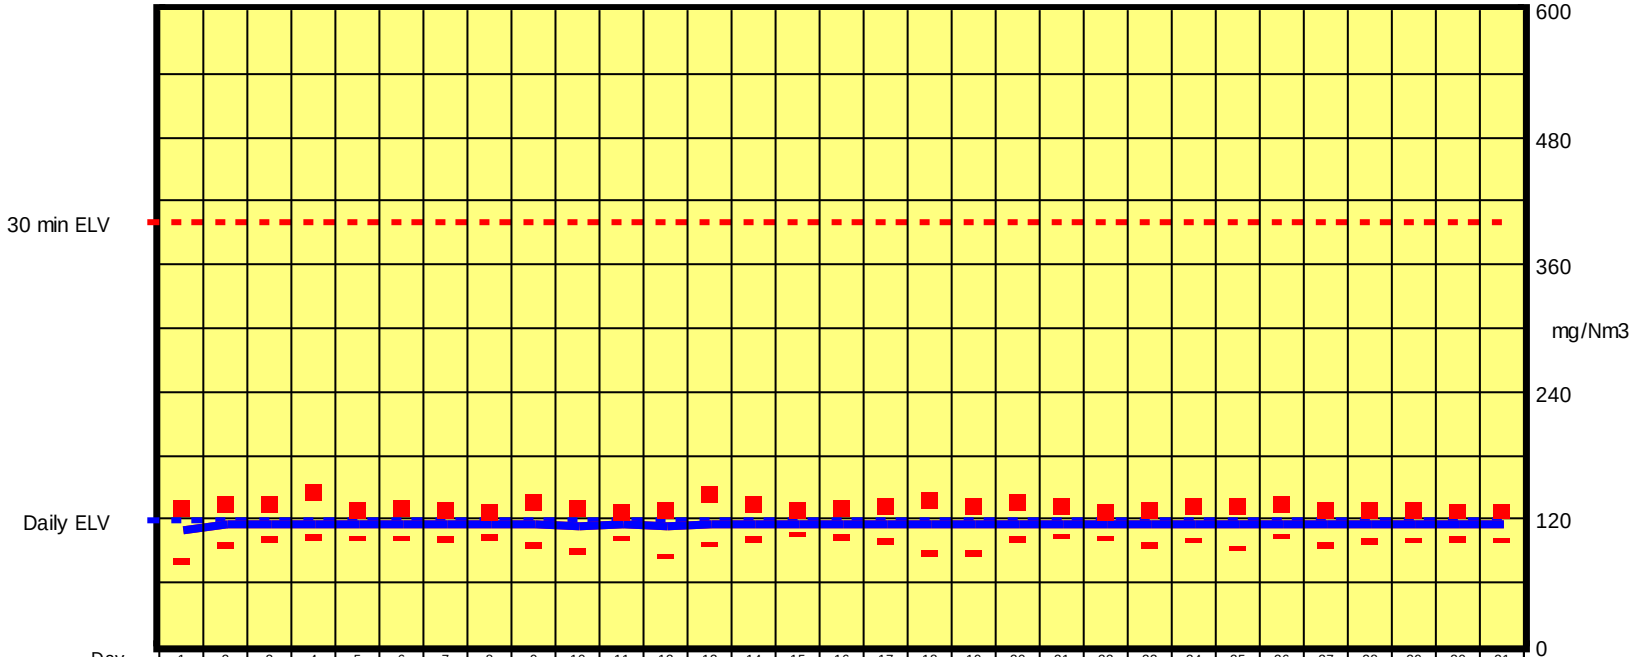

Month summary	
30 min ELV	
Monthly max.	145.9
Monthly mean	114.7
Monthly min.	79.6
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	115.8
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
Max.	130.5	133.4	133.8	145.9	127.7	129.4	127.5	126.8	136.4	129.8	125.8	128.2	142.6	133.4	127.5	130.0	131.5	137.6	131.4	135.1	131.9	126.3	128.4	131.9	131.4	133.1	128.6	128.2	127.7	127.4	127.4
Mean	109.8	114.4	114.6	115.4	114.9	114.5	115.1	114.8	114.9	114.0	115.3	113.5	115.8	114.7	114.7	114.8	115.3	114.4	115.5	114.4	115.0	114.8	114.8	114.6	115.3	114.6	114.9	114.7	114.9	114.7	115.1
Min.	79.6	95.2	100.4	102.4	102.1	101.6	100.6	102.4	95.2	89.9	101.6	85.2	95.9	100.9	105.6	103.0	98.6	88.2	87.7	100.4	104.1	101.7	95.4	100.2	92.6	103.6	94.9	99.5	100.1	101.4	99.7
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120
Daily Mean	109.8	114.4	114.6	115.4	114.9	114.5	115.1	114.8	114.9	114.0	115.3	113.5	115.8	114.7	114.7	114.8	115.3	114.4	115.5	114.4	115.0	114.8	114.8	114.6	115.3	114.6	114.9	114.7	114.9	114.7	115.1
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy


Form No: Air 4 (A1)

Reporting of Continuously Monitored Emissions to Air for CO, Emission Point Report for Aug, 2026

mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Daily average ELV
- 95%ile ELV
- 95%ile 10 min average
- Max. 10 min average
- Min. 10min average
- Daily mean

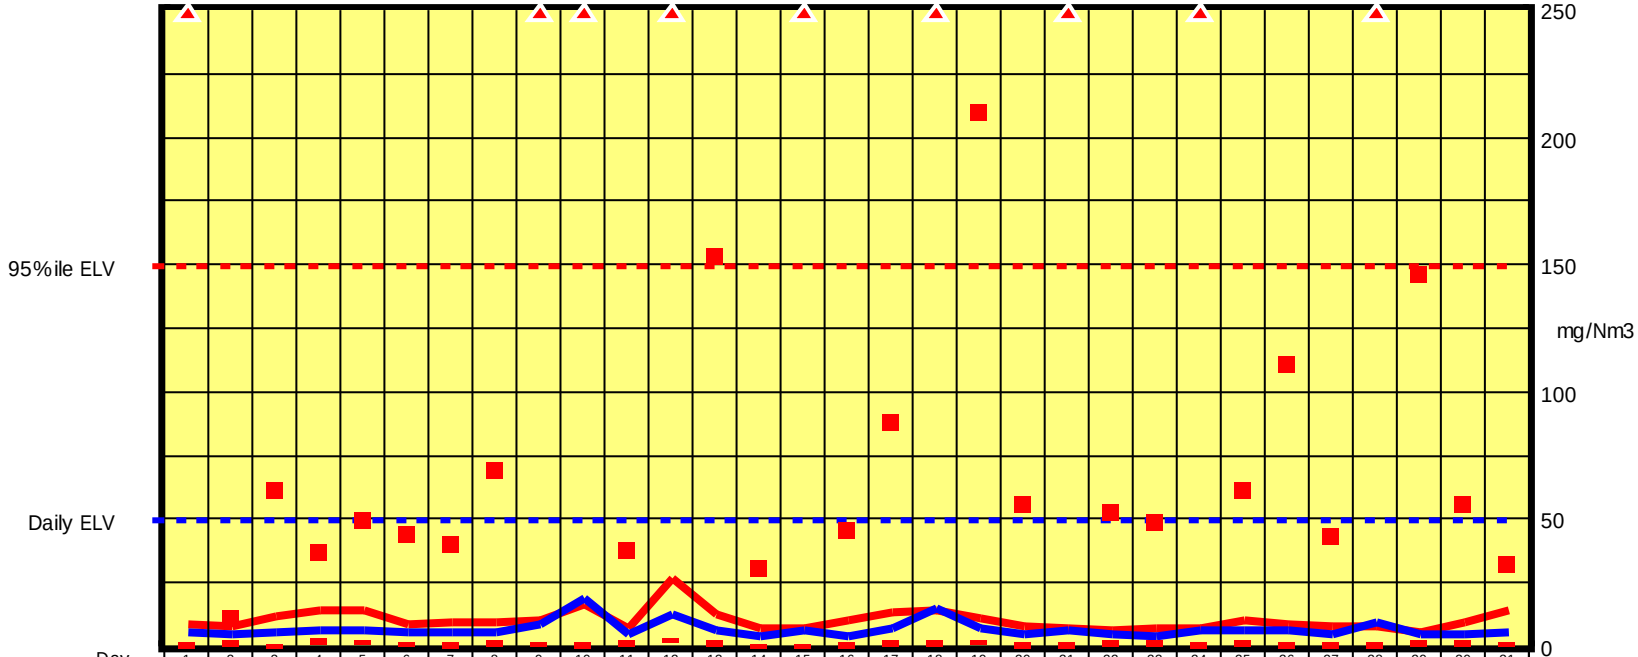

Month summary	
10 minute data	
Monthly max.	1153.3
Monthly mean	6.6
Monthly min.	0.0
Total invalid	0
Sum > ELV	14
Total %ile exceed.	0
Daily ELV	
Monthly max	18.5
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
95%ile 10 min ELV	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
Max.	264.5	11.2	61.4	36.6	49.6	44.4	40.1	69.0	561.1	1151.1	37.4	626.3	153.5	30.8	332.2	45.5	88.2	1153.3	210.0	55.7	282.2	52.5	48.9	376.9	61.6	111.0	42.9	560.4	146.4	55.9	32.2
10 min 95%ile	8.6	7.5	12.2	14.4	14.5	8.9	9.8	9.1	9.9	16.4	7.3	26.7	12.2	7.0	7.4	9.9	13.1	14.1	11.0	8.1	7.3	6.6	7.1	6.7	10.3	9.0	7.9	8.1	5.5	9.8	14.4
Min.	0.3	0.9	0.1	1.9	1.5	0.7	0.3	1.2	0.8	0.6	1.3	2.5	1.0	0.0	0.1	0.5	1.3	1.3	1.7	0.6	0.2	1.3	0.9	0.2	1.2	0.6	0.5	0.6	1.2	0.9	0.9
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	1	0	0	0	0	0	0	0	1	4	0	1	1	0	1	0	0	1	1	0	1	0	0	1	0	0	0	1	0	0	0
ELV exceeded?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Daily ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
Daily Mean	5.8	4.3	5.3	6.0	5.9	5.3	5.2	5.5	8.3	18.5	4.8	12.6	6.5	4.1	6.0	3.7	7.2	14.9	7.4	4.6	6.4	4.6	3.9	6.3	6.1	6.1	4.9	9.1	4.6	4.9	5.6
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO_2, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Daily average ELV
- 30 min. average ELV
- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 5.6

No. of valid averages = 1488

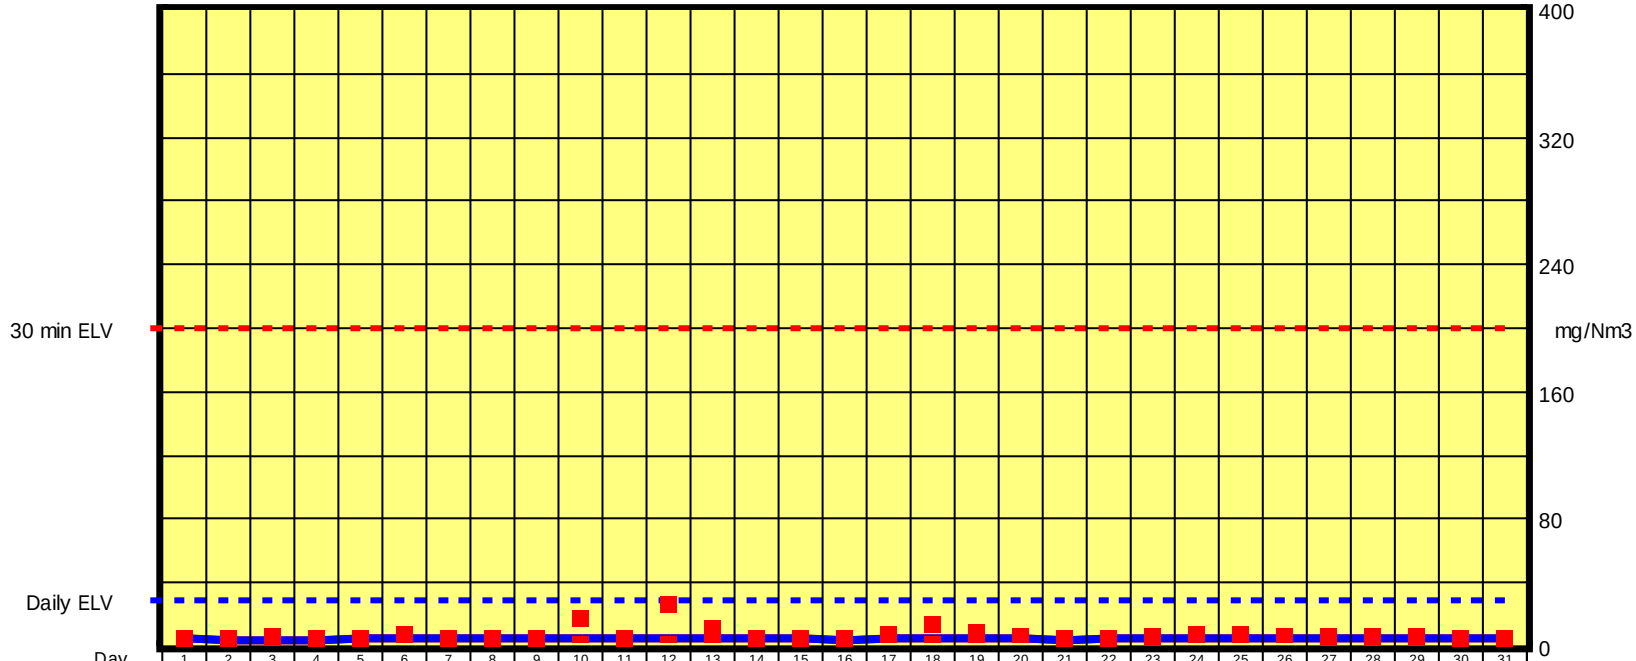

Month summary	
30 min ELV	
Monthly max.	26.1
Monthly mean	4.6
Monthly min.	3.7
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	5.5
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
Max.	5.4	5.2	5.8	5.6	5.3	7.1	5.6	5.4	5.5	17.2	5.6	26.1	11.9	5.4	5.4	5.2	7.1	13.3	8.3	6.9	5.0	5.5	6.3	7.1	7.6	6.9	6.8	6.2	6.0	5.6	5.5
Mean	4.5	4.3	4.1	4.3	4.6	4.4	4.5	4.6	4.6	4.7	4.5	5.5	4.9	4.4	4.5	4.4	4.6	4.7	4.7	4.4	4.3	4.4	4.5	4.5	4.6	4.6	4.8	4.6	4.7	4.6	4.6
Min.	4.1	3.7	3.7	3.8	4.3	3.9	4.1	4.4	4.3	4.0	4.1	4.4	4.2	3.9	3.8	3.8	4.3	4.1	4.2	4.0	4.1	4.1	4.2	4.1	4.2	4.2	4.1	4.3	4.0	4.1	4.0
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
Daily Mean	4.5	4.3	4.1	4.3	4.6	4.4	4.5	4.6	4.6	4.7	4.5	5.5	4.9	4.4	4.5	4.4	4.6	4.7	4.7	4.4	4.3	4.4	4.5	4.5	4.6	4.6	4.8	4.6	4.7	4.6	4.6
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCL, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Daily average ELV
- 30 min. average ELV
- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 5.5

No. of valid averages = 1488

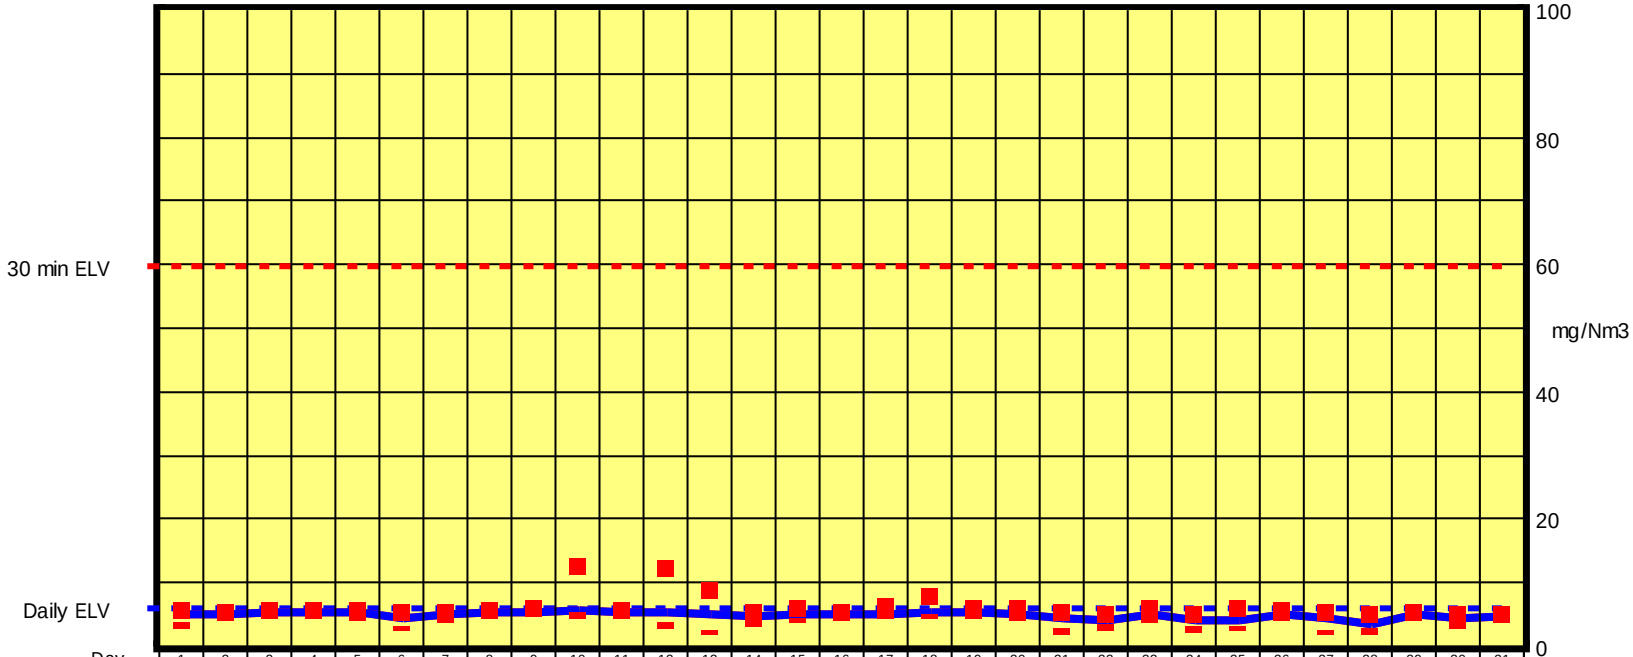

Month summary	
30 min ELV	
Monthly max.	12.7
Monthly mean	4.9
Monthly min.	2.2
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	5.5
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60	60
Max.	5.7	5.3	5.6	5.6	5.6	5.3	5.5	5.6	6.0	12.7	5.8	12.4	8.9	5.4	5.9	5.3	6.4	7.8	5.9	5.9	5.4	5.2	6.0	5.1	6.0	5.6	5.2	4.9	5.3	5.0	5.0
Mean	4.9	5.2	5.3	5.3	5.2	4.3	4.9	5.4	5.4	5.5	5.4	5.3	5.0	4.8	4.9	4.9	5.2	5.4	5.4	5.1	4.3	4.1	4.9	4.2	4.2	5.1	4.3	3.5	4.9	4.4	4.6
Min.	3.2	4.9	4.9	4.7	4.7	2.8	4.1	5.2	5.3	4.9	4.8	3.4	2.2	3.7	4.0	4.4	4.8	4.7	4.8	4.4	2.5	3.1	4.3	2.7	2.8	4.4	2.2	2.3	4.4	3.3	4.2
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6
Daily Mean	4.9	5.2	5.3	5.3	5.2	4.3	4.9	5.4	5.4	5.5	5.4	5.3	5.0	4.8	4.9	4.9	5.2	5.4	5.4	5.1	4.3	4.1	4.9	4.2	4.2	5.1	4.3	3.5	4.9	4.4	4.6
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH_3, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 0.9

No. of valid averages = 1488

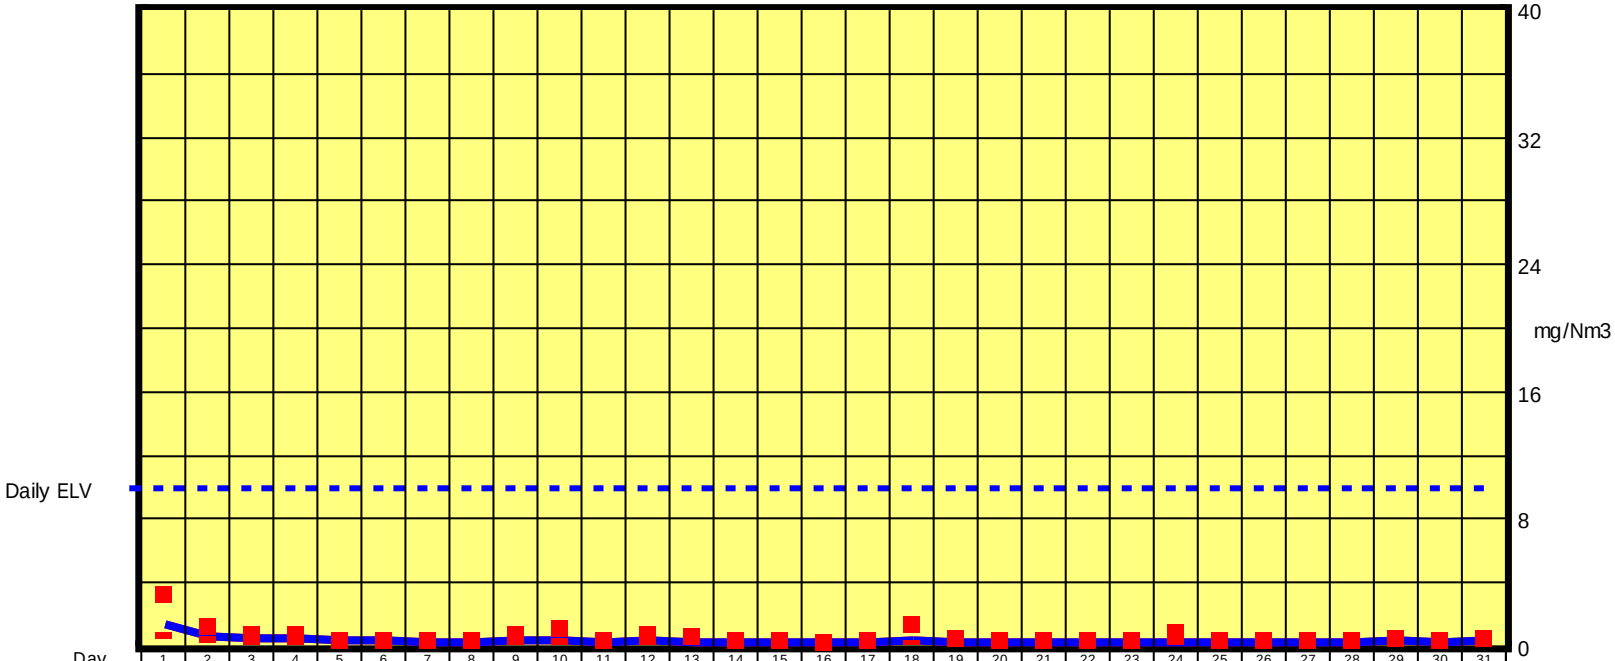

Month summary	
30 min ELV	
Monthly max.	3.2
Monthly mean	0.4
Monthly min.	0.3
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	1.4
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	3.2	1.3	0.7	0.8	0.4	0.4	0.4	0.4	0.7	1.1	0.4	0.7	0.7	0.4	0.4	0.3	0.3	1.4	0.5	0.3	0.3	0.4	0.4	0.9	0.4	0.4	0.4	0.4	0.5	0.4	0.5
Mean	1.4	0.7	0.5	0.5	0.3	0.3	0.3	0.3	0.4	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Min.	0.7	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
Daily Mean	1.4	0.7	0.5	0.5	0.3	0.3	0.3	0.3	0.4	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.4	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 2 (A1)

mCERTS THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME Certificate No:MC080130/05


Reporting of Continuously Monitored Emissions to Air for TOC, Emission Point Report for Aug, 2026

Key

- Daily average ELV
- 30 min. average ELV
- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 0.0

No. of valid averages = 1488

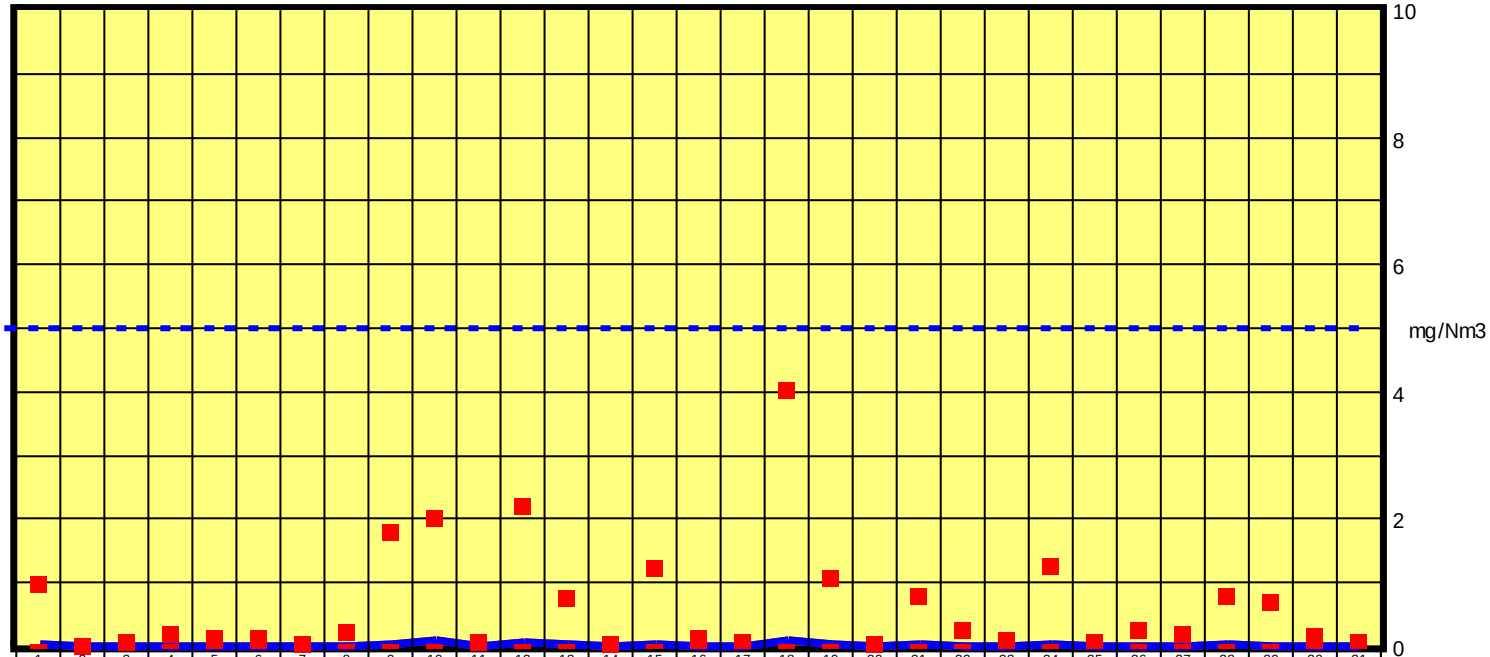

Month summary	
30 min ELV	
Monthly max.	4.0
Monthly mean	0.0
Monthly min.	0.0
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	0.1
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
Max.	1.0	0.0	0.1	0.2	0.1	0.1	0.0	0.2	1.8	2.0	0.1	2.2	0.8	0.0	1.2	0.1	0.1	4.0	1.1	0.0	0.8	0.2	0.1	1.3	0.1	0.2	0.2	0.8	0.7	0.2	0.1
Mean	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Min.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
Daily Mean	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 1.3

No. of valid averages = 1488

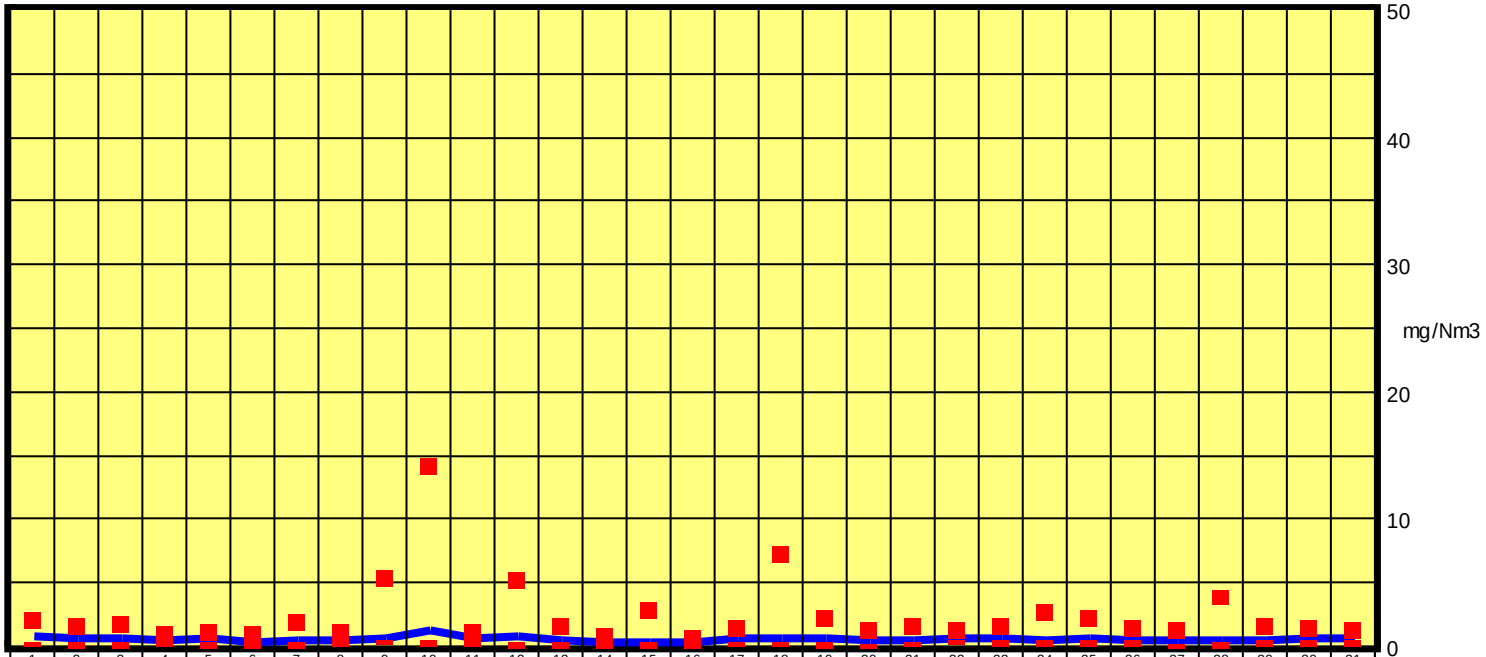

Month summary	
30 min ELV	
Monthly max.	14.1
Monthly mean	0.6
Monthly min.	0.0
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	1.2
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	2.0	1.5	1.7	0.9	1.1	0.9	1.9	1.1	5.4	14.1	1.1	5.2	1.5	0.8	2.8	0.7	1.4	7.3	2.2	1.3	1.6	1.3	1.5	2.6	2.2	1.4	1.3	3.9	1.5	1.4	1.3
Mean	0.8	0.6	0.7	0.5	0.6	0.4	0.5	0.5	0.7	1.2	0.6	0.7	0.5	0.3	0.4	0.3	0.6	0.7	0.6	0.4	0.4	0.6	0.6	0.5	0.6	0.5	0.5	0.5	0.5	0.6	0.7
Min.	0.2	0.1	0.1	0.2	0.1	0.1	0.1	0.3	0.3	0.2	0.2	0.0	0.1	0.0	0.1	0.0	0.2	0.2	0.1	0.0	0.1	0.3	0.2	0.2	0.2	0.2	0.0	0.1	0.2	0.2	0.2
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	0.8	0.6	0.7	0.5	0.6	0.4	0.5	0.5	0.7	1.2	0.6	0.7	0.5	0.3	0.4	0.3	0.6	0.7	0.6	0.4	0.4	0.6	0.6	0.5	0.6	0.5	0.5	0.5	0.5	0.6	0.7
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO_2, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 8.3

No. of valid averages = 1488

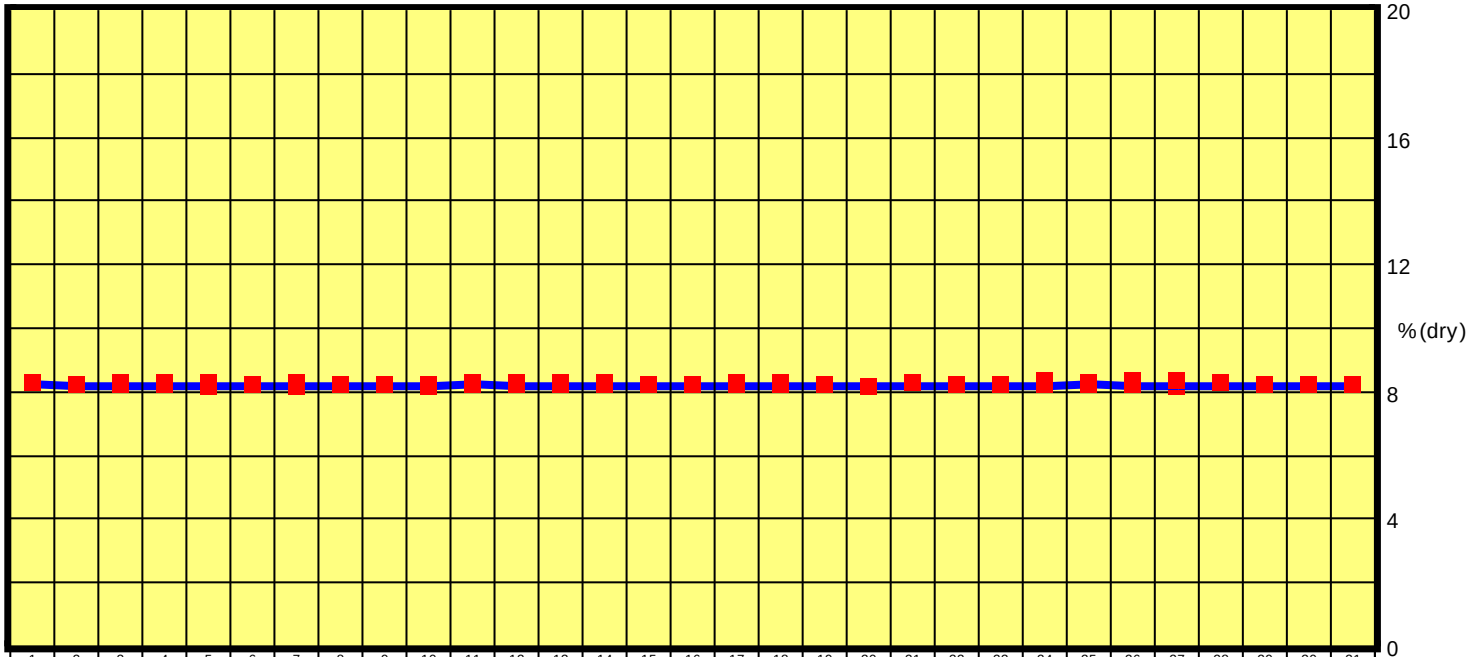

Month summary	
30 min ELV	
Monthly max.	8.4
Monthly mean	8.2
Monthly min.	8.0
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	8.2
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	8.3	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.2	8.3	8.3	8.2	8.2	8.3	8.2	8.3	8.4	8.3	8.4	8.4	8.3	8.3	8.3	8.3
Mean	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
Min.	8.1	8.1	8.1	8.1	8.0	8.0	8.0	8.1	8.1	8.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.0	8.1	8.1	8.0	8.1	8.2	8.1	8.1
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for O_2, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 6.5

No. of valid averages = 1488

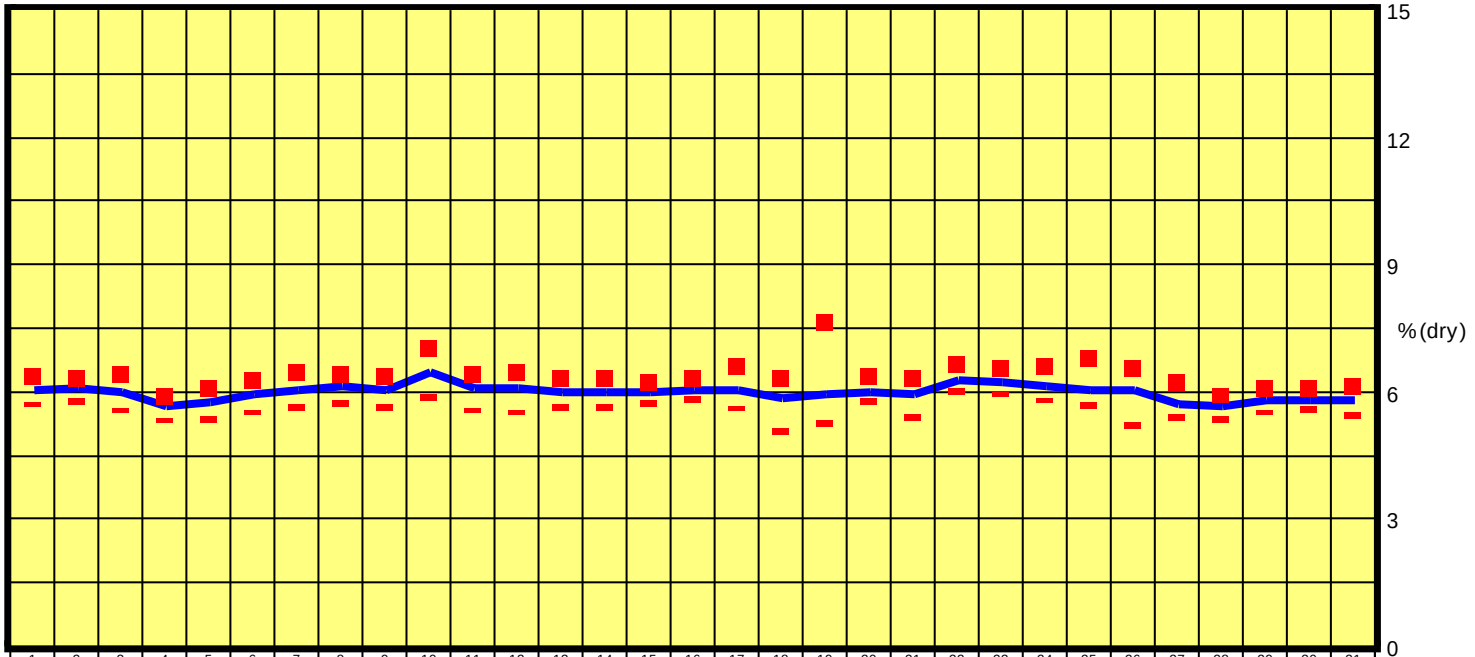

Month summary	
30 min ELV	
Monthly max.	7.7
Monthly mean	6.0
Monthly min.	5.1
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	6.5
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	6.4	6.3	6.4	5.9	6.1	6.3	6.5	6.4	6.4	7.0	6.4	6.5	6.3	6.3	6.2	6.3	6.6	6.3	7.7	6.4	6.3	6.6	6.6	6.6	6.8	6.6	6.2	5.9	6.1	6.1	6.1
Mean	6.1	6.1	6.0	5.6	5.8	5.9	6.0	6.1	6.1	6.5	6.1	6.1	6.0	6.0	6.0	6.0	6.0	5.9	6.0	6.0	6.0	6.3	6.2	6.1	6.1	6.0	5.7	5.7	5.8	5.8	5.8
Min.	5.7	5.8	5.6	5.3	5.3	5.5	5.6	5.7	5.6	5.9	5.6	5.5	5.6	5.6	5.7	5.8	5.6	5.1	5.3	5.8	5.4	6.0	5.9	5.8	5.7	5.2	5.4	5.4	5.5	5.6	5.4
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	6.1	6.1	6.0	5.6	5.8	5.9	6.0	6.1	6.1	6.5	6.1	6.1	6.0	6.0	6.0	6.0	6.0	5.9	6.0	6.0	6.0	6.3	6.2	6.1	6.1	6.0	5.7	5.7	5.8	5.8	5.8
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air C (A1)

mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05


Reporting of Continuously Monitored Emissions to Air for H2O, Emission Point Report for Aug, 2026

Key

- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 20.8

No. of valid averages = 1488

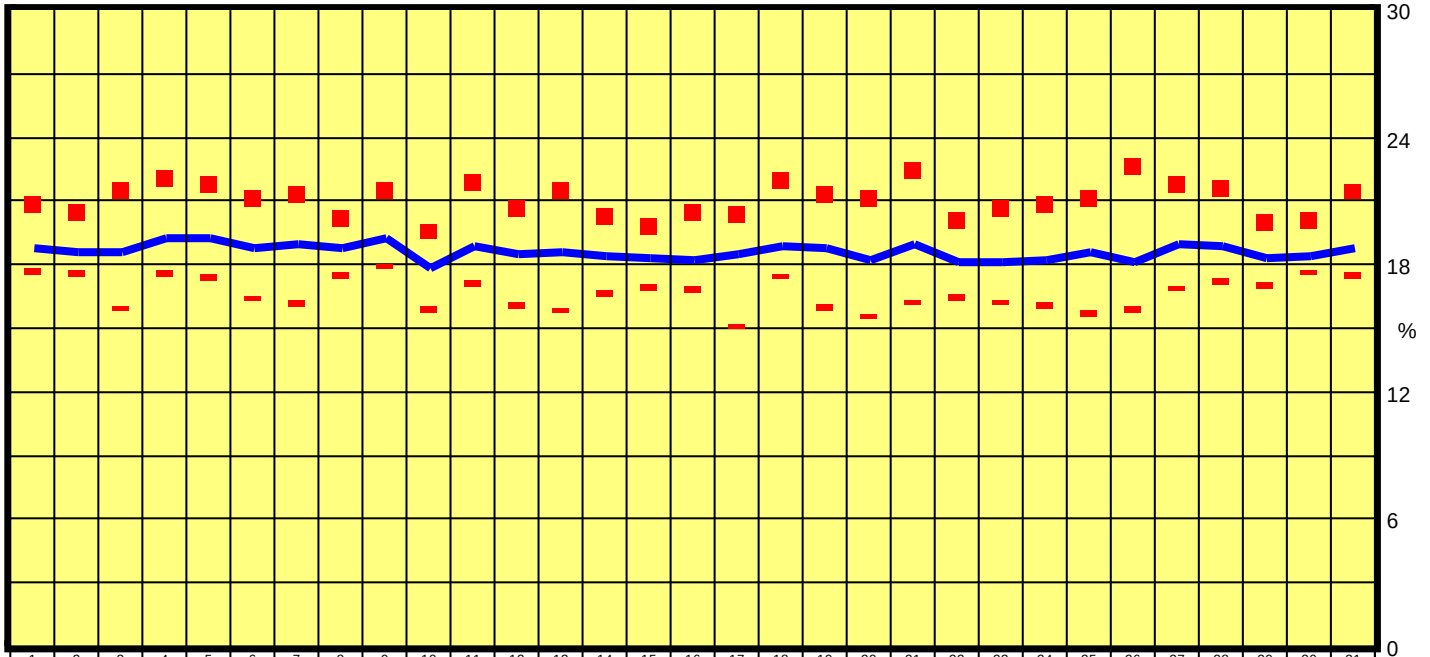

Month summary	
30 min ELV	
Monthly max.	22.6
Monthly mean	18.6
Monthly min.	15.1
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	19.3
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	20.8	20.4	21.5	22.1	21.8	21.1	21.3	20.2	21.5	19.6	21.9	20.7	21.5	20.3	19.8	20.5	20.3	22.0	21.4	21.2	22.4	20.1	20.7	20.8	21.1	22.6	21.8	21.6	20.0	20.1	21.5
Mean	18.7	18.6	18.6	19.3	19.3	18.8	18.9	18.7	19.3	17.8	18.9	18.4	18.6	18.4	18.3	18.2	18.5	18.8	18.8	18.2	18.9	18.1	18.1	18.2	18.5	18.1	19.0	18.8	18.3	18.4	18.8
Min.	17.7	17.6	15.9	17.6	17.4	16.4	16.2	17.5	17.9	15.9	17.1	16.1	15.8	16.6	17.0	16.9	15.1	17.5	16.0	15.6	16.2	16.4	16.2	16.1	15.7	15.9	16.9	17.2	17.0	17.6	17.5
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	18.7	18.6	18.6	19.3	19.3	18.8	18.9	18.7	19.3	17.8	18.9	18.4	18.6	18.4	18.3	18.2	18.5	18.8	18.8	18.2	18.9	18.1	18.1	18.2	18.5	18.1	19.0	18.8	18.3	18.4	18.8
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____

Permit No: PPC/A/1181922

Operator: Westfield Energy Recovery Ltd

Facility: Westfield Energy

Form No: Air 4 (A1)

Reporting of Continuously Monitored Emissions to Air for Dust, Emission Point Report for Aug, 2026


mCERTS
THE ENVIRONMENT AGENCY'S MONITORING CERTIFICATION SCHEME
Certificate No:MC080130/05

Key

- Daily average ELV
- 30 min. average ELV
- Mean 30 min. average
- Max. 30 min average
- Min. 30 min average
- Daily mean

97th Percentile = 0.8

No. of valid averages = 1488

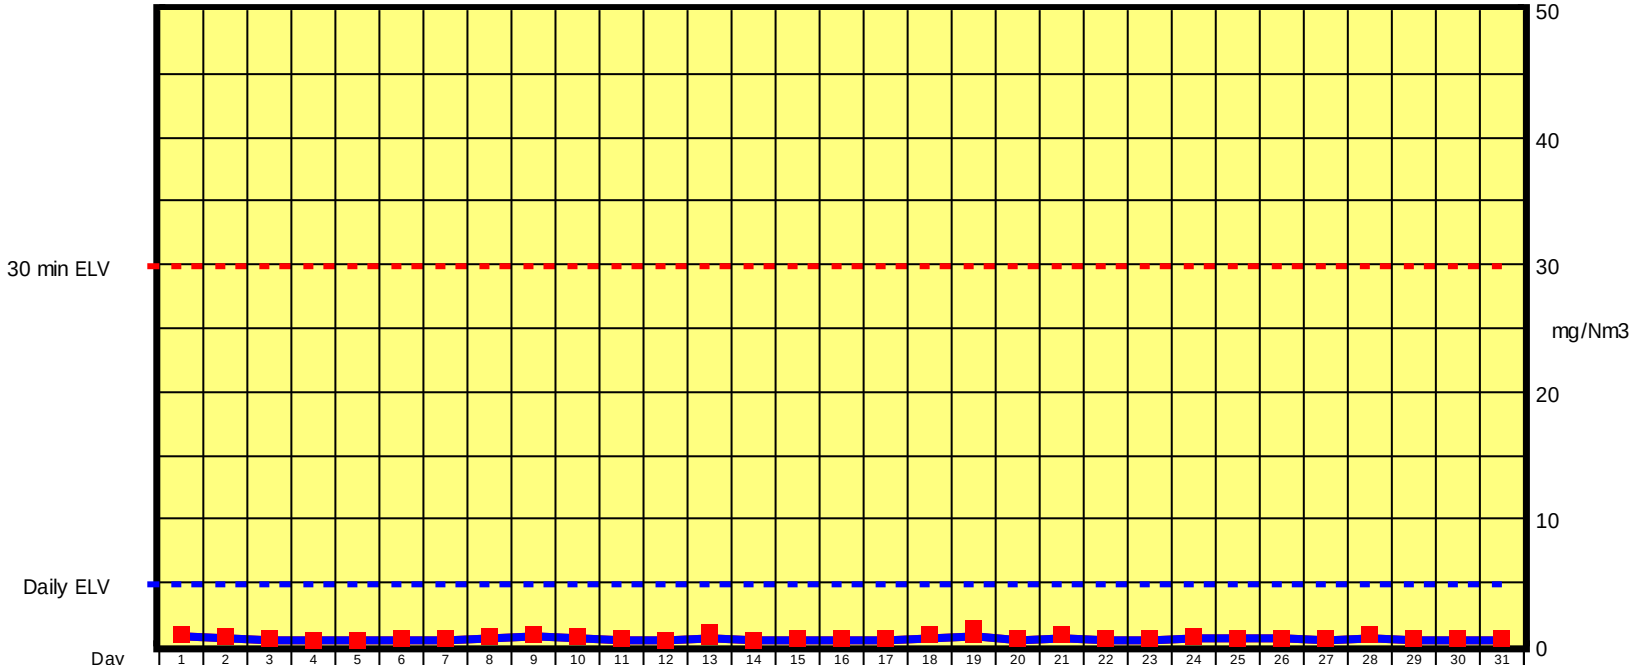

Month summary	
30 min ELV	
Monthly max.	1.4
Monthly mean	0.6
Monthly min.	0.1
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	0.8
No. invalid days	0
No. > ELV	0
No. report days	31
Total run hours	744.0

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
Max.	1.0	0.8	0.6	0.5	0.5	0.6	0.7	0.8	0.9	0.8	0.6	0.5	1.1	0.5	0.6	0.6	0.7	1.0	1.4	0.6	1.0	0.7	0.6	0.8	0.7	0.7	0.6	0.9	0.6	0.6	0.6
Mean	0.7	0.7	0.5	0.4	0.5	0.5	0.5	0.7	0.8	0.6	0.5	0.4	0.6	0.5	0.5	0.5	0.5	0.6	0.7	0.5	0.6	0.5	0.5	0.6	0.6	0.6	0.5	0.6	0.5	0.5	0.5
Min.	0.5	0.6	0.4	0.4	0.4	0.4	0.4	0.6	0.7	0.4	0.4	0.1	0.3	0.4	0.4	0.5	0.5	0.5	0.6	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
Daily Mean	0.7	0.7	0.5	0.4	0.5	0.5	0.5	0.7	0.8	0.6	0.5	0.4	0.6	0.5	0.5	0.5	0.5	0.6	0.7	0.5	0.6	0.5	0.5	0.6	0.6	0.6	0.5	0.6	0.5	0.5	0.5
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
Run hours	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0	24.0

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____