
Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 3 (A1)

# Reporting of Continuously Monitored Emissions to Air for HCl mg/Nm3 at Emission Point A1 For the month of September 2026

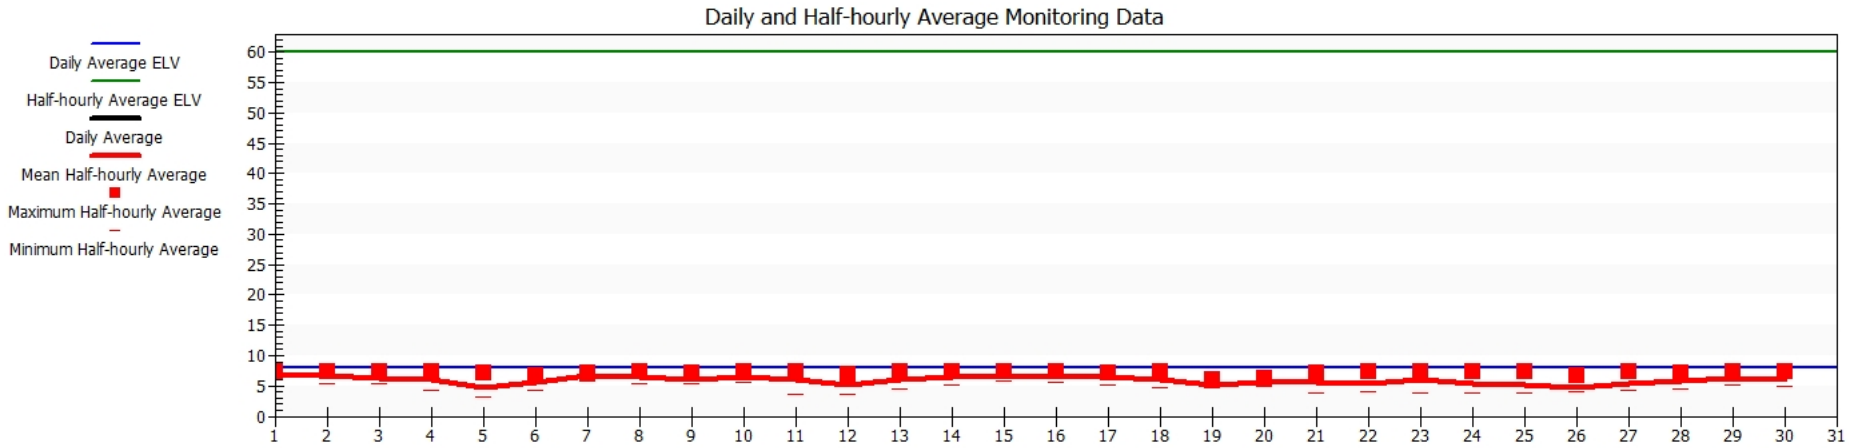


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | |
| | Monthly maximum | 7.5 | Maximum Half-hourly average | 7.4 | 7.3 | 7.3 | 7.4 | 7.1 | 6.7 | 7.2 | 7.3 | 7.1 | 7.3 | 7.5 | 6.9 | 7.3 | 7.2 | 7.3 | 7.3 | 7.2 | 7.3 | 6.0 | 6.2 | 7.2 | 7.3 | 7.3 | 7.3 | 7.4 | 6.7 | 7.3 | 7.2 | 7.4 | 7.3 | |
| Half-hourly | Monthly mean | 5.9 | Mean Half-hourly average | 6.7 | 6.7 | 6.3 | 6.1 | 4.7 | 5.7 | 6.8 | 6.4 | 6.0 | 6.5 | 6.1 | 5.1 | 6.0 | 6.5 | 6.7 | 6.6 | 6.4 | 6.0 | 5.3 | 5.6 | 5.5 | 5.5 | 6.1 | 5.3 | 5.3 | 4.8 | 5.5 | 5.8 | 6.4 | 5.9 | |
| average | Monthly minimum | 3.2 | Minimum Half-hourly average | 6.1 | 5.3 | 5.3 | 4.3 | 3.2 | 4.3 | 5.9 | 5.4 | 5.3 | 5.7 | 3.5 | 3.6 | 4.5 | 5.1 | 5.9 | 5.6 | 5.2 | 4.7 | 4.6 | 4.9 | 3.8 | 4.0 | 3.9 | 3.9 | 3.9 | 4.1 | 4.3 | 4.4 | 5.1 | 5.0 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | | Daily average ELV | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | |
| Daily | Monthly maximum | 6.8 | Daily average | 6.7 | 6.7 | 6.3 | 6.1 | 4.7 | 5.7 | 6.8 | 6.4 | 6.0 | 6.5 | 6.1 | 5.1 | 6.0 | 6.5 | 6.7 | 6.6 | 6.4 | 6.0 | 5.3 | 5.6 | 5.5 | 5.5 | 6.1 | 5.3 | 5.3 | 4.8 | 5.5 | 5.8 | 6.4 | 5.9 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 5 (A1)

# Reporting of Continuously Monitored Emissions to Air for SO2 mg/Nm3 at Emission Point A1 For the month of September 2026

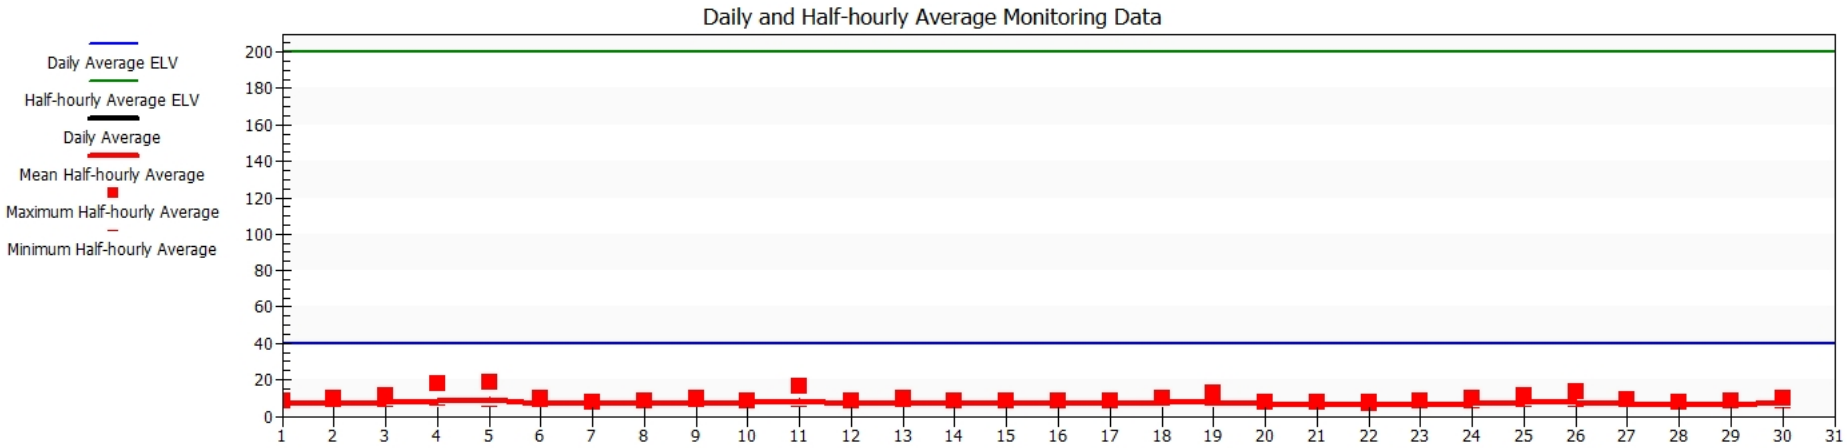


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | 200 | |
| | Monthly maximum | 19 | Maximum Half-hourly average | 9 | 10 | 11 | 18 | 19 | 10 | 8 | 9 | 10 | 9 | 17 | 8 | 10 | 8 | 8 | 8 | 8 | 10 | 13 | 8 | 8 | 8 | 8 | 10 | 12 | 13 | 9 | 7 | 8 | 10 | |
| Half-hourly | Monthly mean | 7 | Mean Half-hourly average | 7 | 7 | 8 | 9 | 9 | 7 | 7 | 7 | 7 | 7 | 8 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 6 | 6 | 6 | 7 | 8 | 8 | 7 | 6 | 7 | 7 | |
| average | Monthly minimum | 3 | Minimum Half-hourly average | 6 | 6 | 6 | 6 | 5 | 6 | 5 | 6 | 5 | 6 | 5 | 6 | 5 | 5 | 5 | 5 | 6 | 6 | 6 | 5 | 4 | 3 | 5 | 5 | 5 | 6 | 6 | 5 | 5 | 5 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | | Daily average ELV | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | |
| Daily | Monthly maximum | 9 | Daily average | 7 | 7 | 8 | 9 | 9 | 7 | 7 | 7 | 7 | 7 | 8 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 7 | 6 | 6 | 6 | 7 | 8 | 8 | 7 | 6 | 7 | 7 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 6 (A1)

# Reporting of Continuously Monitored Emissions to Air for NOx mg/Nm3 at Emission Point A1 For the month of September 2026

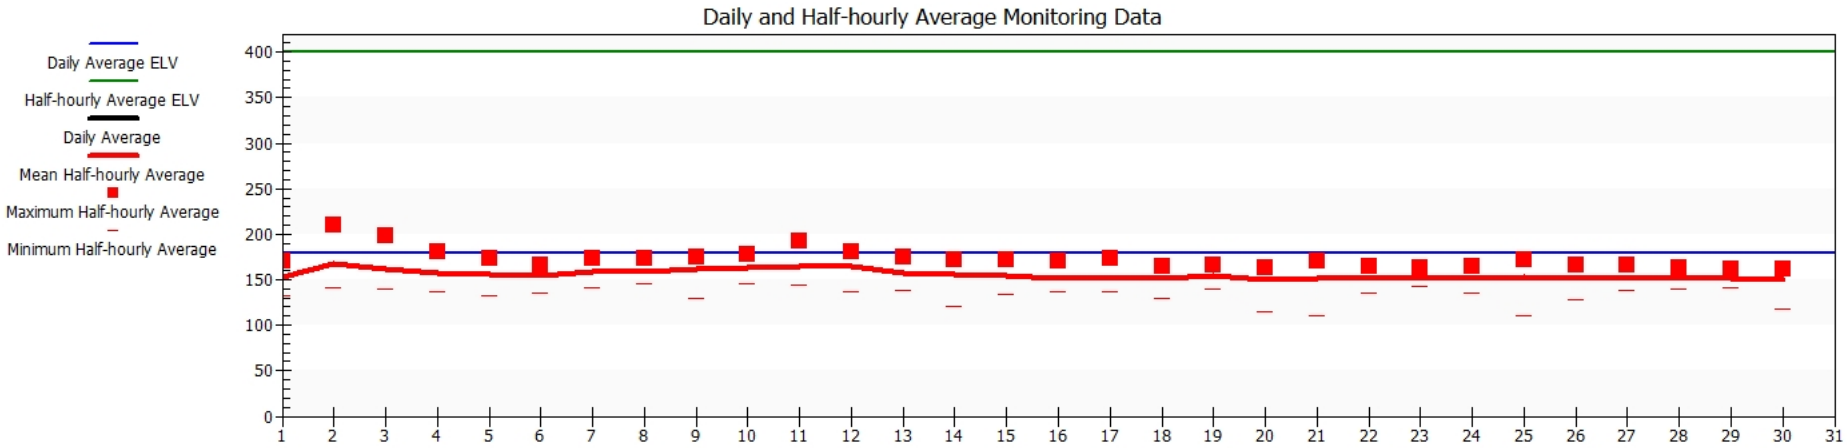


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | 400 | |
| | Monthly maximum | 209 | Maximum Half-hourly average | 171 | 209 | 199 | 181 | 174 | 166 | 173 | 174 | 174 | 178 | 193 | 181 | 175 | 171 | 173 | 170 | 173 | 164 | 166 | 163 | 171 | 165 | 163 | 165 | 172 | 167 | 166 | 164 | 162 | 161 | |
| Half-hourly | Monthly mean | 156 | Mean Half-hourly average | 153 | 168 | 162 | 157 | 155 | 155 | 159 | 159 | 161 | 164 | 164 | 165 | 157 | 155 | 154 | 152 | 152 | 151 | 154 | 151 | 152 | 152 | 152 | 152 | 153 | 152 | 152 | 153 | 152 | 150 | |
| average | Monthly minimum | 111 | Minimum Half-hourly average | 132 | 141 | 140 | 137 | 132 | 136 | 141 | 146 | 130 | 146 | 144 | 136 | 139 | 121 | 134 | 137 | 136 | 129 | 139 | 115 | 111 | 136 | 143 | 136 | 111 | 127 | 139 | 140 | 142 | 118 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | | Daily average ELV | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | 180 | |
| Daily | Monthly maximum | 168 | Daily average | 153 | 168 | 162 | 157 | 155 | 155 | 159 | 159 | 161 | 164 | 164 | 165 | 157 | 155 | 154 | 152 | 152 | 151 | 154 | 151 | 152 | 152 | 152 | 152 | 153 | 152 | 152 | 153 | 152 | 150 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 2 (A1)

# Reporting of Continuously Monitored Emissions to Air for TOC mg/Nm3 at Emission Point A1 For the month of September 2026

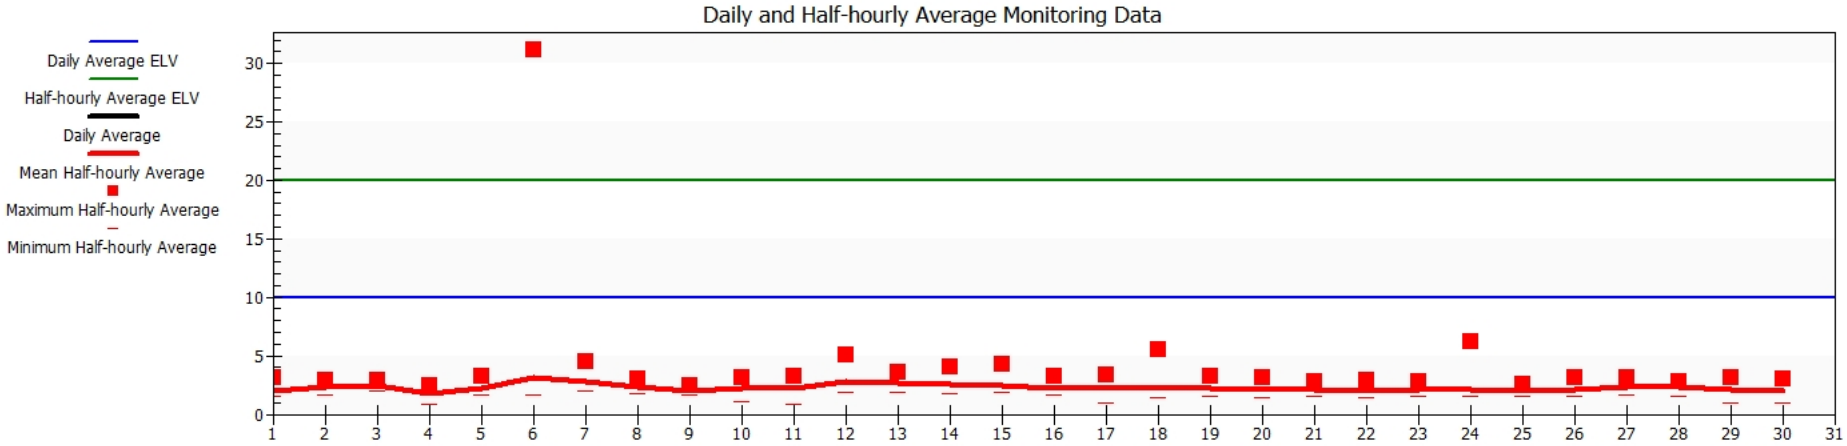


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | 20.0 | |
| | Monthly maximum | 31.1 | Maximum Half-hourly average | 3.2 | 2.9 | 3.0 | 2.5 | 3.2 | 31.1 | 4.5 | 3.1 | 2.4 | 3.1 | 3.2 | 5.1 | 3.6 | 4.1 | 4.3 | 3.2 | 3.4 | 5.5 | 3.2 | 3.1 | 2.8 | 2.9 | 2.8 | 6.2 | 2.5 | 3.1 | 3.2 | 2.8 | 3.2 | 3.0 | |
| Half-hourly | Monthly mean | 2.3 | Mean Half-hourly average | 2.0 | 2.3 | 2.4 | 1.8 | 2.3 | 3.2 | 2.8 | 2.3 | 2.0 | 2.2 | 2.2 | 2.8 | 2.7 | 2.6 | 2.5 | 2.3 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.0 | 2.1 | 2.1 | 2.0 | 2.1 | 2.3 | 2.3 | 2.1 | 2.0 | |
| average | Monthly minimum | 0.9 | Minimum Half-hourly average | 1.5 | 1.7 | 1.9 | 0.9 | 1.7 | 1.6 | 2.0 | 1.7 | 1.7 | 1.1 | 0.9 | 1.9 | 1.9 | 1.8 | 1.9 | 1.7 | 0.9 | 1.5 | 1.5 | 1.5 | 1.6 | 1.5 | 1.5 | 1.5 | 1.6 | 1.5 | 1.7 | 1.6 | 0.9 | 0.9 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 1 | No of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | | Daily average ELV | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | |
| Daily | Monthly maximum | 3.2 | Daily average | 2.0 | 2.3 | 2.4 | 1.8 | 2.3 | 3.2 | 2.8 | 2.3 | 2.0 | 2.2 | 2.2 | 2.8 | 2.7 | 2.6 | 2.5 | 2.3 | 2.2 | 2.2 | 2.2 | 2.2 | 2.2 | 2.0 | 2.1 | 2.1 | 2.0 | 2.1 | 2.3 | 2.3 | 2.1 | 2.0 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 7 (A1)

# Reporting of Continuously Monitored Emissions to Air for NH3 mg/Nm3 at Emission Point A1 For the month of September 2026

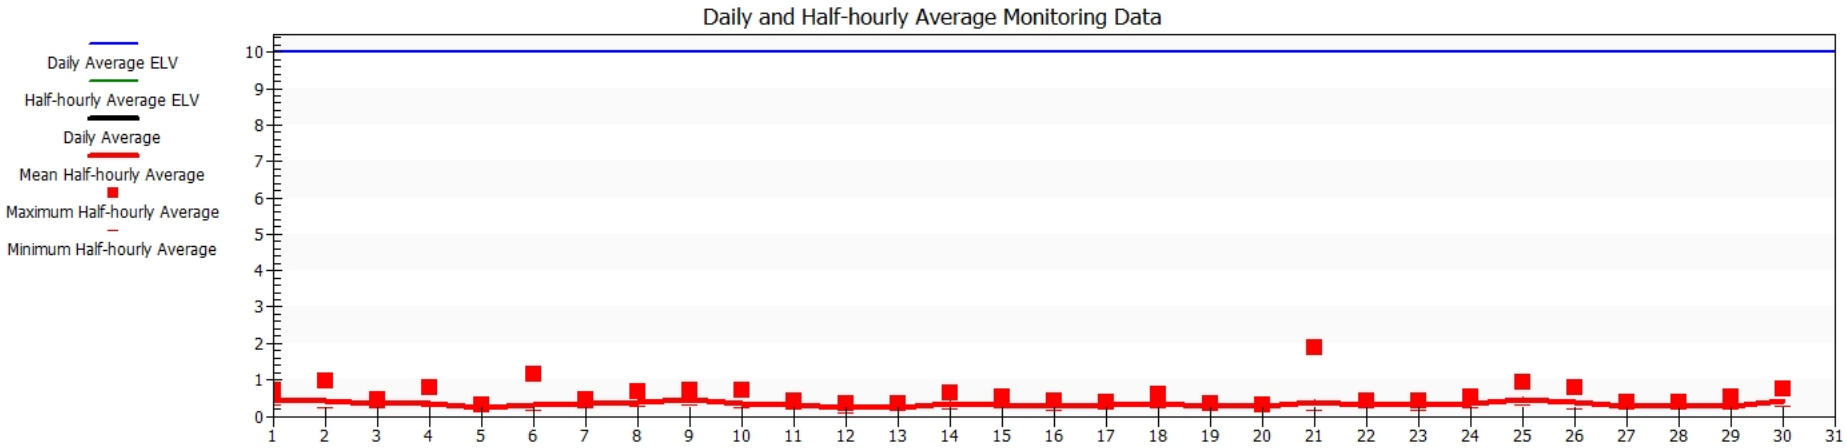


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Half-hourly average | | | Half-hourly average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | Monthly maximum | 1.9 | Maximum Half-hourly average | 0.7 | 1.0 | 0.5 | 0.8 | 0.3 | 1.2 | 0.5 | 0.7 | 0.7 | 0.7 | 0.4 | 0.4 | 0.3 | 0.6 | 0.5 | 0.4 | 0.4 | 0.6 | 0.3 | 0.3 | 1.9 | 0.4 | 0.4 | 0.5 | 0.9 | 0.8 | 0.4 | 0.4 | 0.5 | 0.7 | |
| | Monthly mean | 0.3 | Mean Half-hourly average | 0.5 | 0.4 | 0.3 | 0.4 | 0.2 | 0.3 | 0.3 | 0.4 | 0.5 | 0.4 | 0.3 | 0.2 | 0.2 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.4 | 0.3 | 0.3 | 0.3 | 0.5 | 0.4 | 0.3 | 0.3 | 0.3 | 0.4 | |
| | Monthly minimum | 0.1 | Minimum Half-hourly average | 0.3 | 0.3 | 0.2 | 0.3 | 0.1 | 0.2 | 0.2 | 0.3 | 0.3 | 0.2 | 0.2 | 0.1 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.3 | 0.2 | 0.2 | 0.3 | 0.2 | 0.2 | 0.2 | 0.2 | 0.3 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| Daily average | | | Daily average ELV | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | |
| | Monthly maximum | 0.5 | Daily average | 0.5 | 0.4 | 0.3 | 0.4 | 0.2 | 0.3 | 0.3 | 0.4 | 0.5 | 0.4 | 0.3 | 0.2 | 0.2 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.4 | 0.3 | 0.3 | 0.3 | 0.5 | 0.4 | 0.3 | 0.3 | 0.3 | 0.4 | |
| | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 1 (A1)

# Reporting of Continuously Monitored Emissions to Air for Particulates mg/Nm3 at Emission Point A1 For the month of September 2026

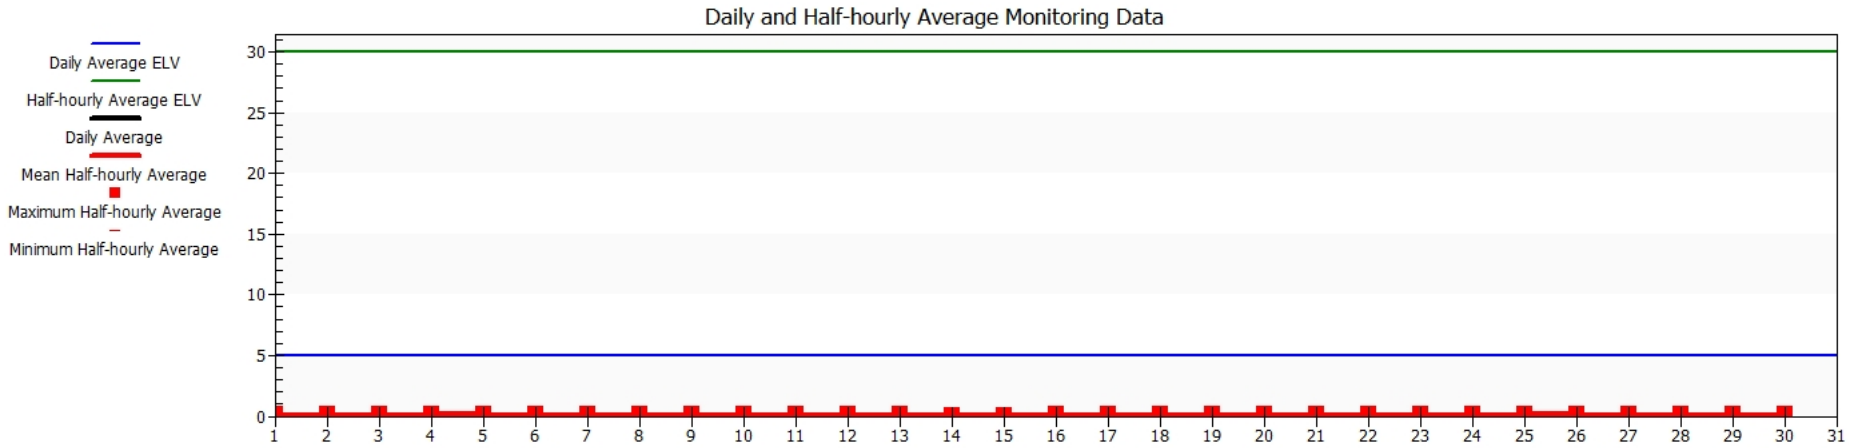


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | 30.0 | |
| | Monthly maximum | 0.2 | Maximum Half-hourly average | 0.1 | 0.1 | 0.1 | 0.2 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.2 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.2 | 0.2 | 0.1 | 0.1 | 0.1 | 0.2 | |
| Half-hourly | Monthly mean | 0.1 | Mean Half-hourly average | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | |
| average | Monthly minimum | 0.1 | Minimum Half-hourly average | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | | Daily average ELV | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | 5.0 | |
| Daily | Monthly maximum | 0.1 | Daily average | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 8 (A1)

# Reporting of Continuously Monitored Emissions to Air for N2O mg/Nm3 at Emission Point A1 For the month of September 2026

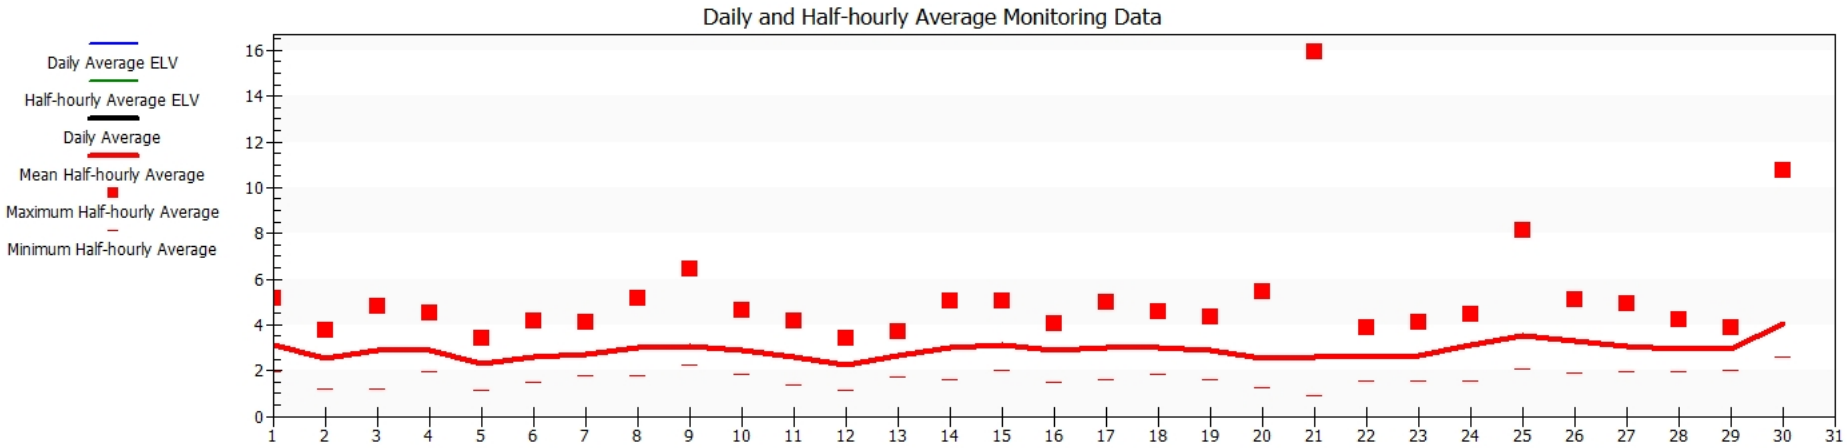


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | Monthly maximum | 15.9 | Maximum Half-hourly average | 5.2 | 3.7 | 4.8 | 4.5 | 3.4 | 4.2 | 4.1 | 5.2 | 6.5 | 4.6 | 4.2 | 3.4 | 3.7 | 5.1 | 5.1 | 4.0 | 5.0 | 4.6 | 4.3 | 5.4 | 15.9 | 3.9 | 4.1 | 4.4 | 8.1 | 5.1 | 4.9 | 4.2 | 3.9 | 10.7 | |
| Half-hourly | Monthly mean | 2.9 | Mean Half-hourly average | 3.1 | 2.6 | 2.9 | 2.9 | 2.3 | 2.6 | 2.7 | 3.0 | 3.1 | 2.9 | 2.6 | 2.2 | 2.6 | 3.0 | 3.1 | 2.9 | 3.0 | 3.0 | 2.9 | 2.5 | 2.6 | 2.6 | 2.7 | 3.1 | 3.5 | 3.3 | 3.0 | 2.9 | 2.9 | 4.1 | |
| average | Monthly minimum | 0.9 | Minimum Half-hourly average | 1.9 | 1.2 | 1.2 | 2.0 | 1.1 | 1.5 | 1.8 | 1.8 | 2.2 | 1.8 | 1.4 | 1.2 | 1.7 | 1.6 | 2.0 | 1.5 | 1.6 | 1.8 | 1.6 | 1.2 | 0.9 | 1.6 | 1.5 | 1.6 | 2.1 | 1.9 | 1.9 | 2.0 | 2.0 | 2.6 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | | | Daily average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| Daily | Monthly maximum | 4.1 | Daily average | 3.1 | 2.6 | 2.9 | 2.9 | 2.3 | 2.6 | 2.7 | 3.0 | 3.1 | 2.9 | 2.6 | 2.2 | 2.6 | 3.0 | 3.1 | 2.9 | 3.0 | 3.0 | 2.9 | 2.5 | 2.6 | 2.6 | 2.7 | 3.1 | 3.5 | 3.3 | 3.0 | 2.9 | 2.9 | 4.1 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air 4 (A1)

# Reporting of Continuously Monitored Emissions to Air for CO mg/Nm3 at Emission Point A1 For the month of September 2026

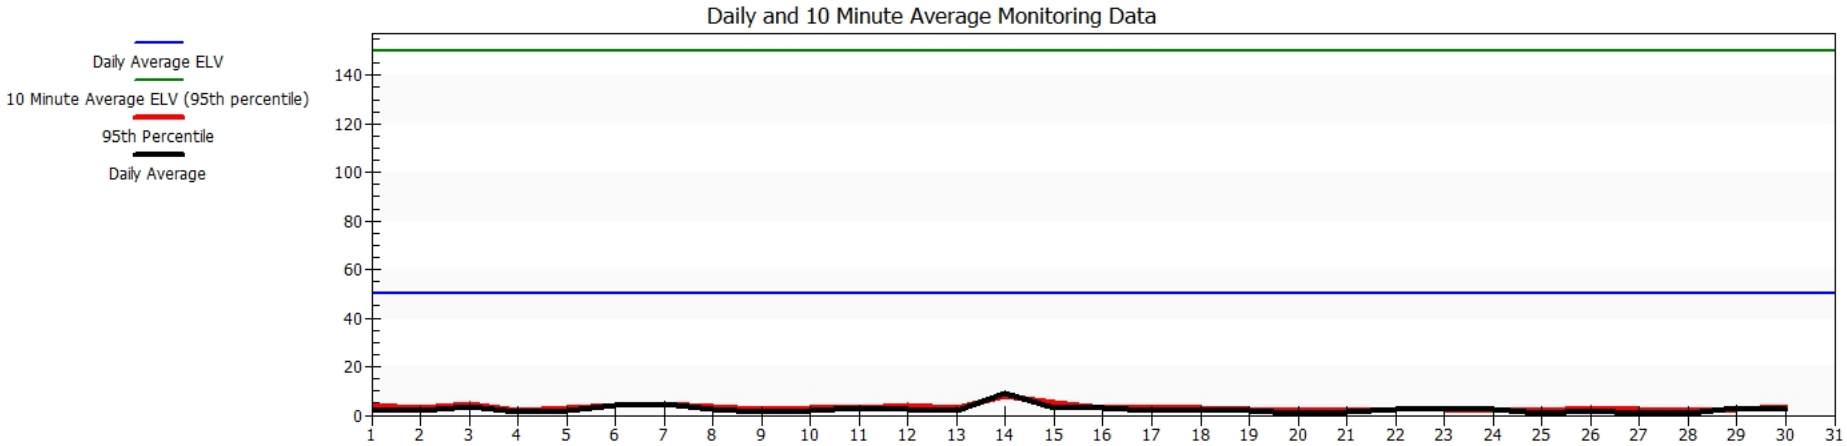


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 10 Minute average | | | 10 Minute average ELV (95th Percentile) | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | 150 | |
| | Monthly Maximum 10-min | 784 | Maximum 10 Minute average | 113 | 4 | 63 | 12 | 40 | 182 | 150 | 6 | 8 | 5 | 102 | 75 | 75 | 784 | 83 | 136 | 8 | 121 | 36 | 9 | 16 | 178 | 169 | 137 | 15 | 82 | 9 | 3 | 158 | 116 | |
| | Monthly mean 10-min avgs | 2 | 95th Percentile | 4 | 3 | 5 | 2 | 3 | 4 | 5 | 4 | 2 | 3 | 3 | 4 | 3 | 8 | 5 | 3 | 3 | 3 | 3 | 2 | 2 | 2 | 2 | 2 | 2 | 3 | 2 | 2 | 3 | 3 | |
| | Monthly Minimum 10-min | 0 | Minimum 10 Minute average | 0 | 0 | 1 | 0 | 0 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | | | Number of results above 150mg/m³ | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 0 | 0 | 0 | 0 | 0 | 1 | 0 | |
| | Sum of Exceedances of 95th percentile ELV | 0 | 95th Percentile ELV Exceeded (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |
| Daily average | | | Daily average ELV | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | |
| | Monthly maximum | 9 | Daily average | 2 | 2 | 4 | 1 | 2 | 4 | 4 | 2 | 1 | 2 | 3 | 3 | 2 | 9 | 3 | 3 | 2 | 2 | 2 | 1 | 1 | 2 | 2 | 2 | 1 | 2 | 1 | 1 | 3 | 2 | |
| | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? (Y/N) | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |

Signed..... Date.....


(Authorised to sign as a representative of the Operator)

Environment Agency explanatory note: The 10-minute average ELV is based on the "95th percentile" In this case this means that 95% of the 10 minute averages in the calendar day (= 137) must be below 150 mg/m3, and 5% (= 7) are allowed to be any value above 150 mg/m3. Whilst we expect operators to minimise CO emissions at all times, it is perfectly acceptable for the value of the maximum 10-minute average to be above 150 mg/m3, provided the 95th percentile ELV has been met for that period

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air A (A1)

# Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A1 For the month of September 2026

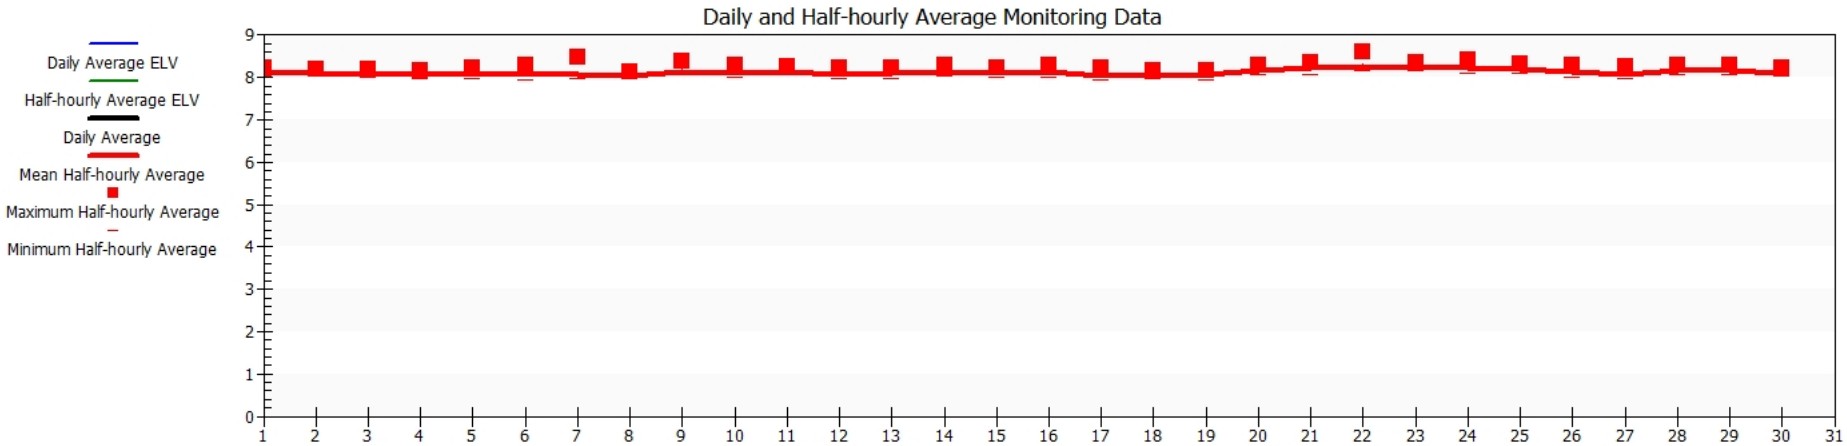


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | Monthly maximum | 8.6 | Maximum Half-hourly average | 8.2 | 8.2 | 8.2 | 8.2 | 8.3 | 8.3 | 8.5 | 8.1 | 8.4 | 8.3 | 8.3 | 8.2 | 8.2 | 8.3 | 8.2 | 8.3 | 8.2 | 8.2 | 8.2 | 8.3 | 8.4 | 8.6 | 8.3 | 8.4 | 8.3 | 8.3 | 8.3 | 8.3 | 8.3 | 8.2 | |
| Half-hourly | Monthly mean | 8.1 | Mean Half-hourly average | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.0 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.0 | 8.1 | 8.1 | 8.2 | 8.2 | 8.3 | 8.2 | 8.2 | 8.2 | 8.2 | 8.1 | 8.2 | 8.2 | 8.1 | |
| average | Monthly minimum | 7.9 | Minimum Half-hourly average | 8.0 | 8.1 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 8.1 | 8.0 | 8.1 | 8.0 | 8.0 | 8.0 | 8.0 | 8.0 | 7.9 | 8.0 | 8.0 | 8.1 | 8.1 | 8.2 | 8.2 | 8.1 | 8.1 | 8.0 | 8.0 | 8.1 | 8.1 | 8.0 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | | | Daily average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| Daily | Monthly maximum | 8.3 | Daily average | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.0 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.1 | 8.0 | 8.1 | 8.1 | 8.2 | 8.2 | 8.3 | 8.2 | 8.2 | 8.2 | 8.2 | 8.1 | 8.2 | 8.2 | 8.1 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air B (A1)

# Reporting of Continuously Monitored Emissions to Air for Dry Oxygen % at Emission Point A1 For the month of September 2026

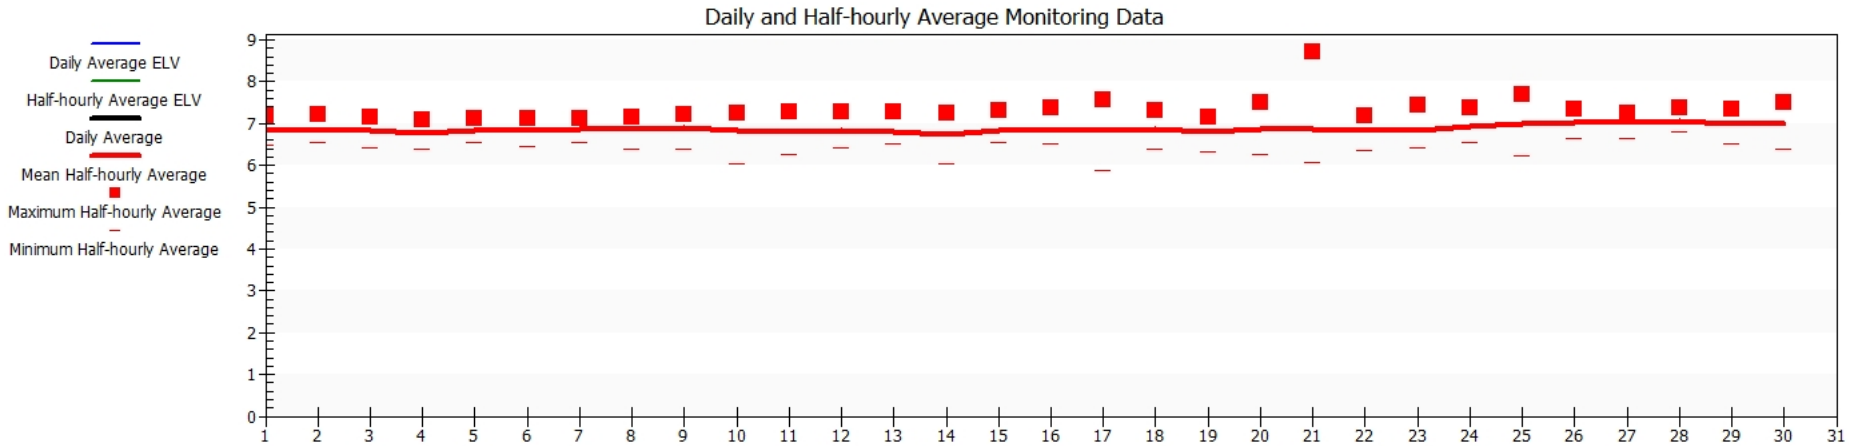


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | Monthly maximum | 8.7 | Maximum Half-hourly average | 7.2 | 7.2 | 7.2 | 7.1 | 7.1 | 7.1 | 7.1 | 7.1 | 7.2 | 7.3 | 7.3 | 7.3 | 7.3 | 7.2 | 7.3 | 7.4 | 7.6 | 7.3 | 7.2 | 7.5 | 8.7 | 7.2 | 7.4 | 7.4 | 7.7 | 7.3 | 7.2 | 7.4 | 7.4 | 7.5 | |
| Half-hourly | Monthly mean | 6.9 | Mean Half-hourly average | 6.8 | 6.9 | 6.8 | 6.8 | 6.8 | 6.8 | 6.9 | 6.9 | 6.9 | 6.8 | 6.8 | 6.8 | 6.8 | 6.7 | 6.8 | 6.8 | 6.8 | 6.9 | 6.8 | 6.9 | 6.9 | 6.8 | 6.8 | 6.9 | 7.0 | 7.0 | 7.0 | 7.1 | 7.0 | 7.0 | |
| average | Monthly minimum | 5.9 | Minimum Half-hourly average | 6.5 | 6.5 | 6.4 | 6.4 | 6.5 | 6.4 | 6.6 | 6.4 | 6.4 | 6.0 | 6.3 | 6.4 | 6.5 | 6.0 | 6.6 | 6.5 | 5.9 | 6.4 | 6.3 | 6.3 | 6.1 | 6.4 | 6.4 | 6.6 | 6.2 | 6.6 | 6.6 | 6.8 | 6.5 | 6.4 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | | | Daily average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| Daily | Monthly maximum | 7.1 | Daily average | 6.8 | 6.9 | 6.8 | 6.8 | 6.8 | 6.8 | 6.9 | 6.9 | 6.9 | 6.8 | 6.8 | 6.8 | 6.8 | 6.7 | 6.8 | 6.8 | 6.8 | 6.9 | 6.8 | 6.9 | 6.9 | 6.8 | 6.8 | 6.9 | 7.0 | 7.0 | 7.0 | 7.1 | 7.0 | 7.0 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |


Signed..... Date.....

(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446 Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center Form Number: Air C (A1)

# Reporting of Continuously Monitored Emissions to Air for Moisture % at Emission Point A1 For the month of September 2026

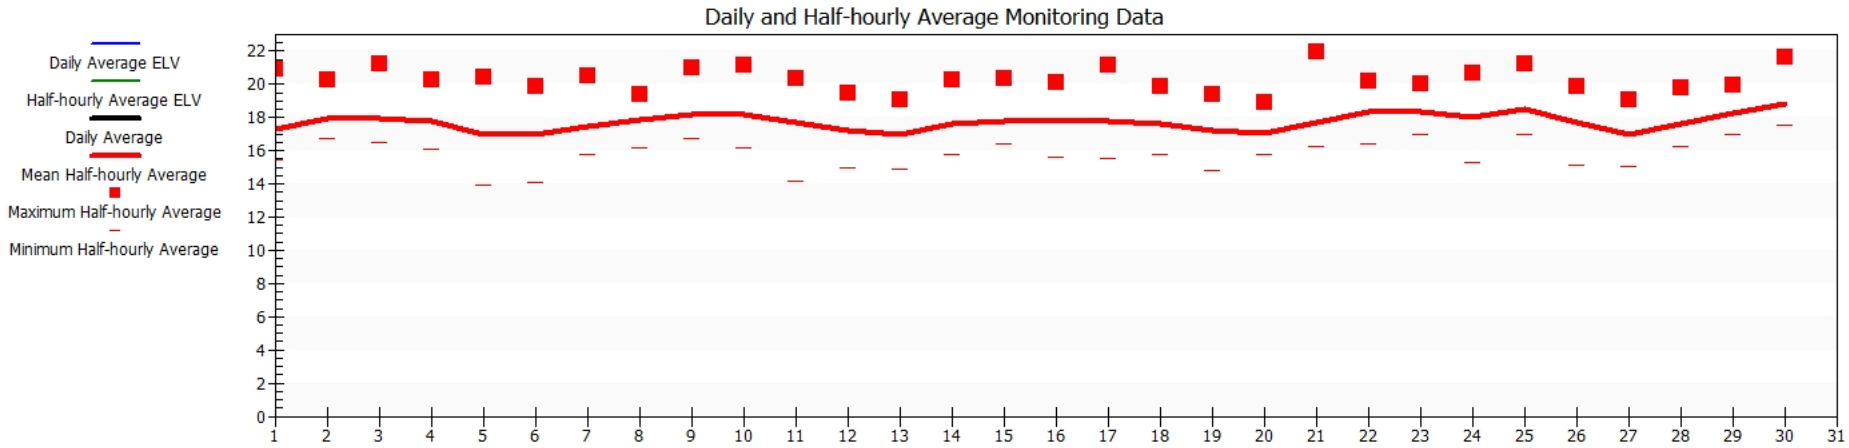


| | Monthly summary | | Date | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | Half-hourly average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | Monthly maximum | 21.9 | Maximum Half-hourly average | 20.9 | 20.2 | 21.2 | 20.3 | 20.5 | 19.9 | 20.5 | 19.4 | 21.0 | 21.1 | 20.4 | 19.5 | 19.0 | 20.2 | 20.3 | 20.1 | 21.1 | 19.9 | 19.4 | 18.9 | 21.9 | 20.2 | 20.0 | 20.7 | 21.3 | 19.9 | 19.1 | 19.8 | 19.9 | 21.6 | |
| Half-hourly | Monthly mean | 17.7 | Mean Half-hourly average | 17.3 | 17.9 | 17.9 | 17.8 | 16.9 | 17.0 | 17.4 | 17.8 | 18.2 | 18.2 | 17.7 | 17.2 | 17.0 | 17.6 | 17.8 | 17.8 | 17.7 | 17.6 | 17.2 | 17.0 | 17.7 | 18.3 | 18.3 | 18.0 | 18.5 | 17.7 | 17.0 | 17.6 | 18.2 | 18.9 | |
| average | Monthly minimum | 13.9 | Minimum Half-hourly average | 15.5 | 16.8 | 16.5 | 16.1 | 13.9 | 14.1 | 15.8 | 16.2 | 16.7 | 16.1 | 14.1 | 15.0 | 14.9 | 15.7 | 16.4 | 15.6 | 15.5 | 15.8 | 14.8 | 15.8 | 16.3 | 16.4 | 17.0 | 15.3 | 17.0 | 15.1 | 15.1 | 16.3 | 17.0 | 17.6 | |
| | Total Invalid results | 0 | No of Invalid results | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | |
| | Sum of exceedances | 0 | No of exceedances of ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| | | | Daily average ELV | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | |
| Daily | Monthly maximum | 18.9 | Daily average | 17.3 | 17.9 | 17.9 | 17.8 | 16.9 | 17.0 | 17.4 | 17.8 | 18.2 | 18.2 | 17.7 | 17.2 | 17.0 | 17.6 | 17.8 | 17.8 | 17.7 | 17.6 | 17.2 | 17.0 | 17.7 | 18.3 | 18.3 | 18.0 | 18.5 | 17.7 | 17.0 | 17.6 | 18.2 | 18.9 | |
| average | No of invalid days | 0 | Value Valid? | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | Y | |
| | Sum of exceedances | 0 | Value Exceeds ELV? | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | N | |

Signed..... Date.....

(Authorised to sign as a representative of the Operator)