

Permit No: PPC/A/1181922


Facility: Westfield Energy

Operator: Westfield Energy Recovery Ltd


Form No: Air 6 (A1)



Reporting of Continuously Monitored Emissions to Air for NO_x, Emission Point Report for Mar, 2026

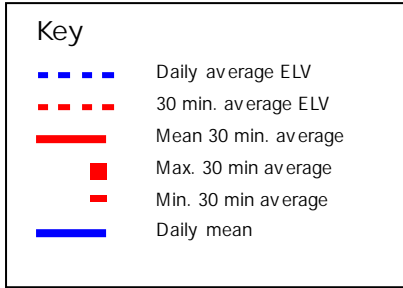

97th Percentile = 128.0
No. of valid averages = 1445

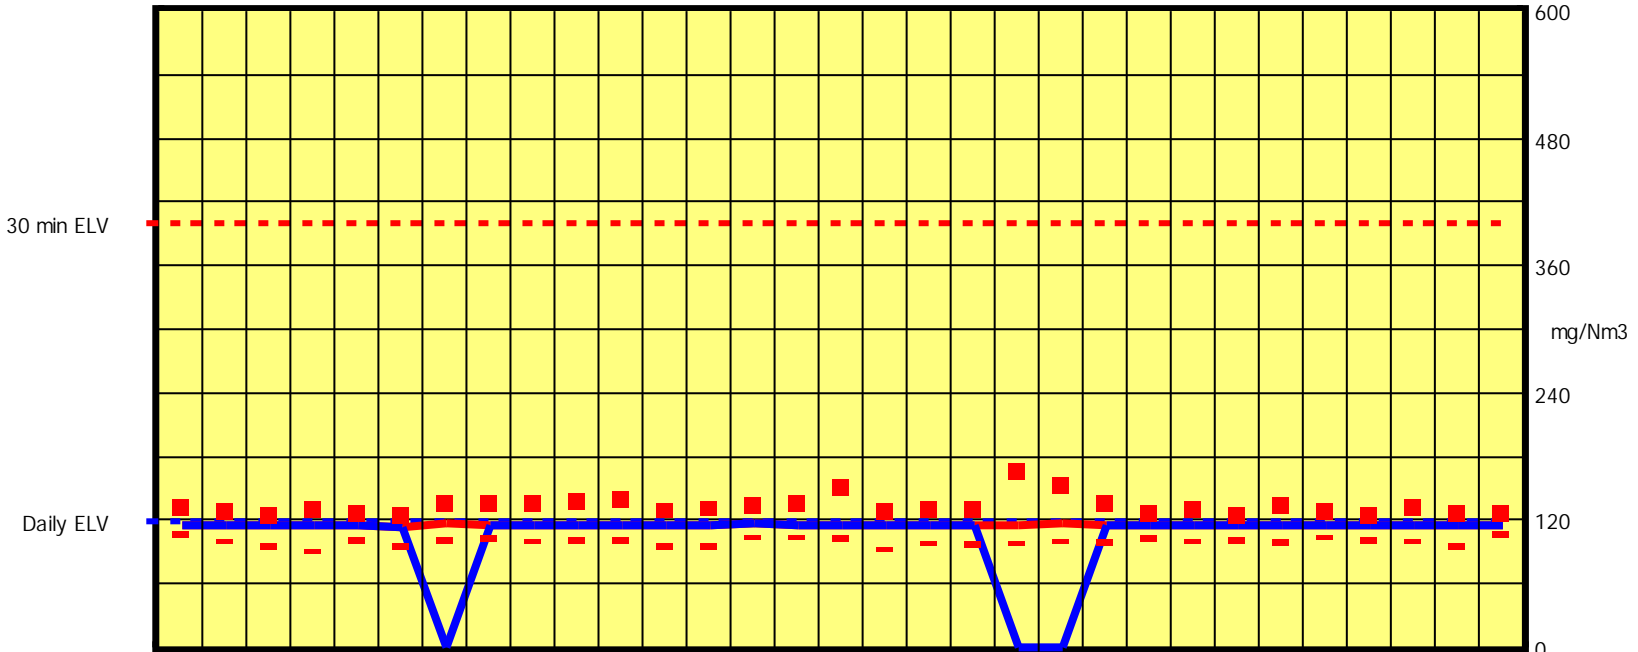

Month summary	
30 min ELV	
Monthly max.	165.2
Monthly mean	115.2
Monthly min.	90.7
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	116.1
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
Max.	132.8	128.1	123.8	129.8	126.5	124.5	136.6	135.9	135.7	138.5	140.0	129.3	131.2	133.1	136.7	151.7	127.8	129.9	130.4	165.2	153.6	135.9	126.6	130.9	124.5	134.5	128.8	123.7	131.5	126.9	126.0
Mean	115.5	114.9	114.5	114.6	115.1	113.9	117.4	115.8	115.4	115.6	115.5	115.3	115.7	116.1	115.6	115.4	115.7	115.6	114.7	114.9	117.1	115.0	114.5	114.5	114.9	115.5	114.5	114.6	114.6	114.7	115.0
Min.	106.7	100.0	94.9	90.7	101.5	94.8	101.0	103.4	100.2	100.4	100.5	95.5	95.4	103.6	103.6	102.6	92.3	98.0	96.9	98.0	99.8	98.9	103.3	99.9	101.2	98.5	104.0	101.0	99.8	95.5	106.1
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120	120
Daily Mean	115.5	114.9	114.5	114.6	115.1	113.9	N/A	115.8	115.4	115.6	115.5	115.3	115.7	116.1	115.6	115.4	115.7	115.6	114.7	N/A	N/A	115.0	114.5	114.5	114.9	115.5	114.5	114.6	114.6	114.7	115.0
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____



Permit No: PPC/A/1181922

Facility: Westfield Energy

Operator: Westfield Energy Recovery Ltd

Form No: Air 4 (A1)

Reporting of Continuously Monitored Emissions to Air for CO, Emission Point Report for Mar, 2026

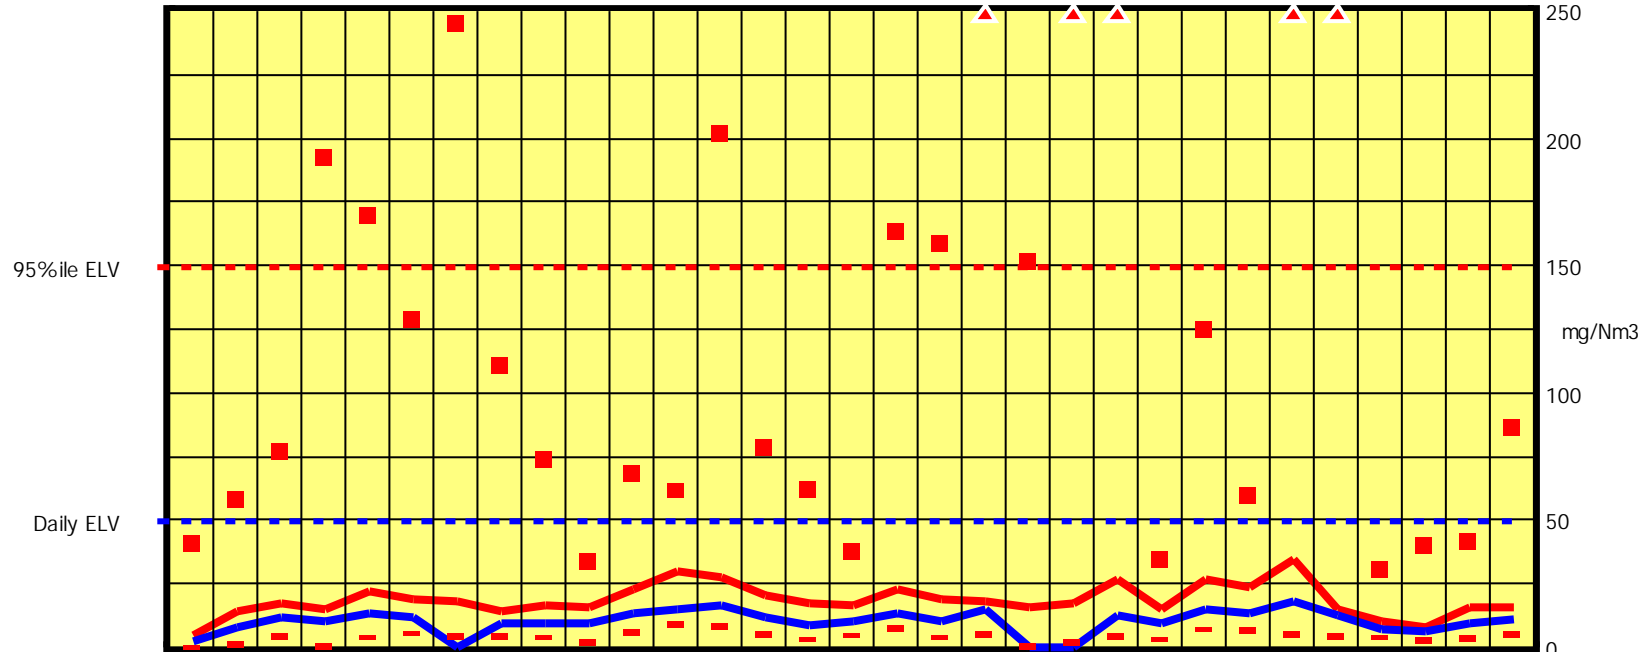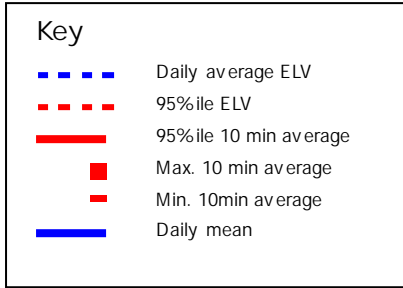

Month summary	
10 minute data	
Monthly max.	421.4
Monthly mean	11.2
Monthly min.	0.0
Total invalid	0
Sum > ELV	14
Total %ile exceed.	0
Daily ELV	
Monthly max	18.3
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
95%ile 10 min ELV	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
Max.	40.7	57.9	77.4	192.7	170.0	129.0	245.6	110.7	73.9	34.0	68.1	61.7	201.8	78.5	62.4	37.7	163.6	159.0	309.0	151.5	265.5	378.2	34.5	125.3	60.0	361.6	421.4	30.3	40.3	41.5	86.6
10 min 95%ile	5.0	13.9	17.5	14.8	21.9	18.6	18.3	14.0	16.1	15.6	22.5	30.0	27.5	20.4	17.0	16.5	22.5	18.6	18.3	15.3	17.6	26.6	14.7	26.9	23.2	34.3	15.2	10.1	8.0	15.4	16.0
Min.	0.0	1.4	4.4	0.3	3.9	5.4	4.2	4.1	4.0	2.2	5.8	8.9	8.1	5.0	3.3	4.7	7.5	3.9	5.2	0.3	1.9	4.5	3.3	7.1	6.7	5.3	4.5	4.0	2.9	3.3	5.0
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	1	1	0	1	0	0	0	0	0	1	0	0	0	1	1	2	1	1	1	0	0	0	2	1	0	0	0	0
ELV exceeded?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Daily ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	
Daily Mean	2.6	7.6	11.8	9.9	13.0	12.1	N/A	9.5	9.2	9.2	13.4	15.1	16.7	11.5	9.0	10.5	13.5	10.2	14.6	N/A	N/A	12.7	9.2	15.1	13.6	18.3	12.5	7.2	6.0	9.1	11.2
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO₂, Emission Point Report for Mar, 2026

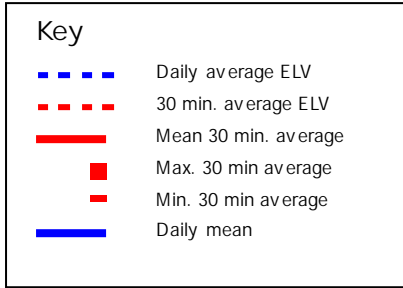

97th Percentile = 7.3
No. of valid averages = 1445

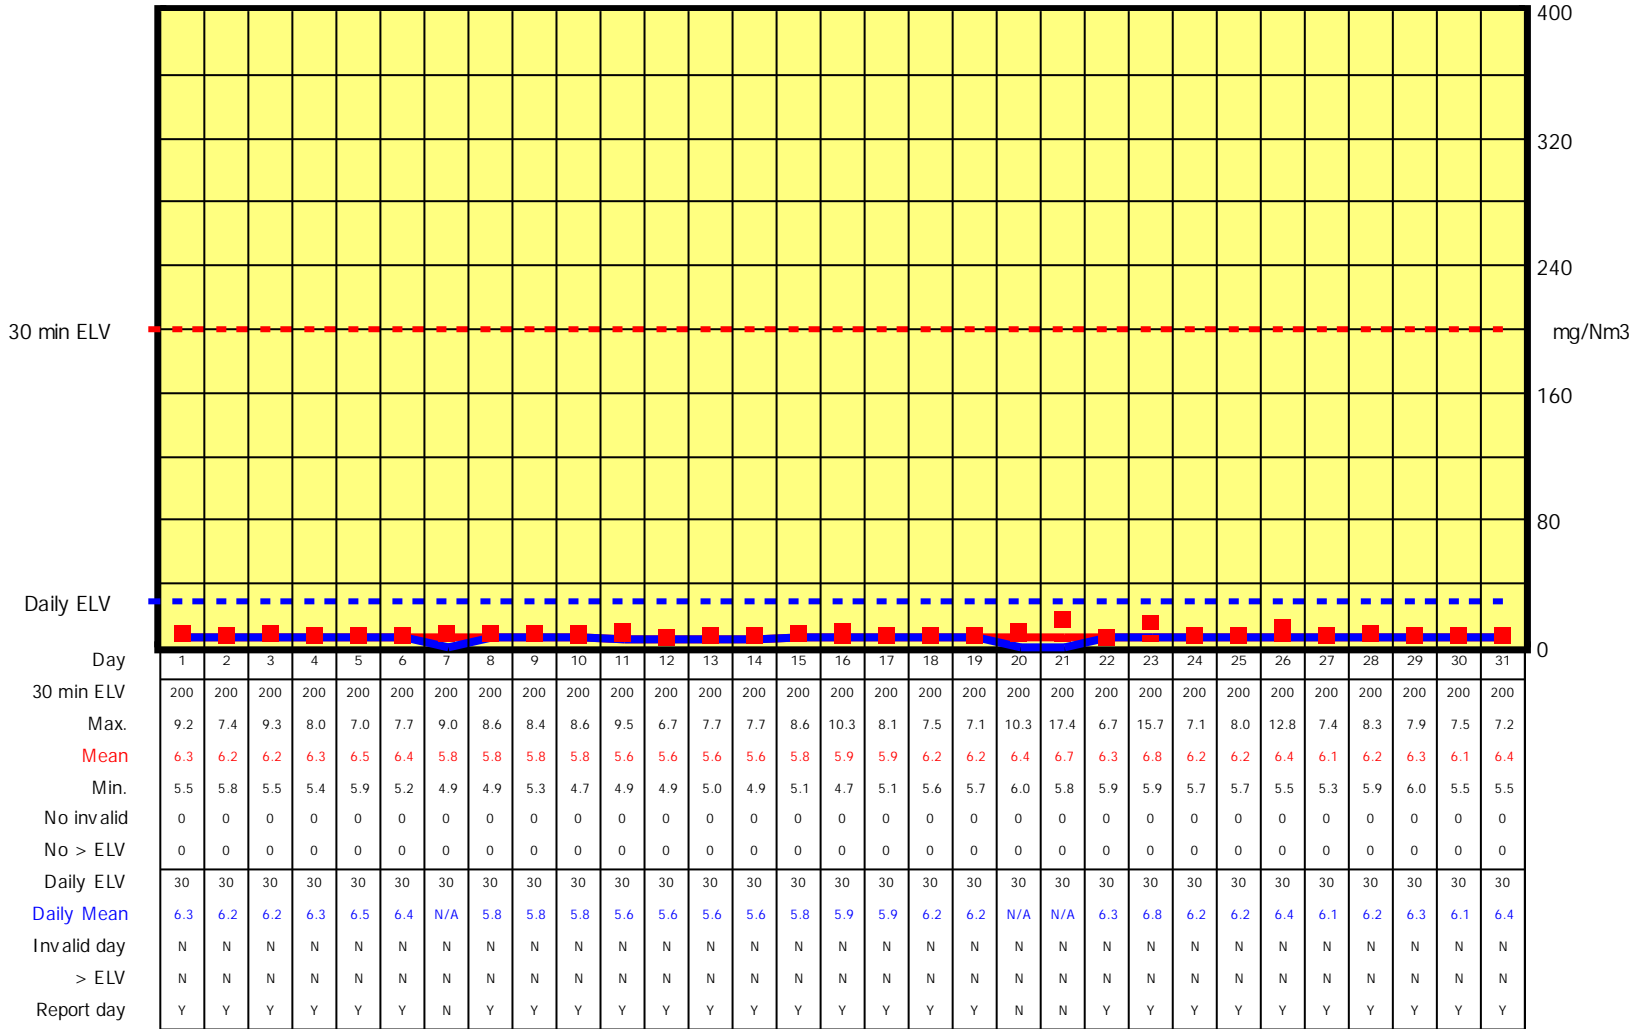

Month summary	
30 min ELV	
Monthly max.	17.4
Monthly mean	6.1
Monthly min.	4.7
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	6.8
No. invalid days	0
No. > ELV	0
No. report days	28

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCL, Emission Point Report for Mar, 2026

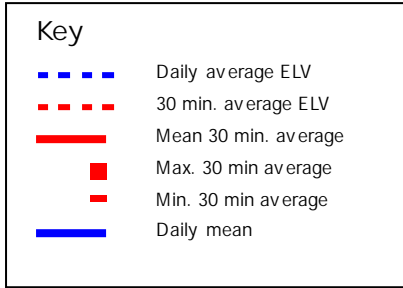

97th Percentile = 4.6
No. of valid averages = 1445

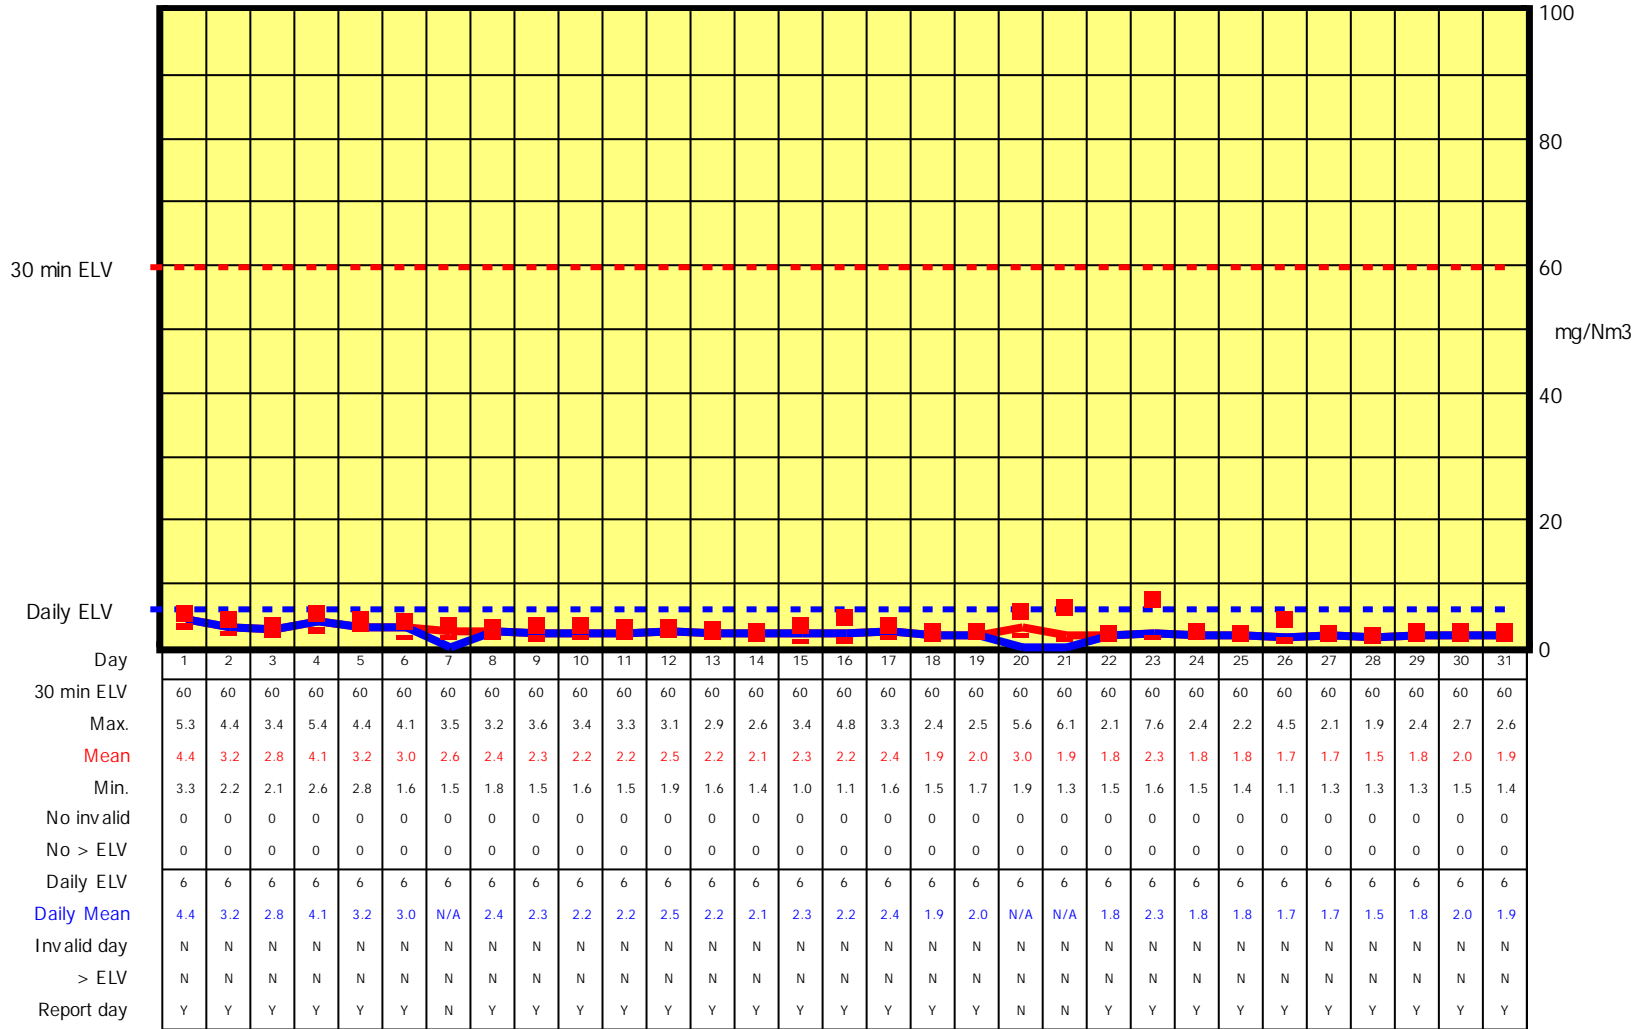

Month summary	
30 min ELV	
Monthly max.	7.6
Monthly mean	2.4
Monthly min.	1.0
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	4.4
No. invalid days	0
No. > ELV	0
No. report days	28

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH₃, Emission Point Report for Mar, 2026

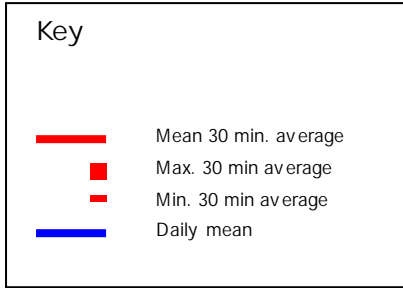

97th Percentile = 0.8
No. of valid averages = 1445

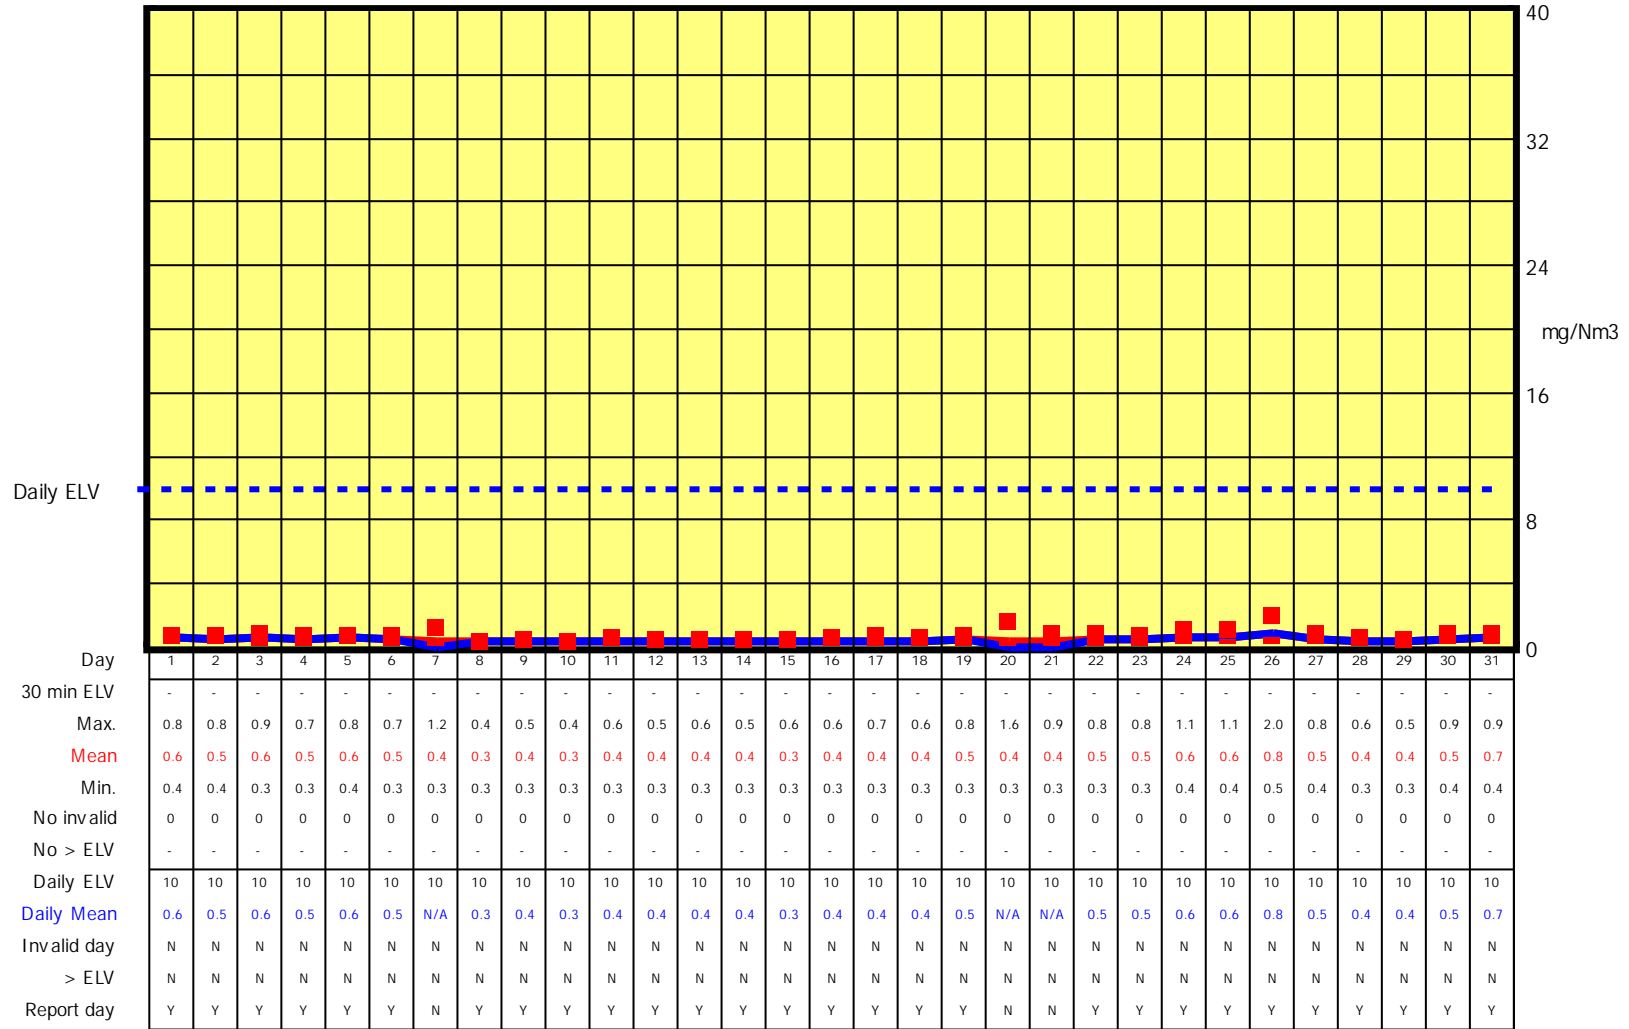

Month summary	
30 min ELV	
Monthly max.	2.0
Monthly mean	0.5
Monthly min.	0.3
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	0.8
No. invalid days	0
No. > ELV	0
No. report days	28

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC, Emission Point Report for Mar, 2026

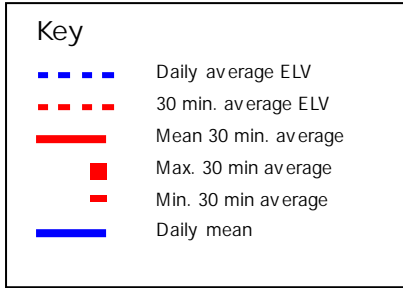

97th Percentile = 0.4
No. of valid averages = 1445

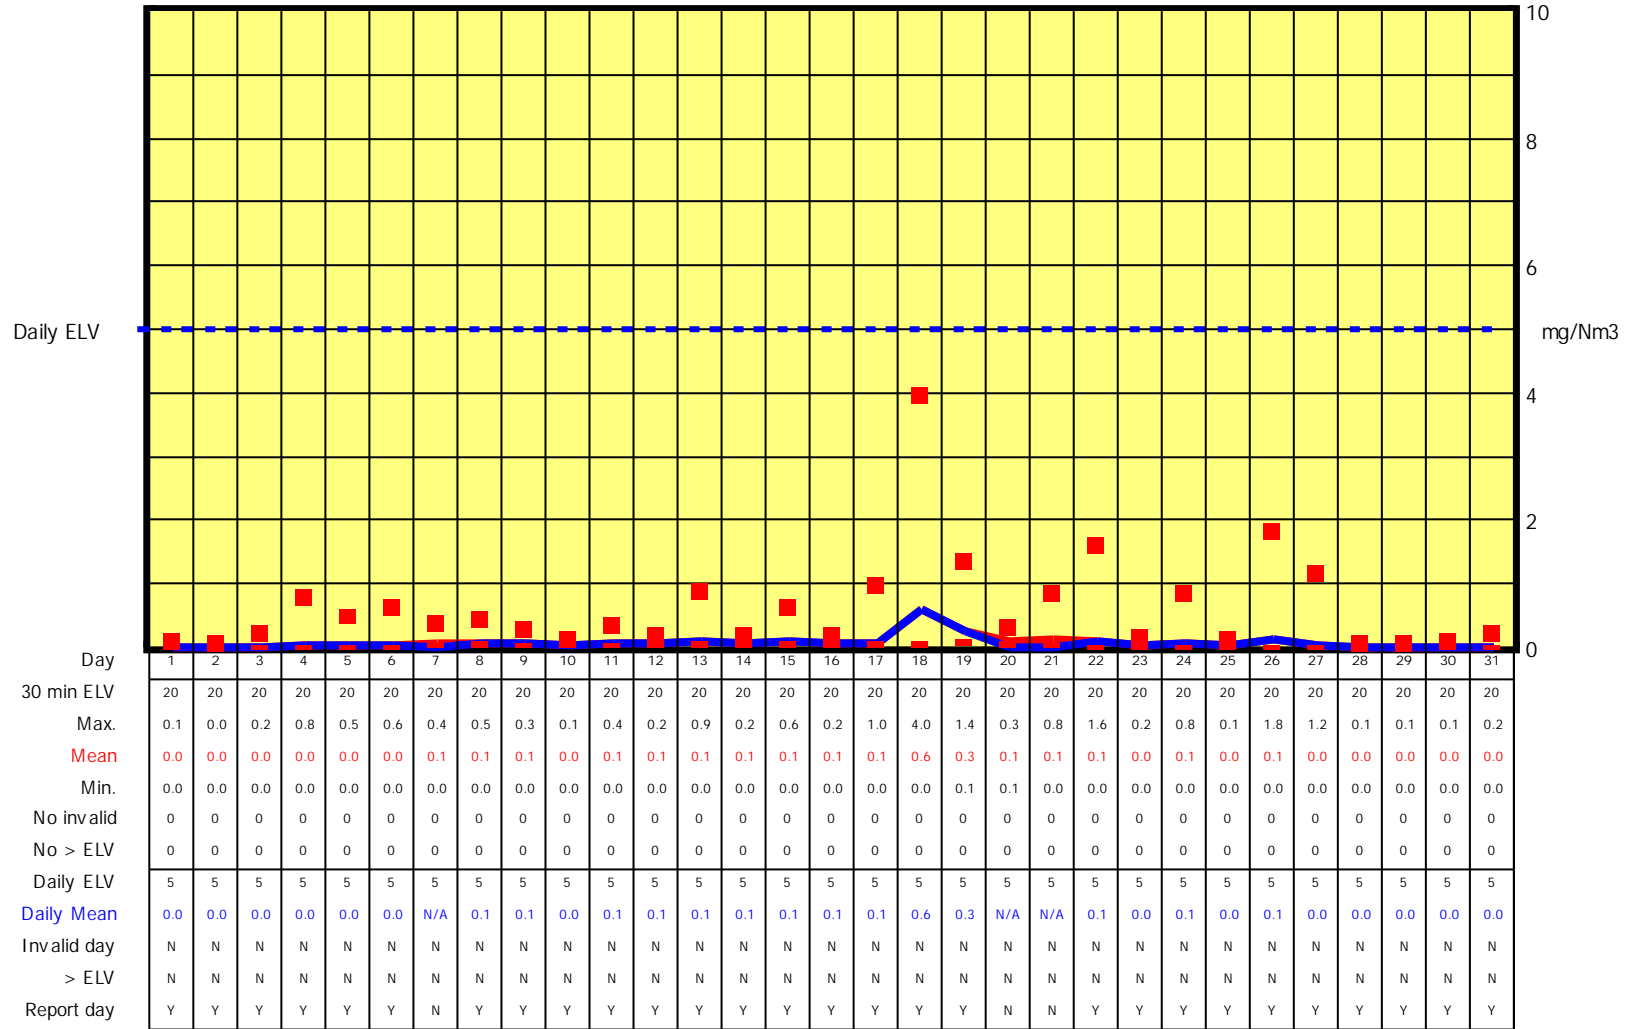

Month summary	
30 min ELV	
Monthly max.	4.0
Monthly mean	0.1
Monthly min.	0.0
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	0.6
No. invalid days	0
No. > ELV	0
No. report days	28

Data is as processed without repairs.

Signature _____
authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O, Emission Point Report for Mar, 2026

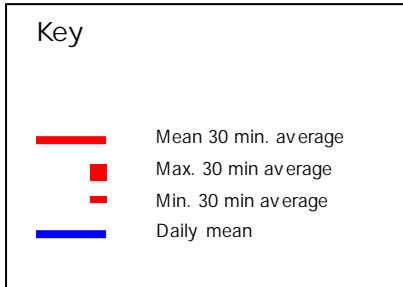

97th Percentile = 5.4
No. of valid averages = 1445

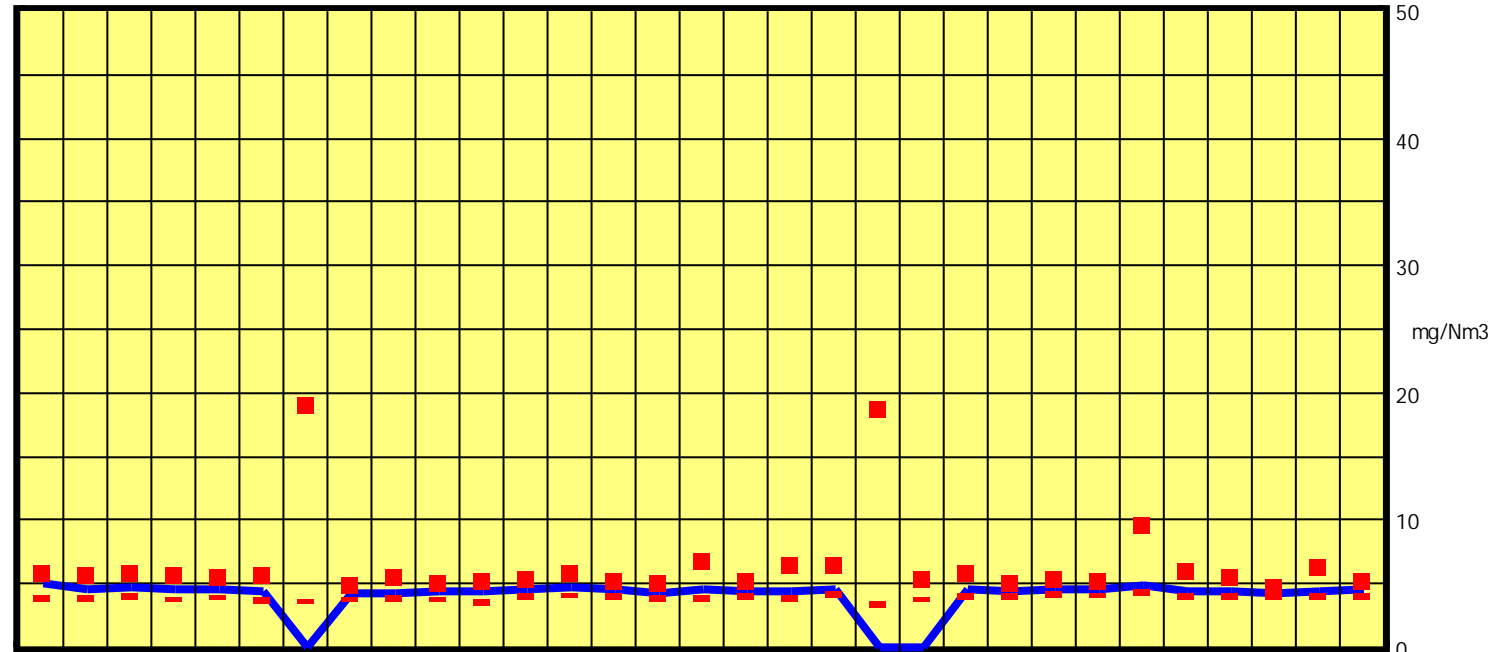

Month summary	
30 min ELV	
Monthly max.	19.0
Monthly mean	4.5
Monthly min.	3.4
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	5.0
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	5.9	5.6	5.9	5.7	5.5	5.7	19.0	4.9	5.5	5.1	5.2	5.3	5.8	5.1	5.0	6.8	5.2	6.5	6.5	18.8	5.3	5.8	5.1	5.4	5.2	9.7	6.0	5.5	4.8	6.3	5.2
Mean	5.0	4.5	4.8	4.5	4.6	4.5	4.7	4.3	4.3	4.4	4.4	4.5	4.7	4.5	4.2	4.6	4.4	4.4	4.6	4.9	4.2	4.5	4.4	4.6	4.5	4.9	4.4	4.4	4.3	4.5	4.5
Min.	3.8	3.8	4.0	3.8	3.9	3.7	3.6	3.8	3.9	3.8	3.6	4.0	4.1	4.0	3.8	3.9	4.0	3.9	4.1	3.4	3.8	4.0	4.1	4.1	4.1	4.3	4.0	4.0	4.0	4.0	4.0
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	5.0	4.5	4.8	4.5	4.6	4.5	N/A	4.3	4.3	4.4	4.4	4.5	4.7	4.5	4.2	4.6	4.4	4.4	4.6	N/A	N/A	4.5	4.4	4.6	4.5	4.9	4.4	4.4	4.3	4.5	4.5
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO₂, Emission Point Report for Mar, 2026

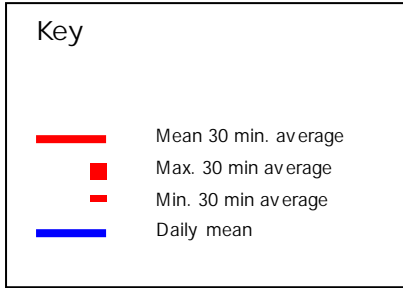

97th Percentile = 8.3
 No. of valid averages = 1445

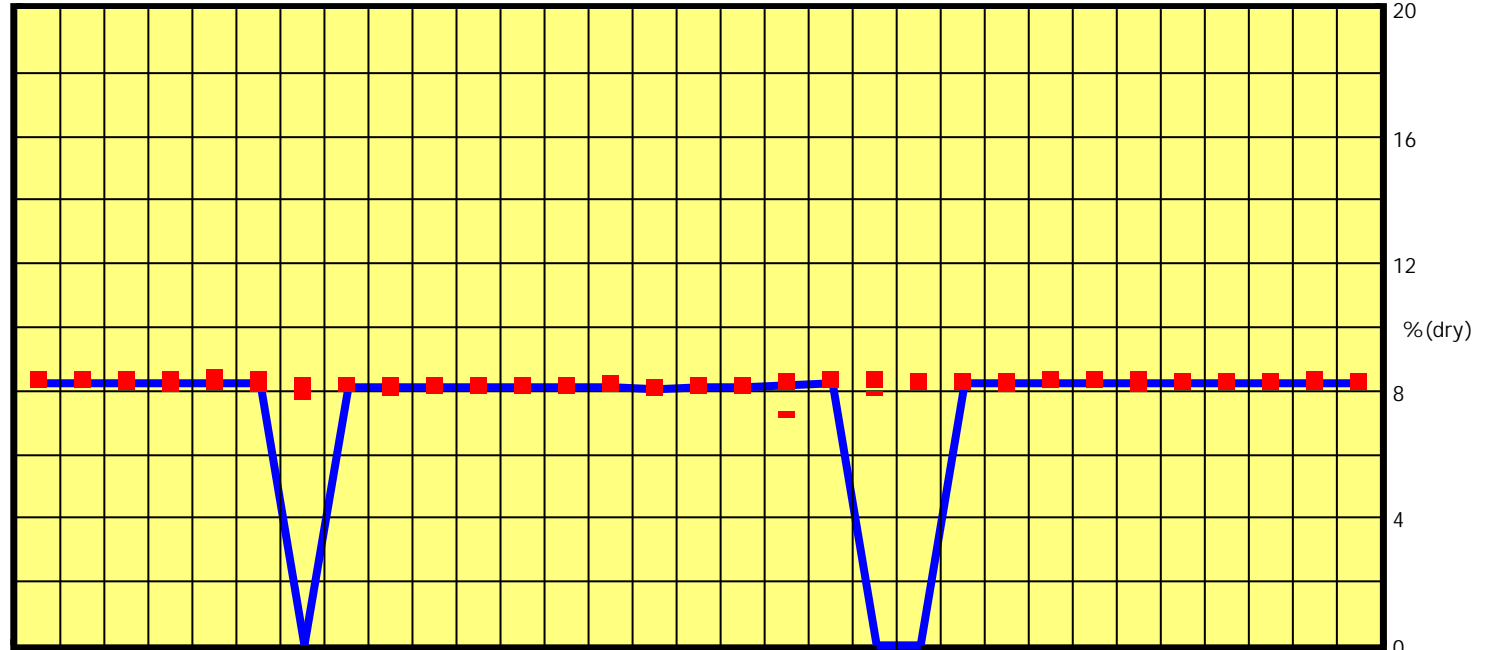

Month summary	
30 min ELV	
Monthly max.	8.4
Monthly mean	8.2
Monthly min.	7.2
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	8.3
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	8.3	8.4	8.4	8.3	8.4	8.4	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.2	8.3	8.4	8.4	8.3	8.3	8.3	8.4	8.3	8.4	8.3	8.3	8.4	8.3	
Mean	8.3	8.3	8.3	8.2	8.3	8.2	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.2	8.3	8.2	8.3	8.2	8.2	8.3	8.3	8.3	8.2	8.2	8.2	8.2	
Min.	8.2	8.2	8.1	8.0	8.1	8.0	7.8	8.1	7.9	8.0	8.0	8.1	8.1	8.1	8.0	8.0	8.1	7.2	8.2	7.9	8.2	8.2	8.1	8.2	8.2	8.1	8.2	8.2	8.1	8.1	
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Daily Mean	8.3	8.3	8.3	8.2	8.3	8.2	N/A	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.2	8.3	N/A	N/A	8.2	8.2	8.3	8.3	8.3	8.2	8.2	8.2	8.2	
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for O₂, Emission Point Report for Mar, 2026

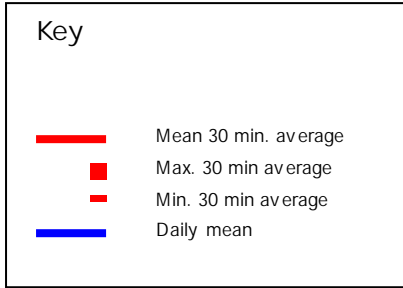

97th Percentile = 7.9
No. of valid averages = 1445

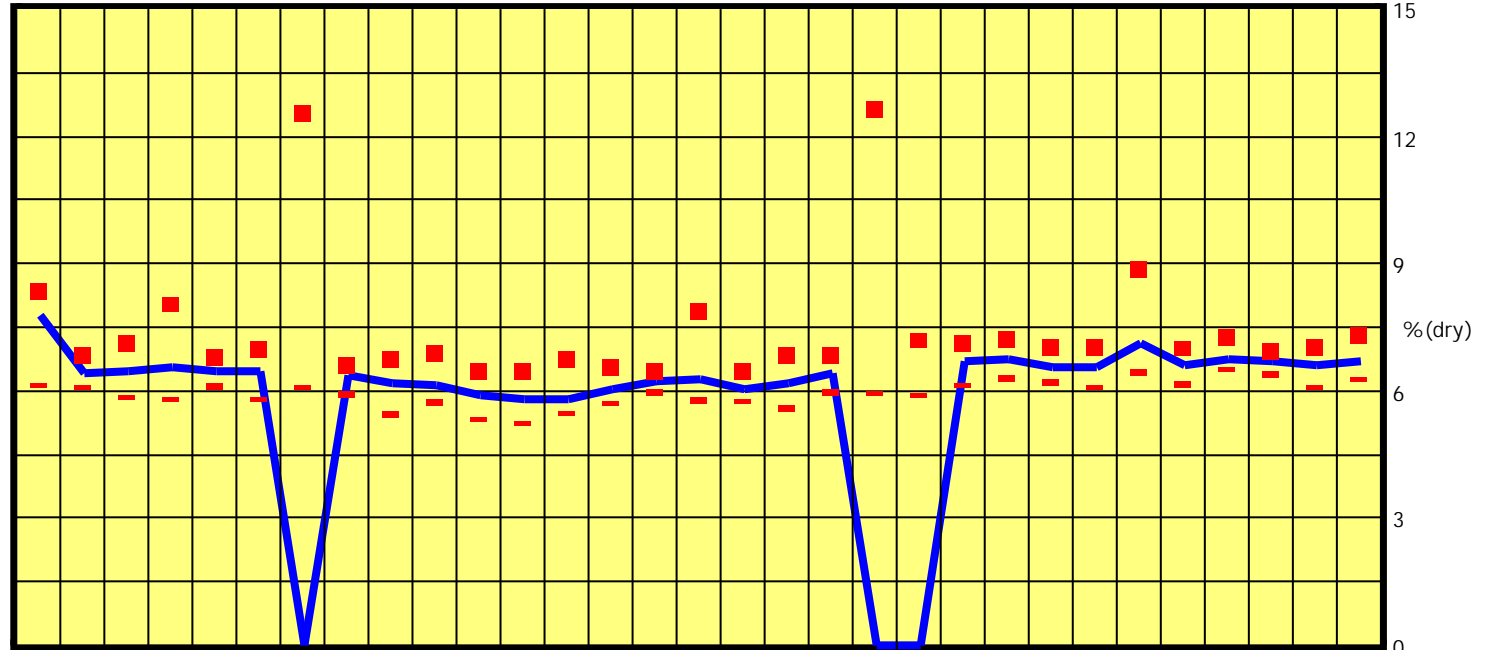

Month summary	
30 min ELV	
Monthly max.	12.6
Monthly mean	6.5
Monthly min.	5.2
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	7.8
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	8.3	6.8	7.1	8.0	6.8	7.0	12.5	6.6	6.7	6.9	6.5	6.5	6.7	6.6	6.5	7.9	6.5	6.8	6.9	12.6	7.2	7.1	7.2	7.0	7.0	8.9	7.0	7.3	6.9	7.0	7.3
Mean	7.8	6.4	6.5	6.6	6.5	6.5	6.5	6.4	6.2	6.1	5.9	5.8	5.8	6.0	6.2	6.3	6.0	6.2	6.4	7.1	6.4	6.7	6.7	6.6	6.6	7.1	6.6	6.8	6.7	6.6	6.7
Min.	6.1	6.1	5.8	5.8	6.1	5.8	6.1	5.9	5.4	5.7	5.3	5.2	5.5	5.7	6.0	5.8	5.8	5.6	6.0	6.0	5.9	6.1	6.3	6.2	6.1	6.4	6.1	6.5	6.4	6.1	6.3
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	7.8	6.4	6.5	6.6	6.5	6.5	N/A	6.4	6.2	6.1	5.9	5.8	5.8	6.0	6.2	6.3	6.0	6.2	6.4	N/A	N/A	6.7	6.7	6.6	6.6	7.1	6.6	6.8	6.7	6.6	6.7
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for H2O, Emission Point Report for Mar, 2026

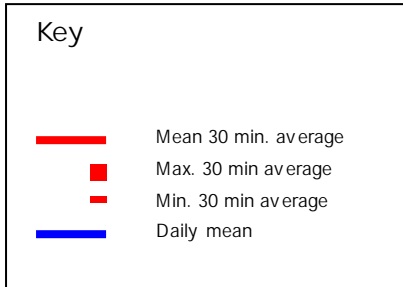

97th Percentile = 22.1
No. of valid averages = 1445

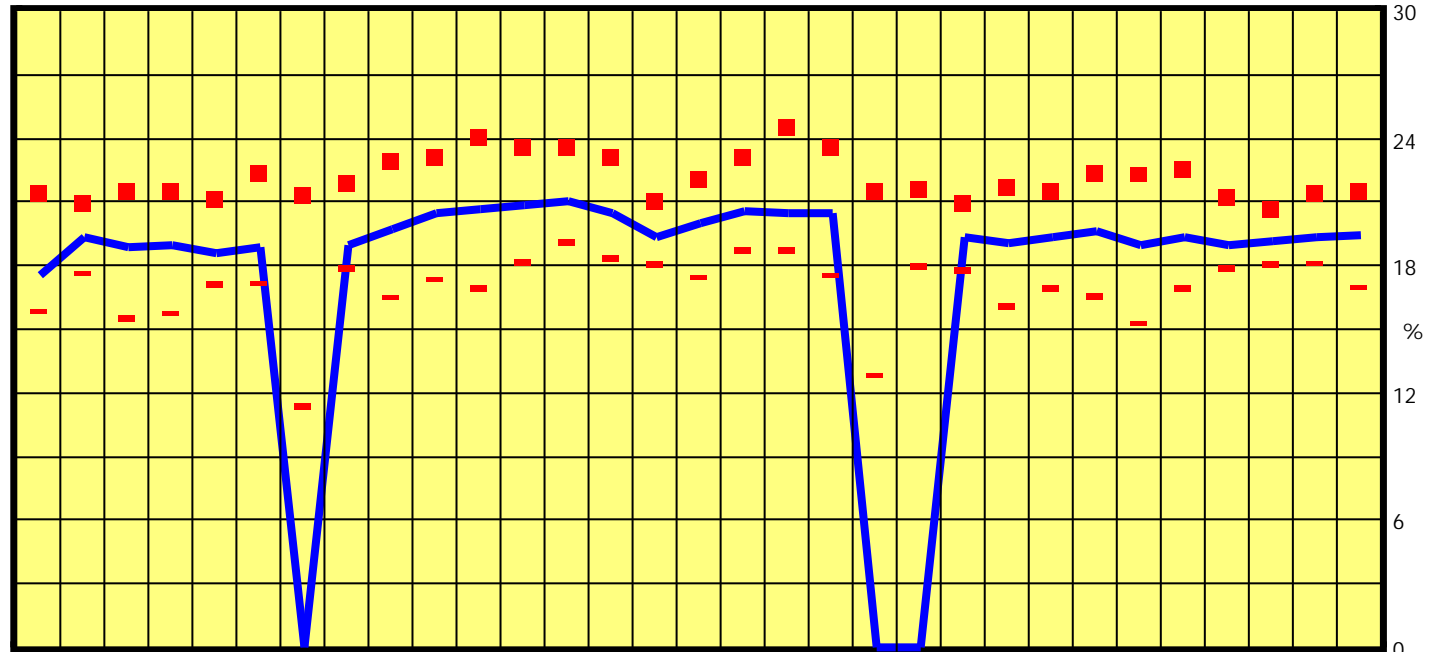

Month summary	
30 min ELV	
Monthly max.	24.5
Monthly mean	19.5
Monthly min.	11.4
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	21.0
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Max.	21.4	20.9	21.5	21.5	21.2	22.3	21.3	21.9	22.9	23.1	24.1	23.6	23.6	23.1	21.1	22.0	23.1	24.5	23.5	21.5	21.6	21.0	21.7	21.5	22.4	22.3	22.6	21.2	20.6	21.4	21.5
Mean	17.6	19.3	18.8	19.0	18.6	18.9	19.1	18.9	19.7	20.5	20.6	20.9	21.0	20.4	19.4	20.0	20.6	20.5	20.5	18.4	19.6	19.3	19.1	19.3	19.6	19.0	19.4	19.0	19.1	19.4	19.5
Min.	15.8	17.6	15.5	15.7	17.1	17.2	11.4	17.9	16.5	17.4	16.9	18.2	19.1	18.4	18.1	17.4	18.7	18.8	17.5	12.8	18.0	17.8	16.1	17.0	16.5	15.3	16.9	17.9	18.1	18.1	17.0
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily ELV	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Daily Mean	17.6	19.3	18.8	19.0	18.6	18.9	N/A	18.9	19.7	20.5	20.6	20.9	21.0	20.4	19.4	20.0	20.6	20.5	20.5	N/A	N/A	19.3	19.1	19.3	19.6	19.0	19.4	19.0	19.1	19.4	19.5
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____


Permit No: PPC/A/1181922

Facility: Westfield Energy


Operator: Westfield Energy Recovery Ltd

Form No: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for Dust, Emission Point Report for Mar, 2026

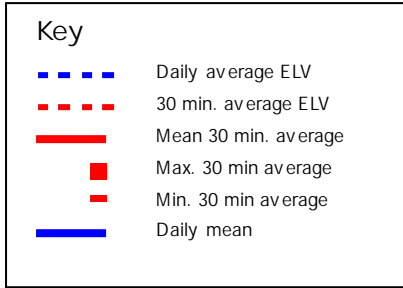

97th Percentile = 1.3
No. of valid averages = 1445

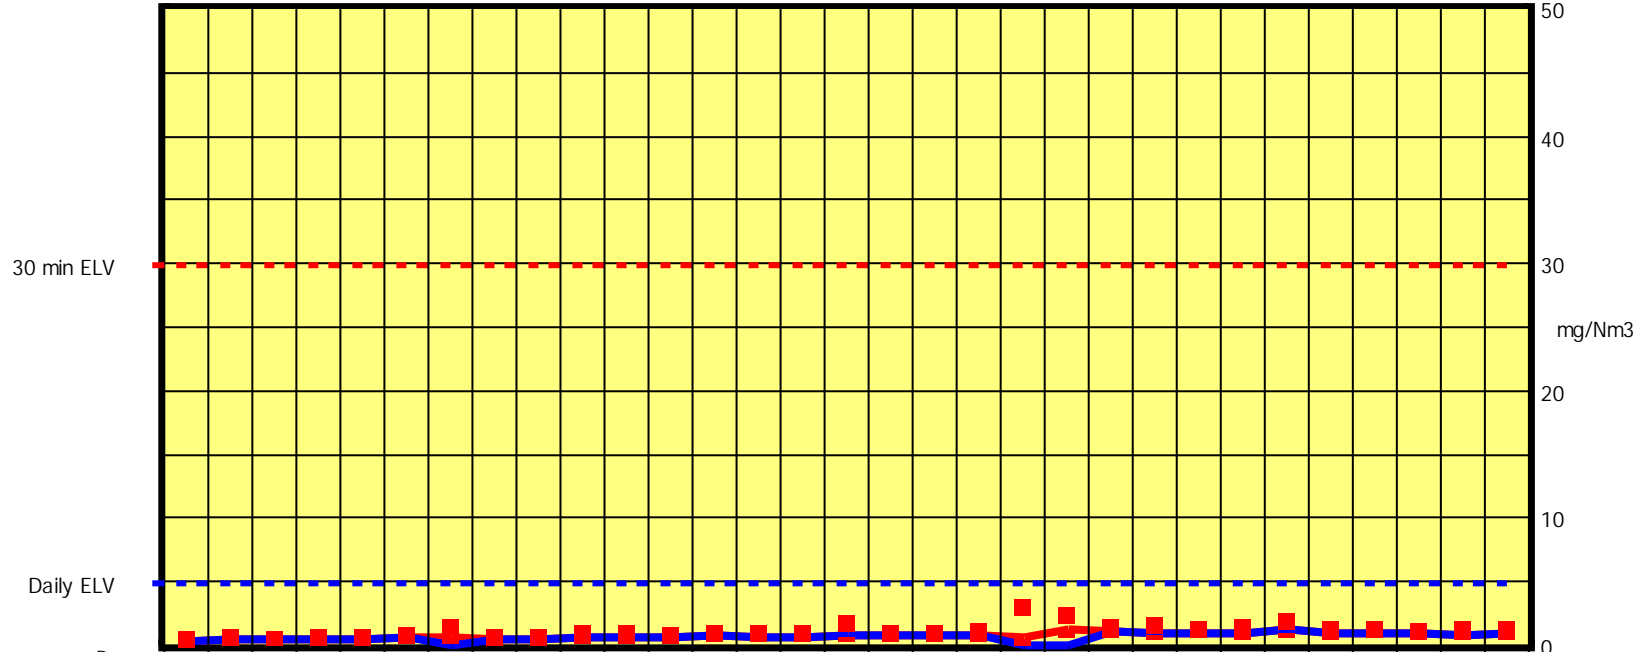

Month summary	
30 min ELV	
Monthly max.	3.0
Monthly mean	0.7
Monthly min.	0.2
Total invalid	0
Sum > ELV	0
Daily ELV	
Monthly max	1.2
No. invalid days	0
No. > ELV	0
No. report days	28

Day	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
30 min ELV	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
Max.	0.5	0.6	0.5	0.6	0.6	0.8	1.3	0.6	0.7	0.9	1.0	0.7	1.0	0.9	0.9	1.7	1.0	0.9	1.1	3.0	2.4	1.4	1.6	1.2	1.4	1.9	1.2	1.3	1.2	1.2	1.3
Mean	0.4	0.5	0.5	0.5	0.5	0.6	0.6	0.5	0.5	0.6	0.6	0.6	0.7	0.6	0.7	0.8	0.7	0.8	0.8	0.7	1.2	1.1	0.9	1.0	1.0	1.2	0.9	1.0	0.9	1.0	
Min.	0.3	0.4	0.4	0.4	0.4	0.4	0.3	0.4	0.4	0.4	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.7	0.5	0.2	0.8	0.8	0.6	0.8	0.7	0.8	0.7	0.8	0.7	0.6	0.6
No invalid	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
No > ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Daily ELV	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	
Daily Mean	0.4	0.5	0.5	0.5	0.5	0.6	N/A	0.5	0.5	0.6	0.6	0.6	0.7	0.6	0.7	0.8	0.7	0.8	0.8	N/A	N/A	1.1	0.9	1.0	1.0	1.2	0.9	1.0	0.9	0.9	1.0
Invalid day	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
> ELV	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Report day	Y	Y	Y	Y	Y	Y	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	N	N	Y	Y	Y	Y	Y	Y	Y	Y	Y	

Data is as processed without repairs.

Signature _____

authorised to sign on behalf of the company

Date _____