


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 3 (A1)

Reporting of Continuously Monitored Emissions to Air for HCl mg/Nm3 at Emission Point A1 For the month of May 2026

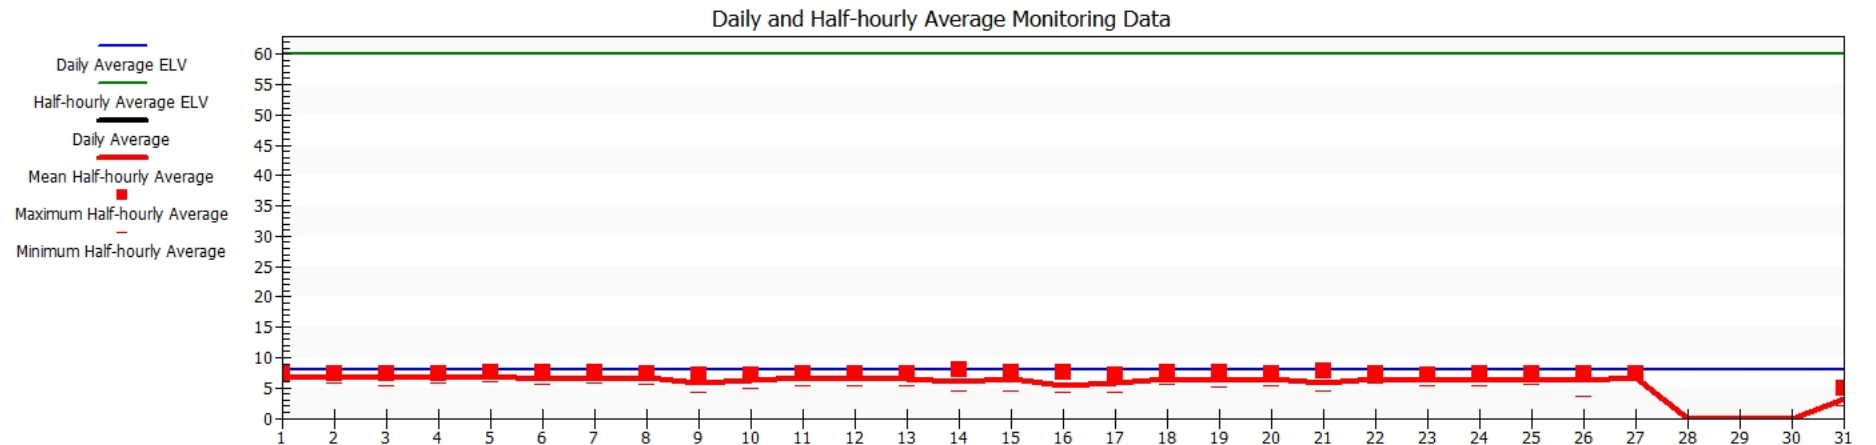

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0	60.0
	Monthly maximum	7.9	Maximum Half-hourly average	7.5	7.4	7.4	7.4	7.6	7.5	7.7	7.4	7.1	7.2	7.4	7.3	7.4	7.9	7.6	7.6	7.0	7.6	7.5	7.3	7.8	7.3	7.1	7.3	7.3	7.4	7.3	Off	Off	Off	4.9
	Monthly mean	6.3	Mean Half-hourly average	6.9	6.7	6.7	6.8	7.0	6.5	6.5	6.6	5.9	6.3	6.6	6.4	6.4	5.9	6.5	5.5	5.8	6.5	6.2	6.6	5.9	6.5	6.2	6.2	6.6	6.2	6.8	Off	Off	Off	3.2
	Monthly minimum	2.1	Minimum Half-hourly average	6.4	5.8	5.4	5.8	6.0	5.5	5.7	5.7	4.3	4.9	5.3	5.5	5.5	4.4	4.6	4.2	4.3	5.6	5.2	5.3	4.6	5.7	5.5	5.3	5.6	3.6	6.5	Off	Off	Off	2.1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0
Daily average			Daily average ELV	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0
	Monthly maximum	7.0	Daily average	6.9	6.7	6.7	6.8	7.0	6.5	6.5	6.6	5.9	6.3	6.6	6.4	6.4	5.9	6.5	5.5	5.8	6.5	6.2	6.6	5.9	6.5	6.2	6.2	6.6	6.2	6.8	Off	Off	Off	3.2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 5 (A1)

Reporting of Continuously Monitored Emissions to Air for SO₂ mg/Nm³ at Emission Point A1 For the month of May 2026

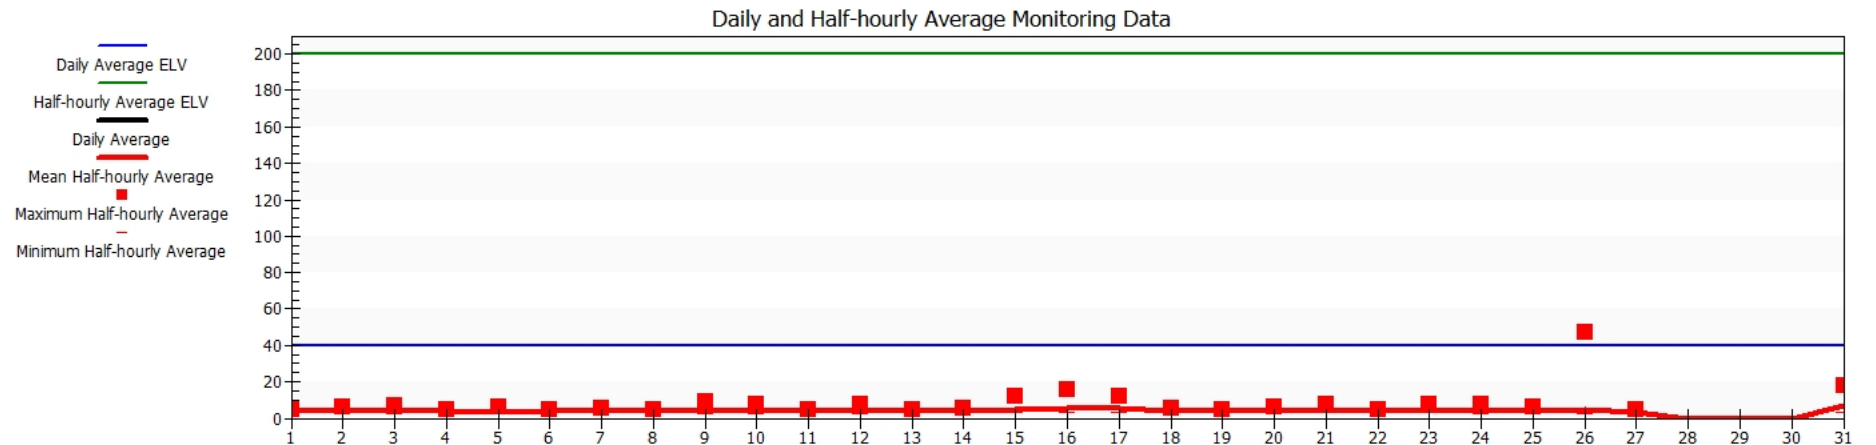

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200	200
	Monthly maximum	47	Maximum Half-hourly average	5	6	7	4	6	5	6	5	9	8	5	7	5	5	12	16	12	6	5	6	8	5	8	8	6	47	5	Off	Off	Off	18
	Monthly mean	4	Mean Half-hourly average	4	4	4	4	4	4	4	4	4	4	4	4	4	4	5	5	5	4	4	4	4	4	4	4	4	5	4	Off	Off	Off	7
	Monthly minimum	3	Minimum Half-hourly average	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	4	4	3	3	4	3	3	3	3	3	3	3	Off	Off	Off	3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0
Daily average			Daily average ELV	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40
	Monthly maximum	7	Daily average	4	4	4	4	4	4	4	4	4	4	4	4	4	4	5	5	5	4	4	4	4	4	4	4	4	5	4	Off	Off	Off	7
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 6 (A1)

Reporting of Continuously Monitored Emissions to Air for NOx mg/Nm3 at Emission Point A1 For the month of May 2026

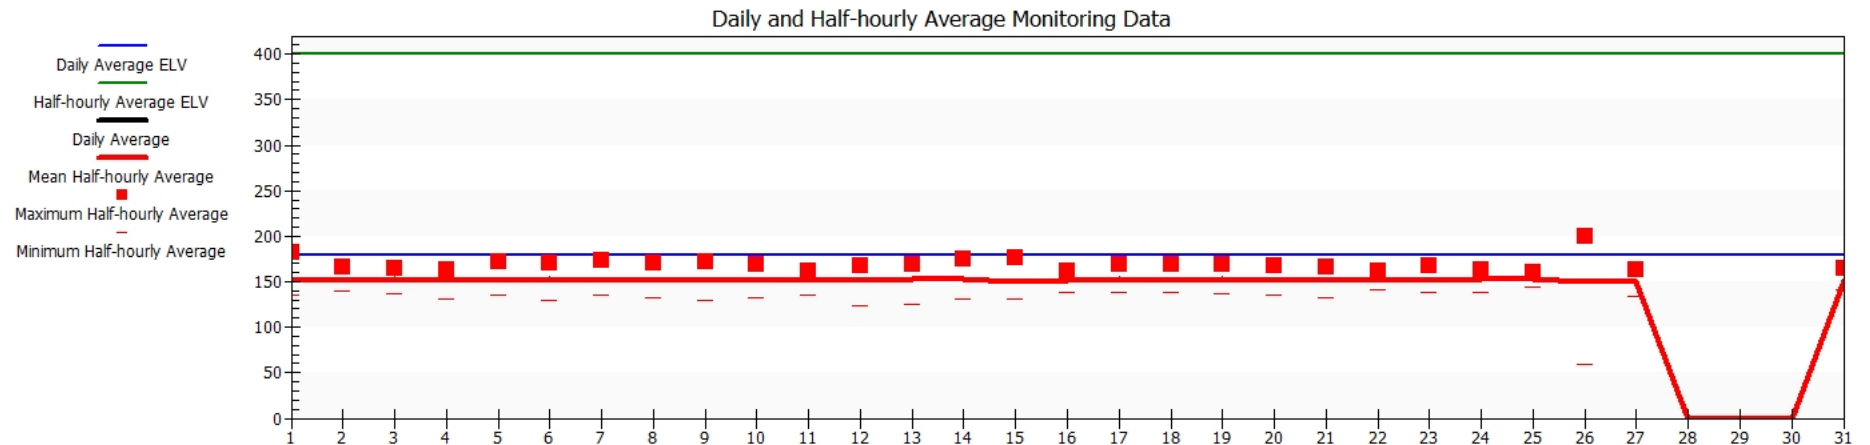

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400	400
	Monthly maximum	200	Maximum Half-hourly average	182	166	164	163	172	170	174	170	172	169	161	168	169	175	176	162	169	168	170	167	166	162	167	164	160	200	163	Off	Off	Off	164
	Monthly mean	152	Mean Half-hourly average	151	152	152	152	152	153	152	152	152	152	153	152	153	153	151	152	152	152	152	152	152	152	152	152	152	150	151	Off	Off	Off	152
	Monthly minimum	59	Minimum Half-hourly average	136	139	137	131	136	130	135	132	130	132	136	124	125	131	130	139	138	138	137	136	133	141	138	138	144	59	134	Off	Off	Off	141
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off	0
Daily average			Daily average ELV	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180	180
	Monthly maximum	153	Daily average	151	152	152	152	152	153	152	152	152	152	153	152	153	153	151	152	152	152	152	152	152	152	152	152	152	150	151	Off	Off	Off	152
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 2 (A1)

Reporting of Continuously Monitored Emissions to Air for TOC mg/Nm3 at Emission Point A1 For the month of May 2026

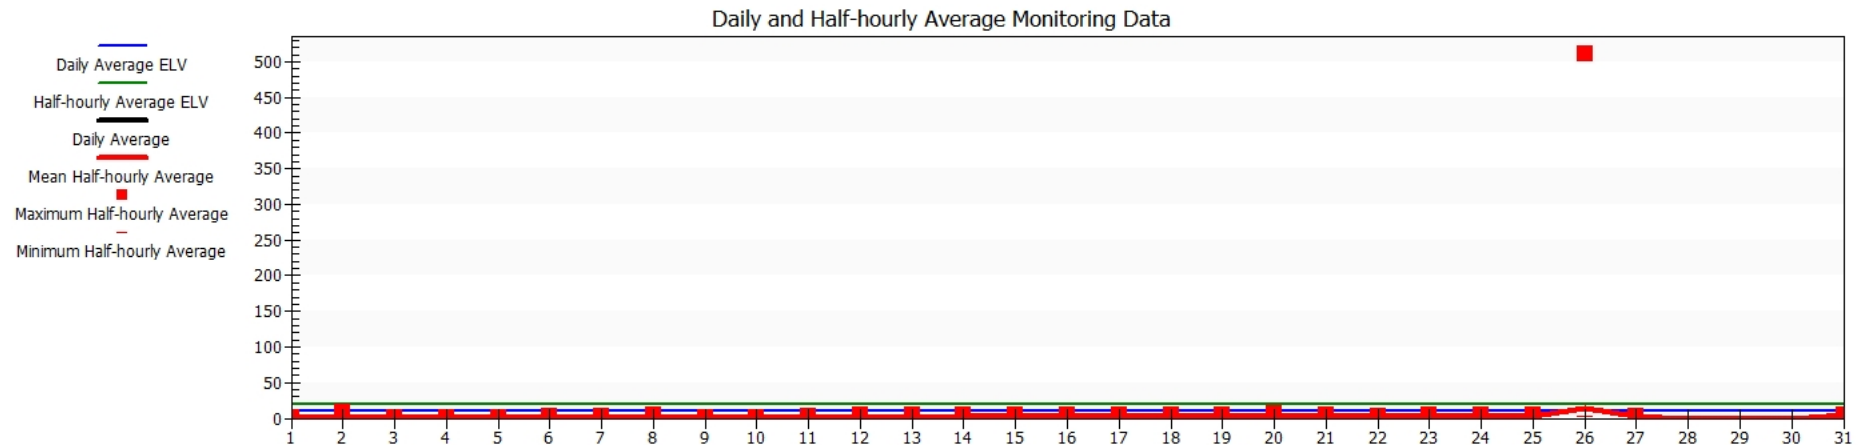

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0	20.0
	Monthly maximum	510.9	Maximum Half-hourly average	0.8	7.9	0.8	0.8	0.9	2.6	3.6	4.2	1.1	1.2	2.9	5.1	4.0	3.8	4.0	5.6	5.3	5.2	4.1	5.9	5.3	3.7	4.1	4.5	3.9	510.9	3.6	Off	Off	Off	5.3
	Monthly mean	2.7	Mean Half-hourly average	0.8	0.9	0.8	0.8	0.8	0.8	1.0	1.7	0.9	0.8	1.2	3.0	1.4	1.9	2.9	3.7	3.7	4.0	2.9	3.4	3.8	2.7	2.9	3.1	3.1	14.4	2.6	Off	Off	Off	4.2
	Monthly minimum	0.0	Minimum Half-hourly average	0.5	0.6	0.6	0.6	0.5	0.6	0.1	0.4	0.7	0.6	0.5	0.2	0.0	0.2	1.9	2.3	2.3	2.7	2.3	2.3	2.5	1.0	1.7	2.1	2.4	2.3	1.6	Off	Off	Off	3.3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	2	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	Off	Off	Off
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
	Monthly maximum	14.4	Daily average	0.8	0.9	0.8	0.8	0.8	0.8	1.0	1.7	0.9	0.8	1.2	3.0	1.4	1.9	2.9	3.7	3.7	4.0	2.9	3.4	3.8	2.7	2.9	3.1	3.1	14.4	2.6	Off	Off	Off	4.2
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	1	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	Y	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 7 (A1)

Reporting of Continuously Monitored Emissions to Air for NH3 mg/Nm3 at Emission Point A1 For the month of May 2026

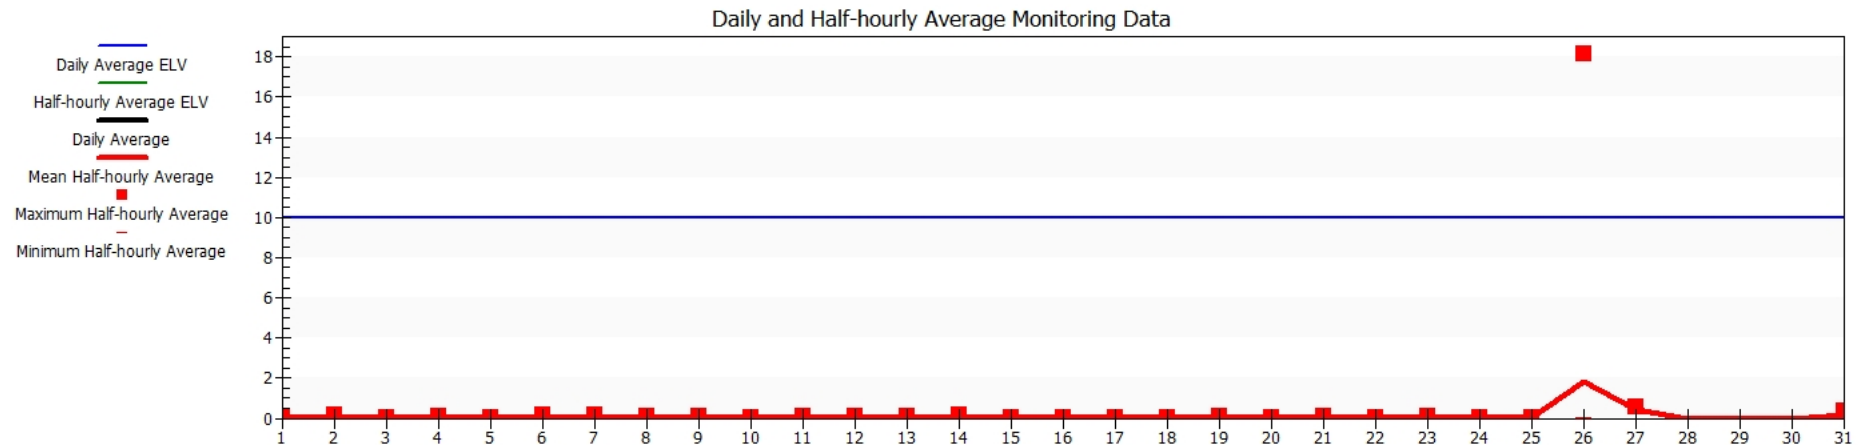

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	18.1	Maximum Half-hourly average	0.1	0.2	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.0	0.1	0.1	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	18.1	0.5	Off	Off	Off	0.4	
	Monthly mean	0.1	Mean Half-hourly average	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.8	0.4	Off	Off	Off	0.2	
	Monthly minimum	0.0	Minimum Half-hourly average	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	Off	Off	Off	0.0	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	Off	N/A
Daily average			Daily average ELV	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	
	Monthly maximum	1.8	Daily average	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.8	0.4	Off	Off	Off	0.2	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 1 (A1)

Reporting of Continuously Monitored Emissions to Air for Particulates mg/Nm3 at Emission Point A1 For the month of May 2026

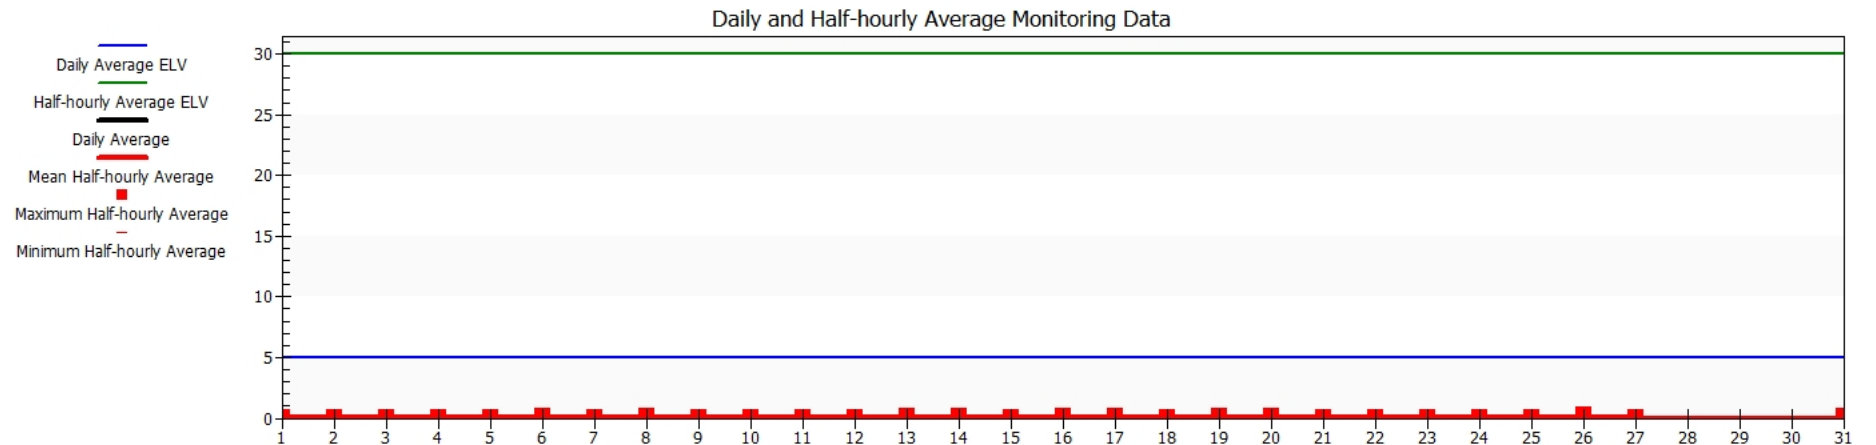

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Monthly maximum	0.3	Maximum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.3	0.1	Off	Off	Off	0.1
	Monthly mean	0.1	Mean Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	Off	Off	Off	0.1
	Monthly minimum	0.1	Minimum Half-hourly average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	Off	Off	Off	0.1
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Off	Off	Off
Daily average			Daily average ELV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
	Monthly maximum	0.1	Daily average	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	Off	Off	Off	0.1
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 8 (A1)

Reporting of Continuously Monitored Emissions to Air for N2O mg/Nm3 at Emission Point A1 For the month of May 2026

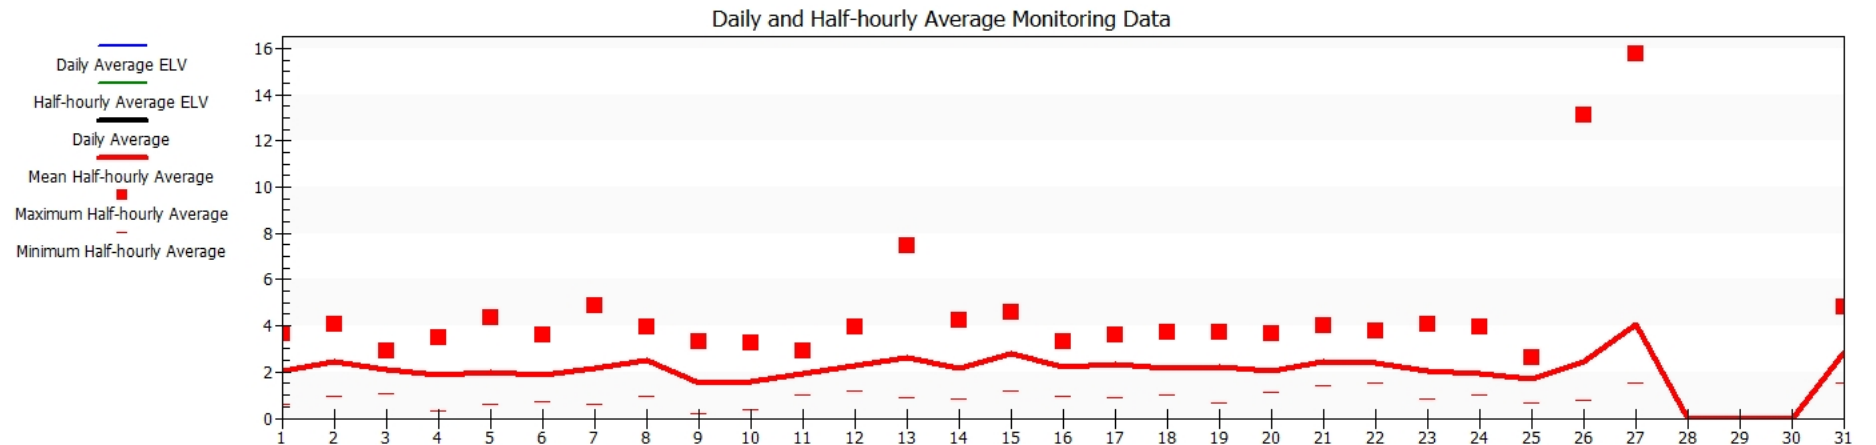

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	15.8	Maximum Half-hourly average	3.7	4.0	2.9	3.5	4.3	3.6	4.9	4.0	3.3	3.3	2.9	4.0	7.5	4.3	4.6	3.3	3.6	3.7	3.7	3.7	4.0	3.8	4.1	4.0	2.6	13.1	15.8	Off	Off	Off	4.8
	Monthly mean	2.2	Mean Half-hourly average	2.0	2.4	2.1	1.9	2.0	1.9	2.2	2.5	1.5	1.6	1.9	2.3	2.6	2.2	2.8	2.2	2.3	2.2	2.2	2.1	2.5	2.4	2.1	1.9	1.7	2.5	4.1	Off	Off	Off	2.9
	Monthly minimum	0.2	Minimum Half-hourly average	0.6	1.0	1.1	0.3	0.6	0.7	0.6	0.9	0.2	0.4	1.0	1.2	0.9	0.8	1.2	1.0	0.9	1.0	0.7	1.1	1.4	1.5	0.8	1.0	0.7	0.8	1.5	Off	Off	Off	1.5
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	Off
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	4.1	Daily average	2.0	2.4	2.1	1.9	2.0	1.9	2.2	2.5	1.5	1.6	1.9	2.3	2.6	2.2	2.8	2.2	2.3	2.2	2.2	2.1	2.5	2.4	2.1	1.9	1.7	2.5	4.1	Off	Off	Off	2.9
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air A (A1)

Reporting of Continuously Monitored Emissions to Air for CO2 % at Emission Point A1 For the month of May 2026

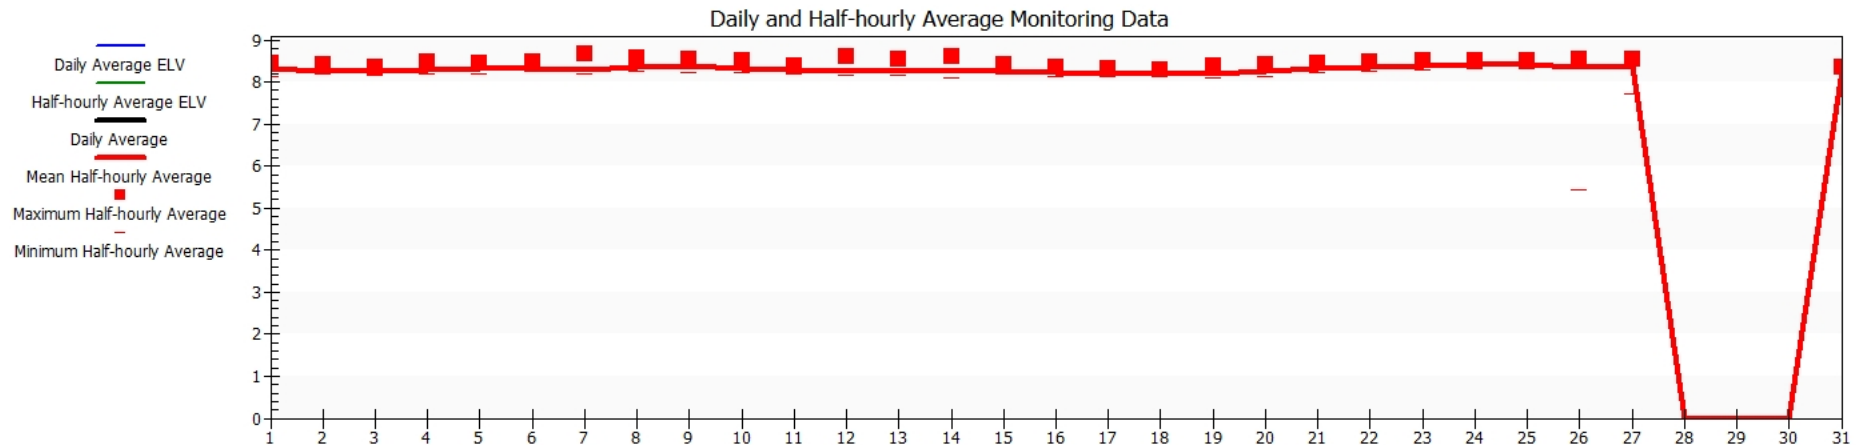

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	8.7	Maximum Half-hourly average	8.4	8.4	8.4	8.5	8.5	8.5	8.7	8.6	8.5	8.5	8.4	8.6	8.5	8.6	8.4	8.3	8.3	8.3	8.4	8.4	8.5	8.5	8.5	8.5	8.5	8.5	8.5	Off	Off	Off	8.4	
	Monthly mean	8.3	Mean Half-hourly average	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4	8.3	8.3	8.3	8.3	8.3	8.3	8.2	8.2	8.2	8.2	8.3	8.3	8.3	8.3	8.4	8.4	8.4	8.3	8.4	Off	Off	Off	8.3
	Monthly minimum	5.5	Minimum Half-hourly average	8.1	8.2	8.2	8.2	8.2	8.3	8.2	8.3	8.2	8.2	8.2	8.2	8.2	8.2	8.1	8.2	8.1	8.1	8.1	8.1	8.1	8.2	8.3	8.3	8.3	8.3	5.5	7.7	Off	Off	Off	8.3
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	Off	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	8.4	Daily average	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4	8.3	8.3	8.3	8.3	8.3	8.3	8.2	8.2	8.2	8.2	8.3	8.3	8.3	8.3	8.4	8.4	8.4	8.3	8.4	Off	Off	Off	8.3
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air B (A1)

Reporting of Continuously Monitored Emissions to Air for Dry Oxygen % at Emission Point A1 For the month of May 2026

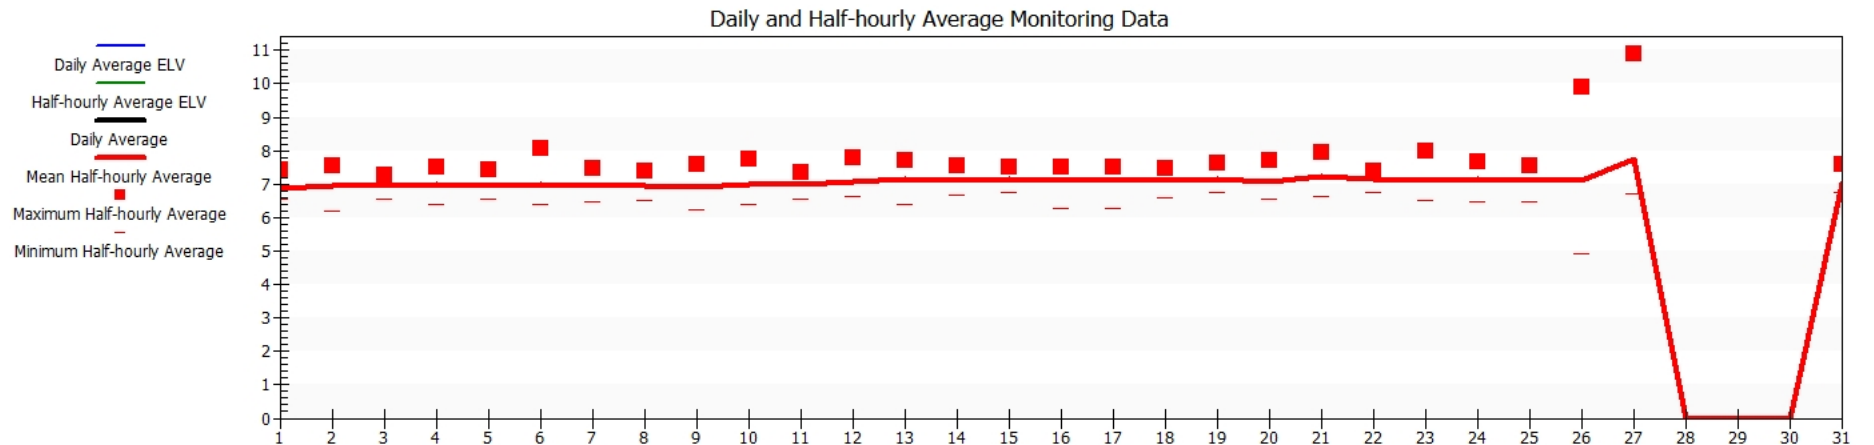

Monthly summary			Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	10.9	Maximum Half-hourly average	7.4	7.5	7.3	7.5	7.4	8.1	7.5	7.4	7.6	7.7	7.3	7.8	7.7	7.6	7.5	7.5	7.5	7.5	7.6	7.7	7.9	7.4	8.0	7.7	7.6	9.9	10.9	Off	Off	Off	7.6
	Monthly mean	7.1	Mean Half-hourly average	6.9	7.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9	7.0	7.0	7.1	7.2	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.2	7.2	7.1	7.2	7.1	7.1	7.7	Off	Off	Off	7.0
	Monthly minimum	4.9	Minimum Half-hourly average	6.6	6.2	6.5	6.4	6.5	6.4	6.5	6.5	6.2	6.4	6.5	6.6	6.4	6.7	6.8	6.3	6.3	6.6	6.8	6.5	6.6	6.7	6.5	6.5	6.5	4.9	6.7	Off	Off	Off	6.7
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	Off	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	7.7	Daily average	6.9	7.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9	7.0	7.0	7.1	7.2	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.2	7.2	7.1	7.2	7.1	7.1	7.7	Off	Off	Off	7.0
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)


Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air C (A1)

Reporting of Continuously Monitored Emissions to Air for Moisture % at Emission Point A1 For the month of May 2026

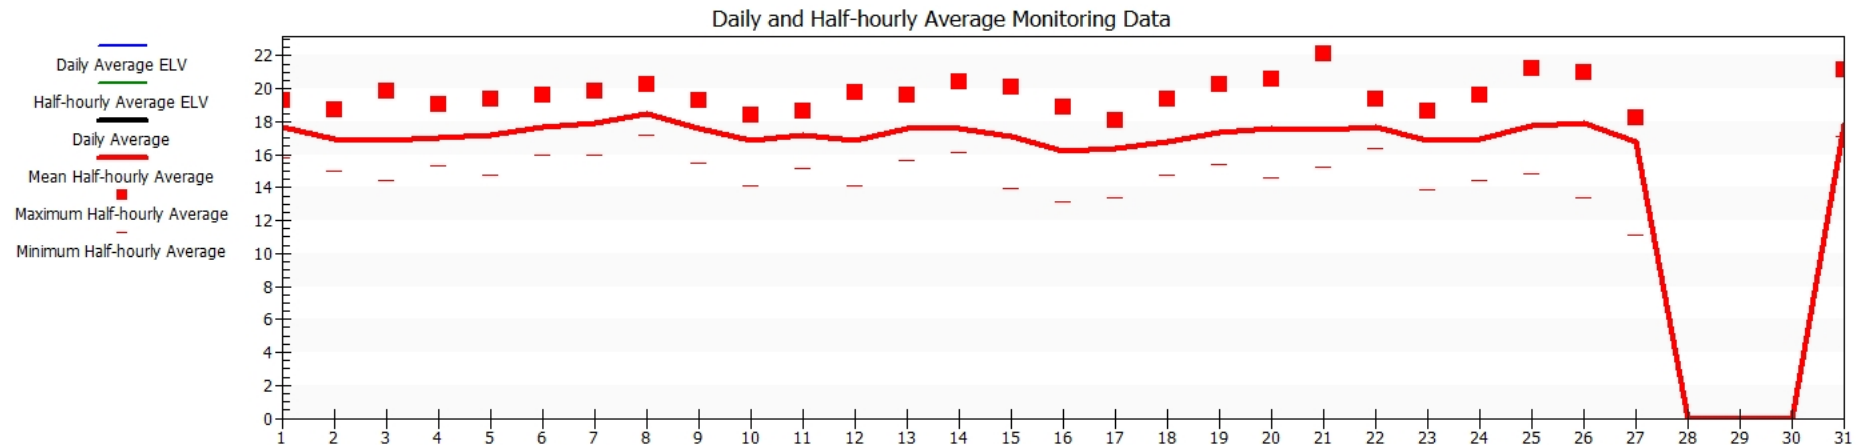

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	
Half-hourly average			Half-hourly average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	22.1	Maximum Half-hourly average	19.3	18.7	19.8	19.0	19.4	19.6	19.9	20.3	19.3	18.4	18.7	19.8	19.6	20.4	20.1	18.9	18.0	19.4	20.2	20.5	22.1	19.3	18.7	19.6	21.2	21.0	18.3	Off	Off	Off	21.1	
	Monthly mean	17.3	Mean Half-hourly average	17.7	16.9	16.9	17.1	17.2	17.7	17.9	18.4	17.6	16.8	17.2	16.8	17.6	17.6	17.1	16.2	16.4	16.8	17.4	17.6	17.5	17.7	16.9	17.0	17.8	17.9	16.8	Off	Off	Off	17.8	
	Monthly minimum	11.1	Minimum Half-hourly average	15.8	15.0	14.4	15.3	14.7	15.9	15.9	17.2	15.5	14.1	15.2	14.1	15.7	16.1	13.9	13.1	13.4	14.7	15.4	14.6	15.3	16.4	13.9	14.4	14.9	13.4	11.1	Off	Off	Off	17.1	
	Total Invalid results	0	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
	Sum of exceedances	0	No of exceedances of ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Off	Off	Off	N/A
Daily average			Daily average ELV	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Monthly maximum	18.4	Daily average	17.7	16.9	16.9	17.1	17.2	17.7	17.9	18.4	17.6	16.8	17.2	16.8	17.6	17.6	17.1	16.2	16.4	16.8	17.4	17.6	17.5	17.7	16.9	17.0	17.8	17.9	16.8	Off	Off	Off	17.8	
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV?	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....


(Authorised to sign as a representative of the Operator)

Permit Reference Number : PPC/A/1157446

Operator : Kanadevia Inova UK Operations Ltd

Installation: Earlsgate Energy Center

Form Number: Air 4 (A1)

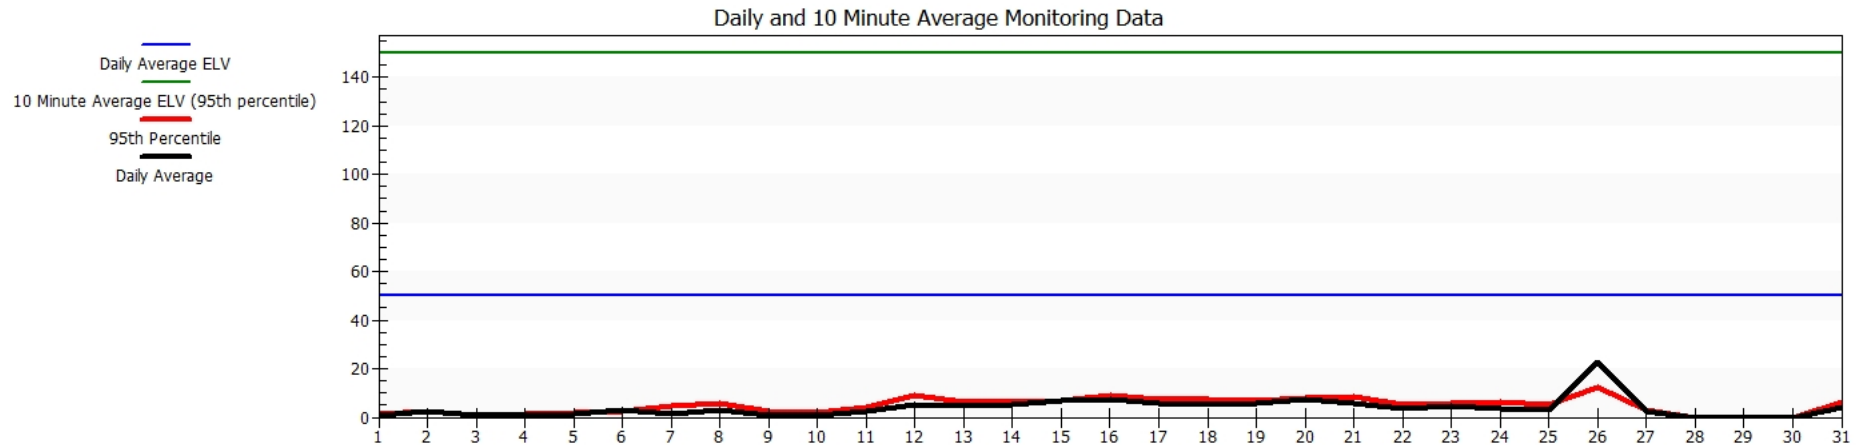Reporting of Continuously Monitored Emissions to Air for CO mg/Nm³ at Emission Point A1 For the month of May 2026

	Monthly summary		Date	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31
10 Minute average			10 Minute average ELV (95th Percentile)	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150	150
	Monthly Maximum 10-min	1846	Maximum 10 Minute average	9	87	21	3	24	209	27	58	26	8	64	60	35	56	250	210	182	8	174	175	9	6	68	64	9	1846	9	Off	Off	Off	7
	Monthly mean 10-min avgs	4	95th Percentile	1	2	1	2	2	2	5	6	2	2	4	9	6	6	7	9	7	7	7	8	8	5	6	6	5	13	3	Off	Off	Off	6
	Monthly Minimum 10-min	0	Minimum 10 Minute average	0	0	0	0	0	0	0	0	0	0	0	1	2	2	2	2	2	3	2	2	3	1	1	1	2	1	0	Off	Off	Off	1
	Total Invalid results	1	No of Invalid results	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0
			Number of results above 150mg/m³	0	0	0	0	0	1	0	0	0	0	0	0	0	0	1	1	1	0	1	1	0	0	0	0	0	2	0	Off	Off	Off	0
	Sum of Exceedances of 95th percentile ELV	0	95th Percentile ELV Exceeded (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N
Daily average			Daily average ELV	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50	50
	Monthly maximum	23	Daily average	1	2	1	1	1	3	2	3	1	1	2	5	5	5	7	7	6	5	6	7	6	3	5	4	3	23	2	Off	Off	Off	4
	No of invalid days	0	Value Valid?	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	Y	
	Sum of exceedances	0	Value Exceeds ELV? (Y/N)	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N	N

Signed.....

Date.....

(Authorised to sign as a representative of the Operator)

Environment Agency explanatory note: The 10-minute average ELV is based on the "95th percentile" In this case this means that 95% of the 10 minute averages in the calendar day (= 137) must be below 150 mg/m³, and 5% (= 7) are allowed to be any value above 150 mg/m³. Whilst we expect operators to minimise CO emissions at all times, it is perfectly acceptable for the value of the maximum 10-minute average to be above 150 mg/m³, provided the 95th percentile ELV has been met for that period